

**Brunner Island, LLC**  
**REGULATORY DELIVERABLE**  
**SUBMITTAL COVER SHEET**

<b>Date:</b>	March 08, 2024	<b>Transmittal No.:</b>	BI-47-2024-03-08-v.1 (Part A)
<b>DOCUMENT DESCRIPTION:</b>	Quarterly Groundwater Report: 1st Quarter 2024--Basin 5, Disposal Area 8, and Pyrite Tomb Area, Brunner Island, LLC		
<b>CONSENT DECREE REFERENCE:</b>	Paragraph No.:	<b>47</b>	
<b>BRIEF DESCRIPTION OF OUTLINED REQUIREMENT:</b>	Brunner shall promptly provide Citizens with all deliverables required under this Consent Decree, as well as quarterly groundwater monitoring data from Ash Basins 5 and 6 and Disposal Area 8.		
<b>RECIPIENT(S):</b>			
<b>NAME:</b>		<b>ORGANIZATION:</b>	
Thomas Weissinger		Talen Energy	
Lisa Widawsky Hallowell (email: lhallowell@environmentalintegrity.org)		EIP	
Dante Mack (email: dmack@environmentalintegrity.org)		EIP	
<b>Brunner Island, LLC Contact Name:</b>		Kathleen Locke	
<b>Brunner Island, LLC Contact Phone:</b>		(717) 268-1531	
<b>Mailing Address:</b>		<b>Street Address:</b>	
Brunner Island, LLC P. O. Box 221 York Haven, PA 17370		Brunner Island, LLC 1400 Wago Road Mt. Wolf, PA 17347	



**Martin E. Mengel, PG** • Project Manager – Environmental Services  
Talen Energy Supply, LLC  
600 Hamilton Street, Suite 600 • Allentown, PA 18101  
(610) 248-9665 • [Martin.Mengel@TalenEnergy.com](mailto:Martin.Mengel@TalenEnergy.com)

March 8, 2024

Mr. Timothy Long, PG  
Pennsylvania Department of Environmental Protection  
Waste Management Program  
909 Elmerton Ave.  
Harrisburg, Pennsylvania 17110

---

**RE: Quarterly Groundwater Report: 1st Quarter 2024  
Basin 5, Disposal Area 8, and Pyrite Tomb Area  
Brunner Island, LLC**

---

Dear Mr. Long:

Please accept this letter and attachments as the quarterly report for Basin 5 at the Brunner Island Steam Electric Station.

Note that a data table (water depth and pH) and associated trend plots for pyrite tomb standpipe monitoring have been added to this Basin 5 report, beginning with the second quarter 2017 groundwater report.

The analytical results are provided on Form 14R (enclosed) in accordance with the Basin 5 closure plan approved by the PADEP in December 2000. A summary table of results, an Excel spreadsheet file, and maps showing well locations are also enclosed.

Please call or email me with any questions. Thank you.

Sincerely,

Martin E. Mengel, PG/CHMM



Attachments: report, data table, pyrite tomb standpipe monitoring results, maps, LandLinks EDD, trend plots, 14Rs, and statistics summary

Cc: Kathleen Locke (w/atts.) – Brunner Island, LLC  
Ben Wilburn – Talen Energy Supply, LLC  
Citizens (w/atts.)

# Groundwater Monitoring Report – 1st Quarter 2024

## Brunner Island, LLC - Basin 5

### Brunner Island Steam Electric Station

---

#### **BACKGROUND**

The Brunner Island Steam Electric Station (Brunner Island SES) is located in York Haven, York County, Pennsylvania and is owned and operated by Brunner Island, LLC (Brunner). An overall Brunner Island SES map and a basin specific map are attached (Attachments 3 and 4).

The PADEP issued Residual Waste Permit # 301337 on December 28, 2000, approving the Basin 5 closure plan. The residual waste permit expired on December 27, 2007 and was not renewed by the PADEP. Brunner believes that Mandatory Abatement Trigger Levels (MATLs) no longer apply to Basin 5, as a result of the permit expiration, and therefore, Brunner no longer uses MATLs as the primary data screening tool for Basin 5 groundwater results.

Disposal Area 8 (a Class 2 residual waste landfill) was constructed on top of Basin 5. Construction was completed and disposal into the landfill began in late 2008. The permitted area for the landfill encompasses approximately 20 acres, however, currently only 9 acres have been constructed and are actively utilized. The existing groundwater monitoring network for Basin 5 was chosen and approved by the PADEP to serve as the monitoring network for Area 8 as well.

In accordance with Brunner's PADEP-approved *Workplan – Groundwater Risk Evaluation – Ash Basin 4 and Pyrite Tomb* dated September 29, 2016, a downgradient monitoring well MW-PT-1 was installed in January 2017 to help assess potential impacts from the pyrite tomb. Additionally, pH and liquid depth monitoring data and associated trend plots for water within the pyrite tomb standpipe have been added to this Basin 5 report, beginning with the second quarter of 2017.

In accordance with the closure/ post closure use plan, construction of the rail extension on Basin 5 was completed in 2013. As a result, moderate subsurface disturbance has occurred in the area.

Groundwater monitoring in the vicinity of Basin 5 is currently conducted quarterly as required in accordance with the approved Basin 5 closure plan. This groundwater monitoring generally includes sampling wells upgradient and downgradient of Basin 5 for indicator parameters of fly ash such as arsenic, boron, lithium, selenium, strontium, and total dissolved solids. Other parameters are routinely monitored in the vicinity of Basin 5 in accordance with permit requirements and are listed on the attached summary table of quarterly groundwater monitoring results (Attachment 1). Brunner reviews current and historical data (approximately the past 10 years) to identify trends and to compare data with Pennsylvania Act 2 residential Statewide Health Standards for used aquifers and/or EPA National Drinking Water Standards.

A groundwater recovery system was installed on the northern portion of Ash Basin 5 to abate apparent migration of dissolved constituents from the Pyrite Tomb area (located on the northeast corner of Ash Basin 5) and the Bottom Ash Processing Area (located on the northwest corner of Ash Basin 5). The groundwater recovery system consists of five groundwater recovery wells

designated as RW-5-B1 through RW-5-B5 associated with the Pyrite Tomb, and four groundwater recovery wells designated as RW-5-A1 through RW-5-A4 associated with the Bottom Ash Processing Area. Capture zones were determined to be sufficient as shown in the *Recovery Well Installation and Pumping Test Report* (rev. 1/23/2023). The full-time operation of the groundwater recovery began on February 6, 2024.

The effectiveness of the groundwater abatement (groundwater recovery system) will be based on the capture zones and/or reduction in concentrations of constituents of concern (COCs) in monitoring wells MW-8-4, MW-PT-1, MW-8-8A, MW-8-8B, MW-8-9B, and MW-8-9C on the east side of Ash Basin 5 (Pyrite Tomb area), and monitoring wells MW-8-5A and MW-8-5B on the west side of Ash Basin 5 (Bottom Ash Processing Area). The effectiveness of the recovery system will be evaluated over a 12-quarter period (3-years) based on data starting from the initiation of full-time groundwater recovery operations (February 6, 2024). A groundwater evaluation report is scheduled to be completed in approximately June 2027 to document the effectiveness of groundwater abatement (the report is required within 90 days of the expected March 2027 receipt of the 12th of 12 quarterly groundwater monitoring event results).

## **GROUNDWATER MONITORING PROGRAM**

### **Monitoring Locations – Basin 5**

Downgradient and upgradient monitoring wells for Basin 5 are listed below and shown on the attached Site Plan of Basin 5 (Attachment 4).

- Background monitoring well – MW-19
- Upgradient monitoring well – MW-4-7A
- Downgradient monitoring wells – MW-4-10, MW-8-1N, MW-8-2, MW-8-3A, MW-8-3B, MW-8-4, MW-8-5A, MW-8-5B, MW-8-10A, MW-8-10B, MW-8-10C, MW-8-12C, MW-8-8A, MW-8-8B, MW-8-9B, MW-8-9C, and MW-PT-1
- Pyrite tomb standpipe (lab analytical concluded in 2017; field pH and water elevation monitoring to continue)

### **Monitoring Schedule**

For all the monitoring wells listed above, except MW-8-10C and MW-8-12C, quarterly sampling of field parameters, non-metals, and metals are performed. For MW-8-10C and MW-8-12C, these parameters are only required to be sampled annually during the second calendar quarter. All the monitoring parameters are listed on the attached Summary Table of Basin 5 Groundwater Monitoring Results (Attachment 1). For MW-8-8A, MW-8-8B, MW-8-9B, and MW-8-9C, the only metals analyzed are arsenic, lithium, manganese, and molybdenum (all other Basin 5 field parameters and non-metals are also analyzed). Additionally, for quality assurance/quality control (QA/QC), field blanks and duplicates are routinely collected during each sampling event.

## QA/QC Results

For the site-wide monitoring event conducted at Brunner Island SES for the first quarter of 2024, Brunner samplers collected seven field blanks (all groundwater field blanks) and eight duplicate samples. The duplicate samples were collected from eight groundwater wells (including MW-4-2A, MW-4-10, MW-8-3B, MW-6-6, MW-7-5, PZ-7-33, EQ-1, and GC-1N). These field blanks and duplicates were analyzed by the laboratory along with the routinely collected groundwater samples. For the seven field blanks, six water quality parameters were detected above respective limits of quantification (fluoride, iron, lithium, molybdenum, nickel, and nitrate) for a total of eleven analyses. In Brunner's opinion, analysis of the field blanks indicated no significant evidence of sample contamination related to field sampling procedures or sample containers. For the eight duplicates, a total of 450 paired analyses were performed with 17 paired analyses exceeding Brunner's acceptable level of less than 20% relative percent difference (RPD) between duplicates. Based on these QA/QC results, Brunner believes that the laboratory precision is reasonable, and the monitoring results are acceptable for reporting to the PADEP.

## GROUNDWATER MONITORING RESULTS

The groundwater sampling results for this quarter are summarized on Attachment 1, Summary Table of Basin 5 Groundwater Monitoring Results. Upgradient and downgradient wells are indicated in the headings at the top of this table. Any groundwater concentrations that exceeded the listed regulatory standards are indicated in red text color. Groundwater monitoring results are also reported on the 14R forms for each well (Attachment 5).

Below are the findings for each Basin 5 monitoring well:

### Upgradient Monitoring Well (MW-4-7A)

Upgradient monitoring well MW-4-7A is located near the northwest corner of Basin 5 and serves as an upgradient well to the basin. Key results for this quarter and trends for MW-4-7A are as follows:

- pH is consistently near neutral.
- Total dissolved solids concentration of 1,150 mg/L exceeded the Secondary Drinking Water Standard of 500 mg/L, and TDS exhibits a slightly increasing trend.
- Sulfate concentration of 624 mg/L exceeded the Secondary Drinking Water Standard of 250 mg/L, and sulfate exhibits a slightly increasing trend.
- Boron concentrations have been relatively stable since 2012 and are far below the Act 2 residential Statewide Health Standard of 6,000 µg/L, although concentrations at MW-4-7A have fluctuated upward slightly since the fourth quarter of 2018.
- Calcium concentrations historically exhibit a stable long-term trend, but concentrations have exhibited increased variability since the fourth quarter of 2018.
- Lithium (dissolved) concentration of 216 µg/L exceeded the Act 2 residential Statewide Health Standard of 69 µg/L. Lithium concentrations at MW-4-7A have exhibited an

increasing trend since 2011, and now exceed the Act 2 standard (with increased variability since the first quarter of 2020).

- Manganese (dissolved) concentration of 219 µg/L exceeded the Secondary Drinking Water Standard of 50 µg/L but did not exceed the Act 2 residential Statewide Health Standard of 300 µg/L. Manganese concentrations are seasonally variable (within a fairly stable range) at MW-4-7A with peak concentrations typically exceeding the Secondary Drinking Water Standard and occasionally exceeding the Act 2 standard.
- Sodium concentrations demonstrate a gradual long-term increasing trend but appear to be stabilizing at about 60 mg/L. Sodium has also exhibited recent increased variability (similar to boron and calcium). There are no EPA drinking water or PA Act 2 standards for sodium.

### Downgradient Monitoring Wells

1. **MW-4-10** - Monitoring well MW-4-10 is located on the dike between Basin 4 and Basin 5 and would be expected to be more representative of basin pore water than the groundwater surrounding the basin. Relatively significant ash-related impact would be expected and is observed, as compared to monitoring wells which are not bounded by ash on both sides. The general area around MW-4-10 has periodically experienced earth disturbance related to wastewater treatment plant construction. This disturbance has apparently impacted groundwater/pore water quality in MW-4-10. Key results for this quarter and trends for MW-4-10 are as follows:

- Beginning in mid-2018, substantial upward fluctuations (beyond respective historical ranges in many cases) for numerous parameters (including total dissolved solids, sulfate, boron, calcium, specific conductance, and strontium) correlated to increased groundwater elevations. Except for calcium and strontium, these parameters have returned to pre-2018 concentrations.
- Field pH ( 6.33 S.U.) is below the Secondary Drinking Water Standard range of 6.5 to 8.5 S.U. The historical pH range for this well is approximately 4 to 6.5.
- Total dissolved solids concentration of 1,020 mg/L exceeded the Secondary Drinking Water Standard of 500 mg/L. Total dissolved solids exhibit a decreasing trend since 2019. As noted above, following a period of increased concentrations, total dissolved solids have returned to pre-2018 concentrations.
- Sulfate concentration of 1, 502 mg/L exceeded the Secondary Drinking Water Standard of 250 mg/L. Sulfate concentrations exhibit a generally decreasing trend since 2019. However, this quarter, sulfate fluctuated above the recent range of variability.
- Concentrations of aluminum, arsenic, beryllium, cadmium, fluoride, nickel, and zinc have exhibited similar elevated and variable concentration trends for the past few years, with noticeable peaks in 2011, 2014, 2016, and 2018, resulting in some exceedances of respective regulatory standards. Elevated concentrations of these metals are likely related to low pH occurrences when groundwater elevations are high. Since 2022, aluminum concentrations

have been more consistently elevated, fluctuating around the Secondary Drinking Water Standard of 200 µg/L.

- Boron concentrations are elevated and variable (ranging from about 1,500 to 3,500 µg/L) relative to the other Basin 5 wells but meet the Act 2 residential Statewide Health Standard of 6,000 µg/L. Boron exhibits a general decreasing trend since 2012 (except for upward fluctuations from mid-2018 to 2022 as noted above).
  - Iron is present at low concentrations, and typically is below the Secondary Drinking Water Standard. Iron (total) occasionally exceeds the standard.
  - Lithium (dissolved) concentration of 680 µg/L exceeded the Act 2 residential Statewide Health Standard of 69 µg/L. Lithium concentrations at MW-4-10 are the most elevated of all Basin 5 wells but exhibit a slightly decreasing trend since 2012.
  - Manganese (dissolved) concentration of 368 µg/L exceeded the Secondary Drinking Water Standard of 50 µg/L and the Act 2 residential Statewide Health Standard of 300 µg/L. Manganese concentrations are elevated and variable but exhibit a relatively stable long-term trend.
  - Molybdenum (dissolved) concentration of 822 µg/L exceeded the Act 2 residential Statewide Health Standard of 40 µg/L. Molybdenum concentrations at MW-4-10 are the most elevated and variable of the Basin 5 wells, but the long-term trend is decreasing.
  - Potassium and sodium concentrations are elevated relative to the other Basin 5 wells. Potassium demonstrates an increasing trend, while sodium demonstrates a decreasing trend. There are no EPA drinking water or PA Act 2 standards for potassium and sodium.
  - Selenium is variable and demonstrates a long-term increasing trend, similar to the increasing trend at background well MW-19, but more variable since 2014. Concentrations have been below the Act 2 residential Statewide Health Standard of 50 µg/L, except for the fourth quarter of 2018.
2. **MW-8-1N** - MW-8-1 was decommissioned on March 27, 2013, shortly after first quarter 2013 sampling was conducted, to accommodate the footprint of the railroad extension project. MW-8-1 was replaced by MW-8-1N (as installed on September 17, 2013) and quarterly sampling was initiated in the third quarter of 2013. Key results for this quarter and trends for MW-8-1N are as follows:
- pH is near neutral, but slightly acidic, sometimes below the Secondary Drinking Water Standard range of 6.5 to 8.5 S.U.
  - Total dissolved solids concentration of 774 mg/L exceeded the Secondary Drinking Water Standard of 500 mg/L. Total dissolved solids concentrations increased after the well was installed (in 2013) until the second quarter of 2015. Since then, concentrations have generally decreased. Specific conductance exhibits a similar trend. These trends for TDS and specific conductance are likely related to similar trends for calcium, magnesium, sodium, strontium, and sulfate at MW-8-1N.

- Sulfate concentration of 344 mg/L exceeded the Secondary Drinking Water Standard of 250 mg/L. Like total dissolved solids, sulfate concentrations had increased until the second quarter of 2015, but concentrations have since decreased and are now below 400 mg/L.
  - Boron concentrations are well below the Act 2 residential Statewide Health Standard of 6,000 mg/L and are the lowest of all Basin 5 wells.
  - Calcium and magnesium concentrations were elevated (compared to most other Basin 5 wells) from 2015 to 2018, but recent concentrations have decreased similar to the trend for total dissolved solids (discussed above). There are no EPA drinking water or PA Act 2 standards for these parameters.
  - Chloride and sodium concentrations have historically been elevated and variable compared to the other Basin 5 wells, but chloride has always been below the Secondary Drinking Water Standard of 250 mg/L. Since 2014 and 2015 respectively, chloride and sodium concentrations have decreased significantly (with variability) and are now comparable to concentrations at several other Basin 5 wells.
  - Iron concentrations are elevated and variable relative to most Basin 5 wells, typically exceeding the Secondary Drinking Water Standard of 0.3 mg/L.
  - Manganese (dissolved) concentration of 1,420 µg/L exceeded the Secondary Drinking Water Standard of 50 µg/L and the Act 2 residential Statewide Health Standard of 300 µg/L. Manganese concentrations are elevated but exhibit a long-term stable trend with some variability.
  - Strontium is usually the most elevated of all the Basin 5 wells (except for recent upward fluctuations at MW-4-10) and exhibits a relatively stable trend since 2015. Strontium concentrations are below the Act 2 residential Statewide Health Standard of 4,000 µg/L.
3. **MW-8-2** - Key results for this quarter and trends for MW-8-2 are as follows:
- pH is stable and near neutral, but is occasionally below the Secondary Drinking Water range of 6.5 to 8.5 S.U.
  - Sulfate and total dissolved solids had exhibited long-term stable trends below the respective Secondary Drinking Water Standards of 250 mg/L and 500 mg/L. However, concentrations increased during the first quarter of 2023. Since then, total dissolved solids concentrations have been fluctuating around the standard, and sulfate concentrations fluctuate just below the standard.
  - Manganese (dissolved) concentration of 328 µg/L exceeded the Secondary Drinking Water Standard of 50 µg/L and the Act 2 residential Statewide Health Standard of 300 µg/L. Concentrations exhibit a long-term stable trend with some variability.
  - Molybdenum (dissolved) concentration of 268 µg/L exceeded the Act 2 residential Statewide Health Standard of 40 µg/L. However, concentrations exhibit a fairly stable trend.

- Strontium concentrations exhibits a slight long-term increasing trend but are below the Act 2 residential Statewide Health Standard of 4,000 µg/L.

**4. MW-8-3A and MW-8-3B** - Key results for this quarter and trends for MW-8-3A and MW-8-3B are as follows:

- pH is stable and near neutral at both wells, but slightly lower at MW-8-3A. pH at MW-8-3A is sometimes slightly below the Secondary Drinking Water Standard range of 6.5 to 8.5 S.U.
- Total dissolved solids concentrations at both wells exhibit increasing long-term trends with some variability. Concentrations are higher and more variable at MW-8-3A. The total dissolved solids concentration at MW-8-3A typically exceeds the Secondary Drinking Water Standard of 500 mg/L, while concentrations at MW-8-3B typically fluctuate around the standard.
- Sulfate concentrations in both wells exhibit relatively stable long-term trends with some variability. Sulfate concentrations at MW-8-3A typically fluctuate around the Secondary Drinking Water Standard of 250 mg/L, while concentrations at MW-8-3B are typically below the standard.
- Arsenic (dissolved) concentrations at both wells exhibit stable long-term trends with seasonal variability. Peak concentrations exceed the Primary Drinking Water Standard of 10 µg/L (not since 2011 at MW-8-3B). Dissolved arsenic concentrations at MW-8-3A typically range from 3 to 20 µg/L over the past 10 years. Since 2019, total arsenic at MW-8-3A exhibits increased variability. At MW-8-3B, arsenic concentrations exhibit a decreasing trend since approximately 2019. Brunner believes that relatively permeable material is associated with relic stream channels existing beneath Basin 5, potentially accounting for arsenic detections at wells MW-8-3A and MW-8-3B.
- Iron concentrations at MW-8-3A are variable and exceed the Secondary Drinking Water Standard of 0.3 mg/L (possibly due to impacts from historical pyritic material handling). Iron is present in MW-8-3B, but at much lower concentrations than at MW-8-3A, suggesting possibly more impact in the upper part of the water-bearing zone (and/or possibly a higher iron concentration related to the high turbidity within MW-8-3A groundwater). Peak iron concentrations in MW-8-3B exceed the standard.
- Manganese concentrations in both wells exceed the Secondary Drinking Water Standard of 50 µg/L and the Act 2 residential Statewide Health Standard of 300 µg/L but exhibit long-term stable trends with some variability. Since 2019, manganese at MW-8-3A exhibits increased variability.
- Molybdenum concentrations in both wells normally exceed the Act 2 residential Statewide Health Standard of 40 µg/L but exhibit long-term stable/slight decreasing trends.

**5. MW-8-4** - Key results for this quarter and trends for MW-8-4 are as follows:

- Field pH at MW-8-4 is typically below the Secondary Drinking Water Standard range of 6.5 to 8.5 S.U., but exhibits an increasing trend.

- Sulfate and total dissolved solids concentrations are elevated and variable at MW-8-4 and exceed Secondary Drinking Water Standards, but exhibit decreasing long-term trends. As a result of the decreasing long-term trends, sulfate and total dissolved solids concentrations fluctuate around the respective standards.
  - Aluminum concentrations are elevated and variable relative to most other Basin 5 wells, sometimes exceeding the Secondary Drinking Water Standard of 200 µg/L.
  - Beryllium, cadmium, nickel, and zinc concentrations had been variable and elevated relative to other Basin 5 wells. However, since 2012, concentrations have generally decreased and have been less variable. These parameters now meet respective regulatory standards.
  - Chloride concentrations are seasonally variable but remain well below the Secondary Drinking Water Standard of 250 mg/L. Peak chloride concentrations have decreased since 2015.
  - Manganese concentrations remain elevated at 3,360 µg/L compared to the Secondary Drinking Water Standard of 50 µg/L and the Act 2 residential Statewide Health Standard of 300 µg/L. Manganese concentrations at MW-8-4 are the most elevated and variable of all the Basin 5 wells, but concentrations exhibit a long-term downward trend with decreasing variability.
- 6. MW-8-5A and MW-8-5B** - These wells are located at the northwestern corner of Basin 5. Key results for this quarter and trends for MW-8-5A and MW-8-5B are as follows:
- pH is stable and near neutral at both wells.
  - Total dissolved solids concentrations are elevated in excess of the Secondary Drinking Water Standard in both wells, with stable long-term trends (current concentrations of 761 and 665 µg/L for MW-8-5A and MW-8-5B, respectively).
  - Sulfate concentrations demonstrate stable long-term trends in MW-8-5A and MW-8-5B with current concentrations of 266 mg/L and 260 mg/L, respectively, compared to the Secondary Drinking Water Standard of 250 mg/L.
  - Arsenic (dissolved) concentrations in MW-8-5A and MW-8-5B are elevated (current concentrations of 122 µg/L and 239 µg/L, respectively) in excess of the Primary Drinking Water Standard of 10 µg/L. Arsenic concentrations at MW-8-5B exhibit a slight decreasing trend, but concentrations have exhibited increased variability since 2019. Concentrations at MW-8-5A exhibit a stable long-term trend.
- Note: PPL's groundwater consultant, Ish Inc., confirmed that Basin 5 is the source of arsenic identified in MW-8-5A and MW-8-5B. As part of the assessment conducted to investigate the elevated arsenic in MW 8-5 area, Ish Inc. established that arsenic attenuates quickly and is not elevated in the new point of compliance wells MW-8-10A and MW 8-10B.
- Lithium concentrations exceed the Act 2 residential Statewide Health Standard of 69 µg/L but demonstrate fairly stable long-term trends at both wells (current concentrations of 186

µg/L and 151 µg/L for MW-8-5A and MW-8-5B, respectively), but concentrations have exhibited increased variability since the fourth quarter of 2019.

- Manganese concentrations exceed the Secondary Drinking Water Standard of 50 µg/L and the Act 2 residential Statewide Health Standard of 300 µg/L in both wells (current concentrations of 475 and 402 µg/L for MW-8-5A and MW-8-5B respectively). Manganese exhibits a slight increasing trend at MW-8-5A and a slight decreasing trend at MW-8-5B.
- Molybdenum concentrations exceed the Act 2 residential Statewide Health Standard of 40 µg/L in both wells (current concentrations of 378 and 342 µg/L for MW-8-5A and MW-8-5B respectively) but exhibit slightly decreasing long-term concentration trends with increased variability since the third quarter of 2019.
- Strontium concentrations exhibit increasing trends in both wells. Strontium concentrations are below the Act 2 residential Statewide Health Standard of 4,000 µg/L.

**7. MW-8-10A, MW-8-10B, and MW-8-10C** - Monitoring wells MW-8-10A, MW-8-10B, and MW-8-10C were added to the monitoring program as part of Area 8 monitoring system located within Basin 5. These wells also serve as the point of compliance wells, downgradient of MW-8-5A and MW-8-5B. MW-8-10A and MW-8-10B are sampled quarterly while MW-8-10C is sampled annually during the second calendar quarter. Most importantly, arsenic concentrations in MW-8-10A, MW-8-10B, and MW-8-10C continue to meet the Primary Drinking Water Standard of 10 µg/L and exhibit stable/decreasing trends. Other key results and trends for these wells for this quarter are as follows:

- MW-8-10B demonstrates typically slightly alkaline pH and overall better and more stable water quality than MW-8-10A and MW-8-10C. pH at MW-8-10C is also slightly alkaline.
- pH at MW-8-10A is near neutral, but lower than pH at MW-8-10B and MW-8-10C. pH at MW-8-10A is sometimes slightly below the Secondary Drinking Water Standard range of 6.5 to 8.5 S.U.
- Sulfate and total dissolved solids concentrations at MW-8-10A exceed the Secondary Drinking Water Standards, and exhibit an increasing trend since 2021 (after previously fluctuating around the respective standards since 2018). These trends appear to be related to similar trends for calcium, magnesium, specific conductivity, and strontium. At MW-8-10B, total dissolved solids concentrations are fairly stable and fluctuate around the 500 mg/L standard. Sulfate concentrations at MW-8-10B are below the 250 mg/L standard and exhibit a slight decreasing trend.
- Iron concentrations at MW-8-10C are variable and occasionally exceed the Secondary Drinking Water Standard of 0.3 mg/L. During the second quarter of 2023, dissolved iron at MW-8-10C fluctuated upward beyond the historical range of variability, exceeding the Secondary Drinking Water Standard of 0.3 mg/L.
- Manganese concentrations at MW-8-10A are elevated and seasonally variable, exceeding the Secondary Drinking Water Standard of 50 µg/L and historically had exceeded the Act 2 residential Statewide Health Standard of 300 µg/L. However, peak manganese

concentrations at MW-8-10A have decreased significantly since 2018 (below the Act 2 standard). Manganese concentrations at MW-8-10C normally exceed both standards but are less variable than at MW-8-10A.

- Molybdenum concentrations at MW-8-10C exceed the Act 2 residential Statewide Health Standard of 40 µg/L, while concentrations at MW-8-10A and MW-8-10B sometimes exceed the standard. Similar to manganese, peak molybdenum concentrations at MW-8-10A have decreased significantly since 2018 and have not exceeded the standard since the first quarter of 2018.
- Vanadium concentrations at MW-8-10B fluctuate around the limit of quantification, but are well below the Act 2 residential Statewide Health Standard of 170 µg/L, which was increased in 2023.
- During the second quarter of 2023, at MW-8-10C, several dissolved metals fluctuated below the historical range of variability including barium, boron, calcium, iron, magnesium, and strontium; and iron fluctuated above the historical range of variability.

**8. MW-8-12C** - Sampling is required at MW-8-12C annually in the second calendar quarter. Key results and trends for the second quarter of 2023 were as follows:

- Iron (dissolved) concentration of 0.59 mg/L exceeded the Secondary Drinking Water Standard of 0.3 mg/L. Iron concentrations have generally decreased with variability since 2016.
- Manganese (dissolved) concentration of 1,610 µg/L exceeded the Secondary Drinking Water Standard of 50 µg/L and the Act 2 residential Statewide Health Standard of 300 µg/L.
- Molybdenum (dissolved) concentration of 414 µg/L exceeded the Act 2 residential Statewide Health Standard of 40 µg/L. Molybdenum concentrations have fluctuated between approximately 150 and 450 µg/L over the past ten years.
- Several parameters fluctuated downward during the second quarter of 2019 at MW-8-12C including boron, calcium, iron, magnesium, manganese, molybdenum, potassium, specific conductivity, sulfate, total dissolved solids, and total organic carbon. Barium and strontium fluctuated upward. Since the second quarter of 2020, each of these parameters returned to concentrations consistent with respective historical trends.

**9. MW-8-8A, MW-8-8B, MW-8-9B, and MW-8-9C** – These wells were added to the sampling schedule beginning with the third quarter of 2022. For these wells, the only metals analyzed are arsenic, lithium, manganese, and molybdenum (all other Basin 5 field parameters and non-metals are also analyzed). Key results for this quarter are as follows:

- Arsenic (dissolved) concentrations at these wells ranged from 348 to 718 µg/L, exceeding the Primary Drinking Water Standard of 10 µg/L for each of these wells. Generally arsenic concentration decreases with depth at the locations of paired wells; for example, the concentration is lower at MW-8-9C, which has a deeper screened depth, than at MW-8-9B.

- Lithium (dissolved) concentrations at these wells ranged from 128 to 240 µg/L, exceeding the Act 2 residential Statewide Health Standard of 69 µg/L for each of these wells.
- Manganese (dissolved) concentrations at these wells ranged from non-detect to 1,320 µg/L, exceeding the Act 2 residential Statewide Health Standard of 300 µg/L for three of these wells.
- Molybdenum (dissolved) concentrations at these wells ranged from 219 to 336 µg/L, exceeding the Act 2 residential Statewide Health Standard of 40 µg/L for each of these wells.
- Sulfate concentrations at these wells ranged from 146 to 314 mg/L, exceeding the Secondary Water Standard of 250 mg/L for two of these wells.
- Total dissolved solids concentrations at these wells ranged from 497 to 1,000 mg/L, exceeding the Secondary Drinking Water Standard of 500 mg/L for three of these wells.

### Pyrite Tomb Monitoring

- 1. Pyrite Tomb Standpipe** – The pyrite tomb is monitored at least monthly for water depth and field pH, and quarterly reporting (via this quarterly groundwater report) began in the 2nd quarter of 2017. Brunner planned to collect two additional (last) samples from the pyrite tomb standpipe during the 3rd and 4th quarters of 2017 for laboratory analysis (as previously). However, on both quarterly sampling occasions, the standpipe contained too little water to sample (lack of water is a favorable condition). A summary table of the field monitoring results for 2017 thru current is provided in Attachment 2. Trend plots for the field parameters (pH, water depths, water elevations) are provided with the electronic submission of this report.
- 2. MW-PT-1** – Downgradient monitoring well MW-PT-1 was installed in January 2017 to help assess the Pyrite Tomb area. This well is located outside of the Basin 5 berm material in native alluvial sediments. Since monitoring of MW-PT-1 commenced, many parameters have exhibited significant variability. Analytical results for the pyrite tomb monitoring well MW-PT-1 are included on Attachment 1, *Summary Table of Basin 5 Groundwater Monitoring Results*, and trend plots for these parameters (as applicable) are provided with the electronic submission of this report. Key results for this quarter are as follows:
  - pH (5.07 S.U.) was below the Secondary Drinking Water Standard range of 6.5 to 8.5 S.U. Lower pH and alkalinity values at MW-PT-1 appear to correlate with higher groundwater elevations.
  - Total dissolved solids concentration of 539 mg/L exceeded the Secondary Drinking Water Standard of 500 mg/L.
  - Since 2022, nitrate concentrations at MW-PT-1 have been more variable, occasionally exceeding the Primary Drinking Water Standard of 10 mg/L.
  - Sulfate concentration of 332 mg/L exceeded the Secondary Drinking Water Standard of 250 mg/L.

- Aluminum (total) concentration of 982 µg/L exceeded the Secondary Drinking Water Standard of 200 µg/L.
- Manganese (total) concentration of 1,590 µg/L exceeded the Secondary Drinking Water Standard of 50 µg/L and Act 2 residential Statewide Health Standard of 300 µg/L.

# **ATTACHMENTS**

1. Summary Table of Groundwater Monitoring Results
2. Site Plan – Overall map – Brunner Island SES
3. Site Plan – Brunner Island Basin 5
4. Pyrite Tomb Standpipe Monitoring Results
5. PADEP Form 14Rs
6. Statistics Summary
7. Trend Plots


**Brunner Island, LLC**  
Basin No. 5 Groundwater Monitoring Results


PARAMETER	UNITS	REGULATORY CRITERIA LIMIT	GROUNDWATER MONITORING WELLS																		
			Downgradient															Pyrite Tomb Monitoring	Upgradient		
			MW-4-10	MW-9-1N	MW-8-2	MW-8-3A	MW-8-3B	MW-8-4	MW-9-5A	MW-8-5B	MW-8-10A	MW-9-10B	MW-8-10C	MW-9-12C	MW-8-8A	MW-8-8B	MW-8-9B		MW-8-9C	MW-PT-1	MW-4-7A
Sampling Date	1/29/2024	1/19/2024	1/19/2024	1/20/2024	1/20/2024	1/20/2024	1/20/2024	1/20/2024	1/22/2024	1/22/2024			1/22/2024	1/22/2024	1/22/2024	1/22/2024	1/23/2024	1/23/2024	1/24/2024		
<b>Field Parameters (monitored quarterly)</b>																					
Well Depth	FT		38.60	26.30	22.30	26.60	46.80	21.80	39.10	59.10	37.30	57.00			52.22	60.52	69.65	90.10	21.25	39.85	45.40
Sampling Depth	FT		34.00	23.00	15.00	20.00	40.00	18.00	33.00	52.00	32.00	52.00			46.00	54.00	64.00	85.00	19.00	35.00	33.00
Well Purge Volume	L		3.45	3.00	7.70	3.30	3.00	3.30	4.25	3.50	3.05	3.30			3.20	3.30	3.50	3.15	3.00	3.00	2.00
Depth to Water	FT		25.45	12.16	6.65	9.77	11.32	12.06	23.18	18.24	16.73	16.79			24.55	23.99	23.36	22.80	12.72	26.33	18.13
Water Surface Elevation	FT		267.26	268.48	264.85	257.61	256.39	258.13	261.86	266.64	259.74	259.48			259.65	259.65	260.98	261.88	259.05	261.68	287.67
Temperature, field	°C		11.41	8.63	10.61	8.68	10.20	9.87	10.81	10.75	11.01	12.28			10.26	10.84	7.76	10.60	12.24	12.53	10.70
pH, field	S.U.	6.5 - 8.5 S	6.33	7.51	6.96	6.71	7.23	5.36	7.38	7.28	6.80	7.72			7.15	7.49	6.81	7.22	5.07	6.94	7.17
pH, lab	S.U.	6.5 - 8.5 S	6.26	6.96	6.99	6.84	7.31	6.22	7.37	7.45	6.91	7.69			7.44	7.68	7.40	7.42	5.20	7.17	7.00
Specific Conductance, field	umhos/cm		1,412.00	1,174.00	752.00	1,272.00	883.00	600.00	1,125.00	1,001.00	1,095.00	911.00			1,662.00	1,433.00	1,501.00	784.00	768.00	1,496.00	213.00
Specific Conductance, lab	umhos/cm		1,440.00	1,150.00	757.00	1,280.00	883.00	591.00	1,110.00	985.00	1,100.00	899.00			1,620.00	1,390.00	1,480.00	803.00	766.00	1,530.00	221.00
Turbidity, field	NTU		1.37	0.72	1.04	32.30	2.19	0.73	0.36	0.83	1.08	0.95			0.84	0.35	0.29	1.07	0.96	0.40	0.67
Dissolved Oxygen, field	mg/L		2.49	0.12	0.39	2.60	0.37	2.60	0.85	0.44	0.67	0.49			0.29	1.50	0.78	1.34	3.19	1.01	5.61
Redox, field	mV		299.20	65.50	196.30	112.20	29.90	222.90	111.90	116.40	348.40	87.90			74.40	105.60	-26.40	-62.30	350.00	249.00	237.00
<b>Non-Metals (monitored quarterly)</b>																					
Alkalinity, total as CaCO3	mg/L		78.80	196.00	149.00	215.00	253.00	64.20	257.00	239.00	148.00	107.00			233.00	217.00	295.00	242.00	21.20	233.00	< 20
Total Organic Carbon	mg/L		< 0.5	0.66	0.87	0.67	< 0.5	< 0.5	< 0.5	< 0.5	< 0.5	0.192 ND			< 0.5	< 0.5	< 0.5	< 0.5	1.87	1.00	0.192 ND
Total Dissolved Solids	mg/L	500 S	1,020.00	774.00	475.00	832.00	542.00	397.00	761.00	665.00	797.00	663.00			1,000.00	950.00	951.00	497.00	539.00	1,150.00	136.00
Chemical Oxygen Demand	mg/L		5.3 ND	5.3 ND	5.3 ND	5.3 ND	5.3 ND	5.3 ND	5.3 ND	5.3 ND	5.3 ND	< 20			< 20	< 20	< 20	5.3 ND	< 20	5.3 ND	5.3 ND
Bicarbonate	mg/L		78.80	196.00	149.00	215.00	253.00	64.20	257.00	239.00	148.00	107.00			233.00	217.00	295.00	242.00	21.20	233.00	< 20
Chloride, total as Cl	mg/L	250 S	19.10	47.00	28.40	133.00	62.70	10.30	25.50	20.70	58.70	110.00			242.00	138.00	110.00	17.50	3.70	11.60	8.48
Fluoride, total as F	mg/L	2 S, 4 M	< 0.2	0.23	0.80	0.38	0.42	0.26	0.82	0.72	< 0.2	< 0.2			0.62	0.72	0.35	1.39	0.27	0.23	< 0.2
Ammonia, as N	mg/L		0.066 ND	< 0.2	< 0.2	< 0.2	0.066 ND	0.066 ND	0.46	0.32	0.066 ND	0.066 ND			0.49	0.066 ND	0.34	0.37	0.066 ND	0.24	0.066 ND
Nitrate, as N	mg/L	10 M	1.15	0.0218 ND	< 0.5	< 0.5	0.0218 ND	< 0.5	0.0218 ND	0.0218 ND	< 0.5	0.0218 ND			0.0218 ND	0.80	0.0218 ND	0.0218 ND	9.57	0.0218 ND	3.75
Sulfate, as SO4	mg/L	250 S	1,502.00	344.00	190.00	267.00	124.00	212.00	266.00	260.00	345.00	171.00			204.00	299.00	314.00	146.00	332.00	624.00	19.20
<b>Metals (monitored quarterly)</b>																					
Aluminum, total	ug/L	200 S	101.00	< 100	< 100	< 100	< 100	257.00	< 100	< 100	< 100	< 100							982.00	< 100	< 100
Aluminum, dissolved	ug/L	200 S	< 100	< 100	< 100	< 100	< 100	< 100	< 100	< 100	< 100	< 100								< 100	< 100
Antimony, total	ug/L	6 M	< 1	0.3 ND	< 1	0.3 ND	0.3 ND	0.3 ND	0.3 ND	0.3 ND	0.3 ND	0.3 ND							0.3 ND	0.3 ND	0.3 ND
Antimony, dissolved	ug/L	6 M	0.3 ND	0.3 ND	< 1	0.3 ND	0.3 ND	0.3 ND	0.3 ND	0.3 ND	< 1	0.3 ND								0.3 ND	0.3 ND
Arsenic, total	ug/L	10 M	0.55 ND	0.55 ND	0.55 ND	7.20	8.69	0.55 ND	119.00	214.00	0.55 ND	1.70			593.00	380.00	776.00	355.00	< 1	< 1	0.55 ND
Arsenic, dissolved	ug/L	10 M	1.15	0.55 ND	0.55 ND	3.91	6.99	0.55 ND	122.00	239.00	0.55 ND	1.54			615.00	420.00	718.00	348.00		0.55 ND	0.55 ND
Barium, total	ug/L	2,000 M	11.90	18.60	28.40	27.10	66.10	16.40	40.10	58.00	19.40	44.50							20.00	16.80	266.00
Barium, dissolved	ug/L	2,000 M	10.70	19.00	30.50	25.60	59.80	16.80	41.60	59.90	18.30	42.00								16.40	253.00
Beryllium, total	ug/L	4 M	0.19 ND	0.19 ND	0.19 ND	0.19 ND	0.19 ND	0.19 ND	0.19 ND	0.19 ND	0.19 ND	0.19 ND							1.46	0.19 ND	0.19 ND
Beryllium, dissolved	ug/L	4 M	0.19 ND	0.19 ND	0.19 ND	0.19 ND	0.19 ND	0.19 ND	0.19 ND	0.19 ND	0.19 ND	0.19 ND								0.19 ND	0.19 ND
Boron, total	ug/L	6,000 A	1,880.00	< 100	454.00	463.00	362.00	213.00	925.00	860.00	472.00	262.00							< 100	1,650.00	< 100
Boron, dissolved	ug/L	6,000 A	1,950.00	< 100	448.00	454.00	351.00	217.00	972.00	904.00	452.00	256.00								1,710.00	< 100
Cadmium, total	ug/L	5 M	< 1	0.15 ND	1.07	0.15 ND	0.15 ND	< 1	< 1	< 1	0.15 ND	0.15 ND							< 1	0.15 ND	0.15 ND
Cadmium, dissolved	ug/L	5 M	< 1	0.15 ND	1.13	0.15 ND	0.15 ND	< 1	0.15 ND	< 1	0.15 ND	0.15 ND								0.15 ND	0.15 ND
Calcium, total	mg/L		156.00	167.00	110.00	181.00	140.00	66.80	175.00	159.00	157.00	130.00							101.00	227.00	24.50
Calcium, dissolved	mg/L		162.00	168.00	109.00	180.00	136.00	65.40	182.00	162.00	151.00	128.00								243.00	25.30
Chromium, total	ug/L	100 M	0.41 ND	0.41 ND	0.41 ND	< 1	0.41 ND	1.16	0.41 ND	0.41 ND	0.41 ND	0.41 ND							1.18	0.41 ND	0.41 ND
Chromium, dissolved	ug/L	100 M	0.41 ND	0.41 ND	0.41 ND	0.41 ND	0.41 ND	0.41 ND	0.41 ND	0.41 ND	0.41 ND	0.41 ND								0.41 ND	0.41 ND
Copper, total	ug/L	1,000 S, 1,300 M	1.87	1.57	1.89	1.32	1.50	1.74	3.50	2.53	0.39 ND	0.39 ND							2.42	0.39 ND	0.39 ND
Copper, dissolved	ug/L	1,000 S, 1,300 M	1.80	1.62	1.96	1.41	1.46	2.05	1.87	2.47	0.39 ND	0.39 ND								0.39 ND	0.39 ND
Iron, total	mg/L	0.3 S	0.03	0.60	0.02	3.18	0.40	0.02	< 0.02	0.03	0.0122 ND	0.04							0.06	0.0122 ND	0.0122 ND
Iron, dissolved	mg/L	0.3 S	< 0.02	0.34	< 0.02	1.37	0.25	< 0.02	0.03	< 0.02	< 0.02	< 0.02								< 0.02	< 0.02
Lead, total	ug/L	5 A, 15 M	0.08 ND	0.08 ND	< 1	0.08 ND	0.08 ND	< 1	< 1	< 1	0.08 ND	0.08 ND							< 1	0.08 ND	0.08 ND
Lead, dissolved	ug/L	5 A, 15 M	0.08 ND	0.08 ND	0.08 ND	0.08 ND	0.08 ND	< 1	< 1	< 1	0.08 ND	0.08 ND								0.08 ND	0.08 ND
Lithium, total	ug/L	69 A	664.00	< 1	17.10	19.70	25.20	10.00	179.00	143.00	14.80	10.70			223.00	240.00	198.00	130.00	19.70	226.00	2.95
Lithium, dissolved	ug/L	69 A	680.00	< 1	17.70	19.60	26.30	10.80	186.00	151.00	14.50	10.50			226.00	240.00	177.00	128.00		216.00	3.85
Magnesium, total	mg/L		13.60	30.20	20.10	36.50	27.40	25.20	38.10	31.60	40.60	25.50							26.60	39.10	4.11
Magnesium, dissolved	mg/L		13.90	30.70	19.70	35.90	26.10	24.60	39.50	32.50	38.90	25.30								41.20	4.12
Manganese, total	ug/L	50 S, 300 A	338.00	1,370.00	368.00	2,590.00	1,160.00	3,370.00	416												

**Brunner Island, LLC**  
Basin No. 5 Groundwater Monitoring Results

PARAMETER	UNITS	REGULATORY CRITERIA LIMIT	GROUNDWATER MONITORING WELLS																		
			Downgradient															Pyrite Tomb Monitoring	Upgradient		
			MW-4-10	MW-9-1N	MW-8-2	MW-8-3A	MW-8-3B	MW-8-4	MW-8-5A	MW-8-5B	MW-8-10A	MW-8-10B	MW-8-10C	MW-8-12C	MW-8-8A	MW-8-8B	MW-8-9B		MW-8-9C	MW-PT-1	MW-4-7A
1/29/2024	1/19/2024	1/19/2024	1/20/2024	1/20/2024	1/20/2024	1/20/2024	1/20/2024	1/22/2024	1/22/2024									1/23/2024	1/23/2024	1/24/2024	
Location ID																					
Sampling Date																					
Molybdenum, total	µg/L	40 A	777.00	1.60	255.00	32.20	149.00	7.22	359.00	313.00	34.50	29.60			332.00	307.00	232.00	293.00	12.30	29.70	1.98
Molybdenum, dissolved	µg/L	40 A	822.00	0.78 ND	268.00	32.00	146.00	9.28	378.00	342.00	32.60	28.40			336.00	306.00	219.00	275.00		28.10	1.78
Nickel, total	ug/L	100 A	9.63	< 1	1.44	1.24	< 1	27.40	< 1	< 1	1.07	0.28 ND							50.10	< 1	0.28 ND
Nickel, dissolved	ug/L	100 A	13.70	< 1	1.47	< 1	< 1	27.90	< 1	< 1	1.06	0.28 ND								< 1	0.28 ND
Potassium, total	mg/L		109.00	8.77	6.30	3.52	1.73	1.29	4.50	4.35	2.76	2.37							3.24	3.98	< 1
Potassium, dissolved	mg/L		116.00	8.84	6.05	3.55	1.66	1.21	4.68	4.41	2.68	2.31								4.02	< 1
Selenium, total	µg/L	50 M	16.40	0.63 ND	0.63 ND	0.63 ND	0.63 ND	0.63 ND	0.63 ND	0.63 ND	0.63 ND	0.63 ND							0.63 ND	0.63 ND	16.80
Selenium, dissolved	µg/L	50 M	19.30	0.63 ND	0.63 ND	0.63 ND	0.63 ND	0.63 ND	0.63 ND	0.63 ND	0.63 ND	0.63 ND								0.63 ND	17.30
Silver, total	µg/L	100 A	0.13 ND	0.13 ND	0.13 ND	0.13 ND	0.13 ND	0.13 ND	0.13 ND	0.13 ND	0.13 ND	0.13 ND							0.13 ND	0.13 ND	0.13 ND
Silver, dissolved	µg/L	100 A	0.13 ND	0.13 ND	0.13 ND	0.13 ND	0.13 ND	0.13 ND	0.13 ND	0.13 ND	0.13 ND	0.13 ND								< 5	0.13 ND
Sodium, total	mg/L		61.20	28.30	16.80	38.00	7.77	11.30	12.50	11.10	21.90	7.98							10.60	57.60	8.16
Sodium, dissolved	mg/L		64.20	27.80	16.50	40.90	7.91	10.70	13.80	11.00	21.00	7.67								59.10	8.40
Strontium, total	µg/L	4,000 A	1,500.00	1,250.00	660.00	1,010.00	397.00	211.00	797.00	880.00	342.00	250.00							376.00	350.00	49.00
Strontium, dissolved	µg/L	4,000 A	1,540.00	1,280.00	647.00	1,020.00	383.00	191.00	831.00	873.00	334.00	242.00								378.00	50.00
Titanium, total	µg/L		0.7 ND	0.7 ND	0.7 ND	0.7 ND	0.7 ND	0.7 ND	0.7 ND	0.7 ND	0.7 ND	0.7 ND							0.7 ND	0.7 ND	0.7 ND
Titanium, dissolved	µg/L		0.7 ND	0.7 ND	0.7 ND	0.7 ND	0.7 ND	0.7 ND	0.7 ND	0.7 ND	0.7 ND	0.7 ND								< 5	0.7 ND
Vanadium, total	µg/L	170 A	0.53 ND	0.53 ND	< 5	0.53 ND	< 5	0.53 ND	< 5	< 5	0.53 ND	< 5							0.53 ND	< 5	0.53 ND
Vanadium, dissolved	µg/L	170 A	0.53 ND	0.53 ND	< 5	0.53 ND	0.53 ND	0.53 ND	< 5	< 5	0.53 ND	< 5								< 5	0.53 ND
Zinc, total	µg/L	2,000 A, 5,000 S	8.85	44.10	43.70	40.70	43.00	71.10	51.90	43.40	< 5	1.12 ND							85.00	1.12 ND	1.12 ND
Zinc, dissolved	µg/L	2,000 A, 5,000 S	9.03	45.70	47.40	44.40	45.40	71.90	51.90	43.70	< 5	1.12 ND								< 5	1.12 ND

- Notes:**
- Regulatory qualifier codes: M = EPA Primary Drinking Water MCL/TT, S = EPA Secondary Drinking Water MCL, and A = Pennsylvania Act 2 residential Statewide Health Standard for used aquifers.
  - MW-19 was sampled for additional parameters (Ga, Ge, Rb, Y) pursuant to Basin No. 7 sampling requirements.
  - MW-4-7A, MW-4-10, and MW-19 are additionally sampled for organic parameters during the second and third calendar quarters pursuant to Basin No. 4 South sampling requirements.
  - MW-8-10C and MW-8-12C are sampled annually during the second calendar quarter.

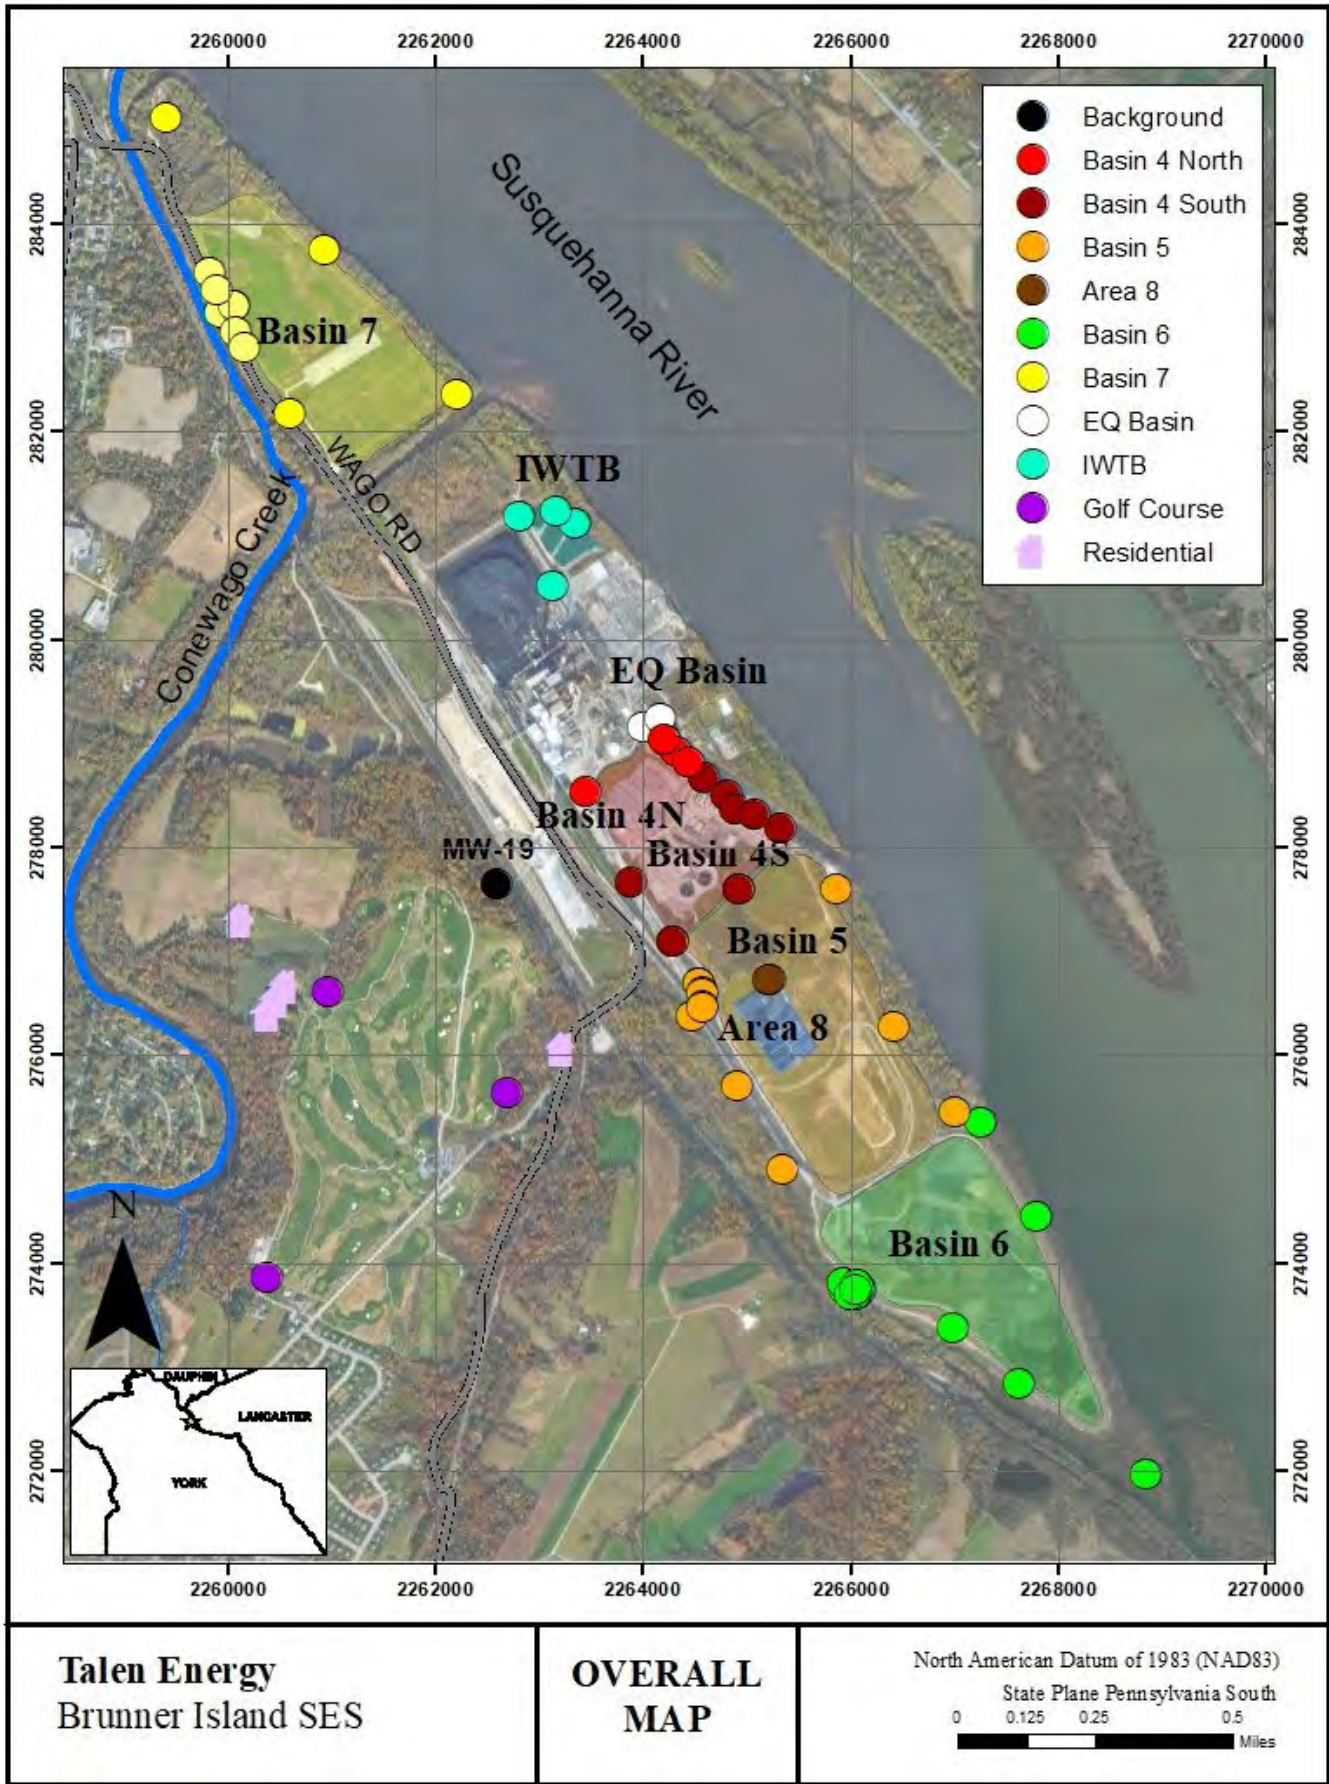

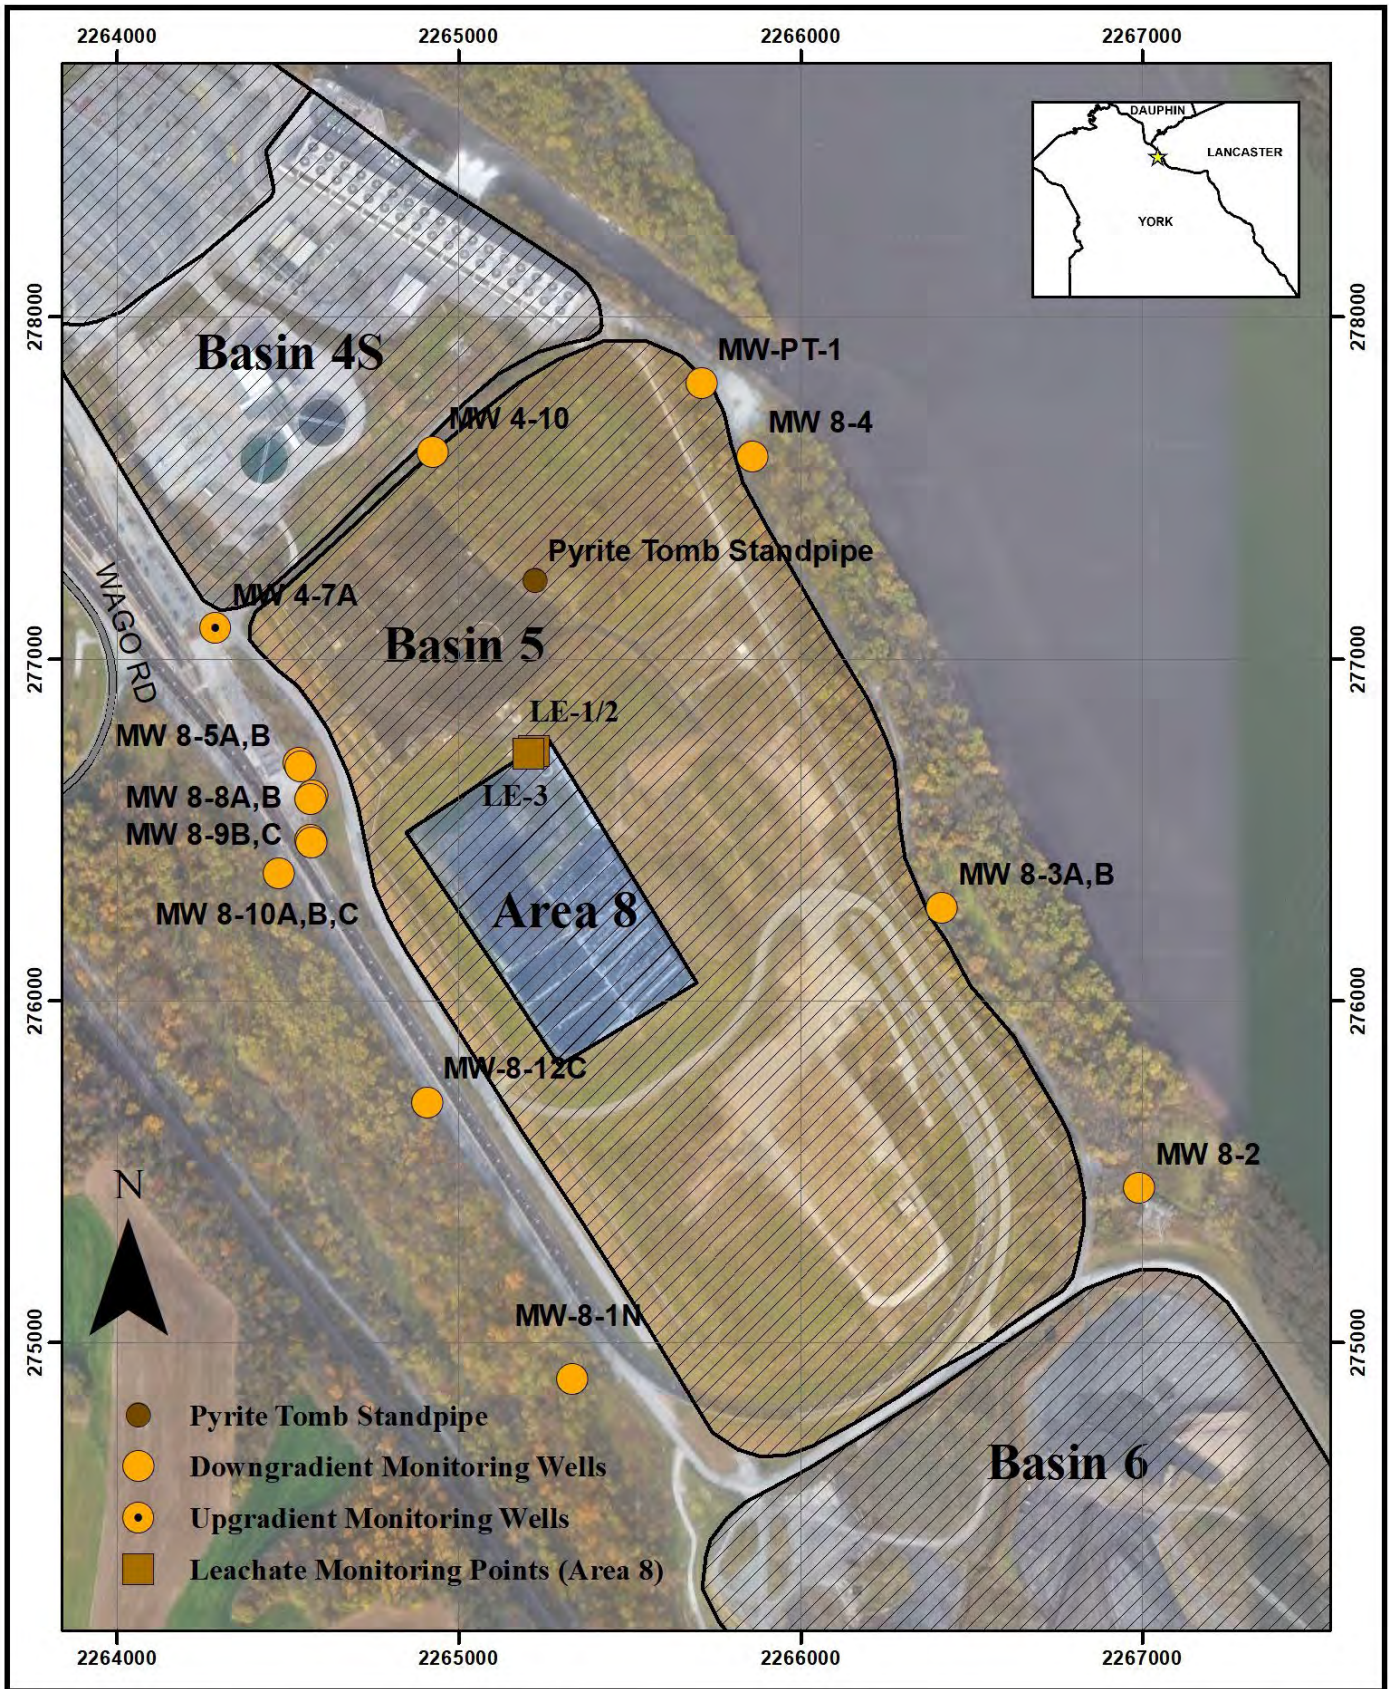

**Talen Energy**  
 Brunner Island SES  
 Basin No. 5

**SITE  
 MAP**

North American Datum of 1983 (NAD83)  
 State Plane Pennsylvania South  
 0 250 500 1,000  
 Feet

## Pyrite Tomb Standpipe Monitoring Results

Date	Pyrite Tomb Standpipe			Comments
	Water Depth (ft)	Water Surface Elevation (ft)	pH (S.U.)	
1/3/2017	25.85	269.60	7.61	
1/12/2017	26.00	269.45	7.54	
1/18/2017	29.03	266.42	8.88	Standpipe cleanout 1/17/2017
1/25/2017	28.79	266.66	7.84	Sampled the tomb (with bailer)
1/31/2017	28.79	266.66	8.25	
2/7/2017	28.78	266.67	7.97	
2/13/2017	28.85	266.60	7.41	
3/6/2017	28.70	266.75	7.11	
4/4/2017	28.62	266.83	7.49	
4/15/2017	28.57	266.88	7.11	
4/20/2017	30.71	264.74	7.70	
5/9/2017	29.08	266.37	7.77	
6/22/2017	27.72	267.73	7.43	Purged 24.5 gal.
6/23/2017	30.92	264.53	7.97	Sampled the tomb after recharging (17.5 hours)
8/3/2017	28.41	267.04	7.53	
9/1/2017	28.18	267.27	7.15	
9/21/2017	30.80	264.65	N/A	Sample attempted, but not enough water in standpipe.
9/28/2017	30.70	264.75	N/A	Sample attempted again, but not enough water in standpipe.
10/2/2017	30.65	264.80	7.18	
12/5/2017	30.21	265.24	7.48	
12/14/2017	N/A	N/A	N/A	Sample attempted again, but not enough water in standpipe.
<i>Lab analytical attempts discontinued in 2018; Attempts to purge water continuing quarterly.</i>				
1/25/2018	N/A	N/A	N/A	Water elevation not high enough to record depth to water.
2/19/2018	30.57	264.88	6.94	
3/4/2018	30.33	265.12	6.48	Purged 5.25 Liters
4/12/2018	31.20	264.25	7.24	
5/14/2018	31.16	264.29	6.96	Purged 1.7 liters. Wouldn't purge further.
5/29/2018	31.24	264.21	N/A	Not enough water in tomb to get a pH reading
6/7/2018	31.32	264.13	N/A	Not enough water in tomb to get a pH reading
7/7/2018	29.40	266.05	7.38	
8/2/2018	28.64	266.81	7.42	
8/13/2018	27.93	267.52	N/A	
9/13/2018	23.56	271.89	7.76	Pumped tomb down to 31.43'. Purged 35.25 L.
10/5/2018	22.22	273.23	7.69	
11/5/2018	22.15	273.30	8.2	Purged 52.5 L.
12/10/2018	19.55	275.90	7.95	
1/10/19	19.75	275.70	7.62	

## Pyrite Tomb Standpipe Monitoring Results

Date	Pyrite Tomb Standpipe			Comments
	Water Depth (ft)	Water Surface Elevation (ft)	pH (S.U.)	
2/22/19	19.22	276.23	7.46	Purged 20 L. Water level was not dropping.
3/13/19	18.80	276.65	7.43	
4/2/2019	18.18	277.27	7.4	
5/16/2019	18.20	277.25	8.22	
6/18/2019	18.55	276.90	7.28	Purged 45 L. Water level was not dropping.
7/23/2019	18.58	276.87	7.35	
8/13/2019	19.00	276.45	7.39	Water level did not drop after 7 hours of pumping. Purged 91 L.
9/5/2019	19.71	275.74	7.24	
10/1/2019	20.32	275.13	7.43	
11/19/2019	21.14	274.31	7.88	Purged 42.5 L. Temp = 13.45°C, SpC = 2465 µmhos/cm, Redox = -85.5 mV, DO = 2.01 mg/L, Turb = 1.00 NTU.
12/19/2019	21.65	273.80	7.39	
1/16/2020	21.47	273.98	7.42	
2/24/2020	21.11	274.34	7.66	Purged 53.5 L. Water level did not drop during purge.
3/11/2020	21.21	274.24	7.07	
4/1/2020	21.37	274.08	6.85	
5/28/2020	21.20	274.25	6.88	Purged 24 L.
6/1/2020	21.38	274.07	7.45	
7/17/2020	22.05	273.40	7.17	
8/20/2020	22.66	272.79	7.12	
9/30/2020	23.44	272.01	6.92	Purged 36 L on 10/6/2020. Did not drop.
10/13/2020	23.63	271.82	7.18	
11/5/2020	24.06	271.39	7.05	Purged 24 L. Temp = 14.7°C, Recharge rate = 0.00165 L/min
12/22/2020	24.67	270.78	7.23	
1/12/2021	24.67	270.78	7.22	Temp = 13.1°C
2/25/2021	24.82	270.63	7.42	Temp = 12.8°C
3/10/2021	24.75	270.70	7.11	Temp = 13.9°C
4/30/2021	23.90	271.55	7.31	Purged 27 L. Temp = 14.1°C
5/4/2021	23.88	271.57	7.22	
6/10/2021	24.16	271.29	7.54	Temp = 15.0°C
7/28/2021	25.53	269.92	7.06	Purged 20 L. Temp = 15.0°C
8/16/2021	24.63	270.82	7.32	Temp = 15.5°C
9/22/2021	24.48	270.97	7.02	
10/23/2021	23.75	271.10	6.82	Purged 84 L
11/30/2021	23.86	271.59	7.28	Temp = 11.6°C
12/1/2021	23.80	271.65	7.31	
1/29/2022	24.52	270.93	7.62	Purged 66 L
2/2/2022	24.54	270.91	7.62	Temp = 12.6°C

## Pyrite Tomb Standpipe Monitoring Results

Date	Pyrite Tomb Standpipe			Comments
	Water Depth (ft)	Water Surface Elevation (ft)	pH (S.U.)	
3/23/2022	24.71	270.74	6.97	Temp = 12.5°C
4/25/2022	24.65	270.80	7.29	Purged 30 L. Temp = 13.7°C
5/12/2022	24.73	290.72	7.09	
6/18/2022	23.96	271.49	7.08	Temp = 14.5°C
7/27/2022	24.35	271.10	6.87	Purged 40 L. Temp = 16.1°C
8/3/2022	24.60	270.85	6.58	
9/29/2022	24.90	270.55	6.30	
10/24/2022	25.10	270.35	6.96	Purged 104 L
11/28/2022	25.70	269.75	7.82	
12/21/2022	25.74	269.71	7.19	
1/28/2023	25.80	269.65	7.42	Purged 57 L
2/1/2023	26.05	269.40	7.96	
3/29/2023	25.85	269.60	7.07	
4/26/2023	25.83	269.62	7.55	Purged 12.6 L
5/11/2023	26.00	269.45	7.70	
6/20/2023	25.84	269.61	7.68	
7/29/2023	24.88	270.57	7.34	Purged 18 L. Temp = 16.6°C
8/26/2023	25.97	269.48	7.39	Temp = 14.8°C
9/14/2023	25.98	269.47	7.42	
10/21/2023	26.05	269.40	7.47	Purged 64 L. Temp = 12.8°C
11/7/2023	26.33	269.12	7.64	Temp = 14.2°C
12/4/23	26.40	269.05	7.53	Temp = 13.4°C
1/30/24	26.45	269.00	7.49	Purged 57 L
2/7/24	27.45	268.00	9.17	Temp = 13.9°C
2/14/24	27.23	268.22	8.64	Temp = 13.7°C
2/23/24	27.03	268.42	8.87	Temp = 13.5°C



Date Prepared/Revised 03/05/2024
DEP USE ONLY
Date Received

**FORM 14R**  
**RESIDUAL WASTE LANDFILLS**  
**AND DISPOSAL IMPOUNDMENTS**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**

This form must be fully and accurately completed. All required information must be typed or legibly printed in the spaces provided. If additional space is necessary, identify each attached sheet as Form 14R, reference the item number and identify the date prepared. The "date prepared/revised" on any attached sheets needs to match the "date prepared/revised" on this page.

General References: Section 288.254, 289.264

**SECTION A. SITE IDENTIFIER**

Applicant/permittee: Brunner Island, LLC - Basin No. 5

Site Name: Basin No. 5

Facility ID (as issued by DEP): 301337

**SECTION B. FACILITY INFORMATION**

Monitoring wells must be designed and constructed in accordance with Department standards. **INDICATE THE LATITUDE AND LONGITUDE TO THE NEAREST ONE TENTH OF A SECOND (DD° MM' SS.S")**.

Monitoring Point Number: MW-19

Well  Spring  Stream  Other

Upgradient/Upstream  Downgradient/Downstream

Location: County York

Municipality: East Manchester Township

Sampling Point: Latitude: 40° 5' 26.55"

Longitude: 76° 41' 55.87"

Depth to Water Level: 18.13 ft.

Measured from:  Land Surface  TOC

Casing Stick Up: 1.60 ft.

Elevation of Water Level: 287.67 ft./MSL

Sampling Depth: 33.00 ft.

Volume of Water Column: \_\_\_\_\_ gal.

Total Well Depth: 45.40 ft.

Sampling Method:  Pumped  Bailed  Grab

Well Purged:  Yes  No

Well Volumes Purged: 2 L

Sample Field Filtered (must be 0.45 micron)?  Yes  No

Spring Flow Rate: \_\_\_\_\_ GPM

Sample Date (mm/dd/yy): 01/24/2024

Sample Collection Time: 9:43AM

Sample Collector's Name: NL

Sample Collector's Affiliation: Talen Generation, LLC

Laboratory(ies) Performing Analysis: Hawk Mtn Labs, Inc.

Were any holding times exceeded?  Yes  No. If yes, please explain in comments field.

Lab Certification Number(s): 40-417

Lab Sample Number(s): 240101643-001

Final Lab Analysis Completion Date: 02/16/2024

Name/Affiliation of Person who Filled out Form Martin Mengel / Talen Energy Supply, LLC

Comments: \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

I.D. No.	301309
Monitoring Point No.	MW-19
Sample Date	01/24/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**  
**ANALYTES**

**1-Q. Inorganics (Enter all data in mg/l except as noted)**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Ammonia, as N (mg/l)	0.066 ND	SM 4500-NH3 F
Bicarbonate (mg/l)	20 <	SM 2320
Calcium, total (mg/l)	24.5	EPA 200.7
Calcium, dissolved (mg/l)	25.3	EPA 200.7
Chemical Oxygen Demand (mg/l)	5.3 ND	SM 5220 D
Chloride, total as Cl (mg/l)	8.48	EPA 300.0
Fluoride, total as F (mg/l)	0.2 <	EPA 300.0
Iron, total (µg/l)	12.2 ND	EPA 200.7
Iron, dissolved (µg/l)	20 <	EPA 200.7
Magnesium, total (mg/l)	4.11	EPA 200.7
Magnesium, dissolved (mg/l)	4.12	EPA 200.7
Manganese, total (µg/l)	5.31 ND	EPA 200.7
Manganese, dissolved (µg/l)	5.31 ND	EPA 200.7
Nitrate, as N (mg/l)	3.75	EPA 300.0
pH, field (su)	7.17	SM 4500-H+B
pH, lab (su)	7 H	SM 4500-H+B
Potassium, total (mg/l)	1 <	EPA 200.7
Potassium, dissolved (mg/l)	1 <	EPA 200.7
Sodium, total (mg/l)	8.16	EPA 200.7
Sodium, dissolved (mg/l)	8.4	EPA 200.7
Specific Conductance, field (umhos/cm)	213	EPA 120.1, FIELD
Specific Conductance, lab (umhos/cm)	221	SM 2510 B
Sulfate, as SO4 (mg/l)	19.2	EPA 300.0
Alkalinity, total as CaCO3 (mg/l)	20 <	SM 2320 B
Total Dissolved Solids (mg/l)	136	SM 2540 C
Total Organic Carbon (mg/l)	0.192 ND	SM 5310 C
Turbidity, field (n.t.u.)	0.67	Field Meter
Dissolved O2, field (mg/l)	5.61	Field Meter
Redox, field (mv)	237	Field Meter
Temperature, field (°c)	10.7	Field Meter
Acidity, total as CaCO3 (mg/l)	-6.15	SM 2310 B

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-19
Sample Date	01/24/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**

**1-A. Organics (Enter all data in ug/l)**

<b>ANALYTE</b>	<b>VALUE (T)</b>	<b>ANALYSIS METHOD NUMBER</b>
Benzene (µg/l)		
1,2-Dibromoethane (µg/l)		
1,1-Dichloroethane (µg/l)		
1,1-Dichloroethene (µg/l)		
1,2-Dichloroethane (µg/l)		
cis-1,2-Dichloroethene (µg/l)		
trans-1,2-Dichloroethene (µg/l)		
Ethylbenzene (µg/l)		
Methylene Chloride (µg/l)		
Tetrachloroethene (µg/l)		
Toluene (µg/l)		
1,1,1-Trichloroethane (µg/l)		
Trichloroethene (µg/l)		
Vinyl chloride (µg/l)		
Xylenes (µg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-19
Sample Date	01/24/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Arsenic, total (µg/l)	0.55 ND	EPA 200.8
Arsenic, dissolved (µg/l)	0.55 ND	EPA 200.8
Barium, total (µg/l)	266	EPA 200.8
Barium, dissolved (µg/l)	253	EPA 200.8
Cadmium, total (µg/l)	0.15 ND	EPA 200.8
Cadmium, dissolved (µg/l)	0.15 ND	EPA 200.8
Chromium, total (µg/l)	0.41 ND	EPA 200.8
Chromium, dissolved (µg/l)	0.41 ND	EPA 200.8
Copper, total (µg/l)	0.39 ND	EPA 200.8
Copper, dissolved (µg/l)	0.39 ND	EPA 200.8
Lead, total (µg/l)	0.08 ND	EPA 200.8
Lead, dissolved (µg/l)	0.08 ND	EPA 200.8
Mercury, total (µg/l)	0.72 ND	EPA 200.8
Mercury, dissolved (µg/l)	0.72 ND	EPA 200.8
Selenium, total (µg/l)	16.8	EPA 200.8
Selenium, dissolved (µg/l)	17.3	EPA 200.8
Silver, total (µg/l)	0.13 ND	EPA 200.8
Silver, dissolved (µg/l)	0.13 ND	EPA 200.8
Zinc, total (µg/l)	1.12 ND	EPA 200.8
Zinc, dissolved (µg/l)	1.12 ND	EPA 200.8
Boron, total (µg/l)	100 <	EPA 200.7
Boron, dissolved (µg/l)	100 <	EPA 200.7
Lithium, total (µg/l)	2.95	EPA 200.8
Lithium, dissolved (µg/l)	3.85	EPA 200.8
Molybdenum, total (µg/l)	1.98	EPA 200.8
Molybdenum, dissolved (µg/l)	1.78	EPA 200.8
Strontium, total (µg/l)	49	EPA 200.7
Strontium, dissolved (µg/l)	50	EPA 200.7

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-19
Sample Date	01/24/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Aluminum, total (µg/l)	100 <	EPA 200.7
Aluminum, dissolved (µg/l)	100 <	EPA 200.7
Antimony, total (µg/l)	0.3 ND	EPA 200.8
Antimony, dissolved (µg/l)	0.3 ND	EPA 200.8
Beryllium, total (µg/l)	0.19 ND	EPA 200.8
Beryllium, dissolved (µg/l)	0.19 ND	EPA 200.8
Cobalt, total (µg/l)		
Cobalt, dissolved (µg/l)		
Gallium, total (µg/l)	8.72	EPA 200.8
Gallium, dissolved (µg/l)	8.28	EPA 200.8
Germanium, total (µg/l)	1 ND	EPA 200.8
Germanium, dissolved (µg/l)	1 ND	EPA 200.8
Nickel, total (µg/l)	0.28 ND	EPA 200.8
Nickel, dissolved (µg/l)	0.28 ND	EPA 200.8
Rubidium, total (µg/l)	1 ND	EPA 200.8
Rubidium, dissolved (µg/l)	1 ND	EPA 200.8
Titanium, total (µg/l)	0.7 ND	EPA 200.8
Titanium, dissolved (µg/l)	0.7 ND	EPA 200.8
Vanadium, total (µg/l)	0.53 ND	EPA 200.8
Vanadium, dissolved (µg/l)	0.53 ND	EPA 200.8
Yttrium, total (µg/l)	1 ND	EPA 200.8
Yttrium, dissolved (µg/l)	1 ND	EPA 200.8

T Please indicate detection limit if analyte is not detected.



Date Prepared/Revised 03/05/2024
DEP USE ONLY
Date Received

## FORM 14R RESIDUAL WASTE LANDFILLS AND DISPOSAL IMPOUNDMENTS QUARTERLY AND ANNUAL WATER QUALITY ANALYSES

This form must be fully and accurately completed. All required information must be typed or legibly printed in the spaces provided. If additional space is necessary, identify each attached sheet as Form 14R, reference the item number and identify the date prepared. The "date prepared/revised" on any attached sheets needs to match the "date prepared/revised" on this page.

General References: Section 288.254, 289.264

### SECTION A. SITE IDENTIFIER

Applicant/permittee:	Brunner Island, LLC - Basin No. 5
Site Name:	Basin No. 5
Facility ID (as issued by DEP):	301337

### SECTION B. FACILITY INFORMATION

Monitoring wells must be designed and constructed in accordance with Department standards. **INDICATE THE LATITUDE AND LONGITUDE TO THE NEAREST ONE TENTH OF A SECOND (DD° MM' SS.S").**

Monitoring Point Number: <u>MW-4-10</u>	<input checked="" type="checkbox"/> Well <input type="checkbox"/> Spring <input type="checkbox"/> Stream <input type="checkbox"/> Other <input type="checkbox"/> Upgradient/Upstream <input checked="" type="checkbox"/> Downgradient/Downstream
Location: County <u>York</u>	Municipality: <u>East Manchester Township</u>
Sampling Point: Latitude: <u>40° 5' 25.84"</u>	Longitude: <u>76° 41' 25.83"</u>
Depth to Water Level: <u>25.45</u> ft.	Measured from: <input type="checkbox"/> Land Surface <input checked="" type="checkbox"/> TOC
Casing Stick Up: <u>2.26</u> ft.	Elevation of Water Level: <u>267.26</u> ft./MSL
Sampling Depth: <u>34.00</u> ft.	Volume of Water Column: _____ gal.
Total Well Depth: <u>38.60</u> ft.	Sampling Method: <input checked="" type="checkbox"/> Pumped <input type="checkbox"/> Bailed <input type="checkbox"/> Grab
Well Purged: <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Well Volumes Purged: <u>3.45</u> L
Sample Field Filtered (must be 0.45 micron)? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
Spring Flow Rate: _____ GPM	
Sample Date (mm/dd/yy): <u>01/29/2024</u>	Sample Collection Time: <u>11:52AM</u>
Sample Collector's Name: <u>AMC</u>	
Sample Collector's Affiliation: <u>Talen Generation, LLC</u>	
Laboratory(ies) Performing Analysis: <u>Hawk Mtn Labs, Inc.</u>	
Were any holding times exceeded? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No. If yes, please explain in comments field.	
Lab Certification Number(s): <u>40-417</u>	
Lab Sample Number(s): <u>240101636-005</u>	Final Lab Analysis Completion Date: <u>02/09/2024</u>
Name/Affiliation of Person who Filled out Form <u>Martin Mengel / Talen Energy Supply, LLC</u>	
Comments: _____ _____ _____	

I.D. No.	301309
Monitoring Point No.	MW-4-10
Sample Date	01/29/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**  
**ANALYTES**

**1-Q. Inorganics (Enter all data in mg/l except as noted)**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Ammonia, as N (mg/l)	0.066 ND	SM 4500-NH3 F
Bicarbonate (mg/l)	78.8	SM 2320
Calcium, total (mg/l)	156	EPA 200.7
Calcium, dissolved (mg/l)	162	EPA 200.7
Chemical Oxygen Demand (mg/l)	5.3 ND	SM 5220 D
Chloride, total as Cl (mg/l)	19.1	EPA 300.0
Fluoride, total as F (mg/l)	0.2 <	EPA 300.0
Iron, total (µg/l)	33	EPA 200.7
Iron, dissolved (µg/l)	20 <	EPA 200.7
Magnesium, total (mg/l)	13.6	EPA 200.7
Magnesium, dissolved (mg/l)	13.9	EPA 200.7
Manganese, total (µg/l)	338	EPA 200.7
Manganese, dissolved (µg/l)	368	EPA 200.7
Nitrate, as N (mg/l)	1.15	EPA 300.0
pH, field (su)	6.33	SM 4500-H+B
pH, lab (su)	6.26 H	SM 4500-H+B
Potassium, total (mg/l)	109	EPA 200.7
Potassium, dissolved (mg/l)	116	EPA 200.7
Sodium, total (mg/l)	61.2	EPA 200.7
Sodium, dissolved (mg/l)	64.2	EPA 200.7
Specific Conductance, field (umhos/cm)	1,412	EPA 120.1, FIELD
Specific Conductance, lab (umhos/cm)	1,440	SM 2510 B
Sulfate, as SO4 (mg/l)	1,502	EPA 300.0
Alkalinity, total as CaCO3 (mg/l)	78.8	SM 2320 B
Total Dissolved Solids (mg/l)	1,020	SM 2540 C
Total Organic Carbon (mg/l)	0.5 <	SM 5310 C
Turbidity, field (n.t.u.)	1.37	Field Meter
Dissolved O2, field (mg/l)	2.49	Field Meter
Redox, field (mv)	299.2	Field Meter
Temperature, field (°c)	11.41	Field Meter
Acidity, total as CaCO3 (mg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-4-10
Sample Date	01/29/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**

**1-A. Organics (Enter all data in ug/l)**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Benzene (µg/l)		
1,2-Dibromoethane (µg/l)		
1,1-Dichloroethane (µg/l)		
1,1-Dichloroethene (µg/l)		
1,2-Dichloroethane (µg/l)		
cis-1,2-Dichloroethene (µg/l)		
trans-1,2-Dichloroethene (µg/l)		
Ethylbenzene (µg/l)		
Methylene Chloride (µg/l)		
Tetrachloroethene (µg/l)		
Toluene (µg/l)		
1,1,1-Trichloroethane (µg/l)		
Trichloroethene (µg/l)		
Vinyl chloride (µg/l)		
Xylenes (µg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-4-10
Sample Date	01/29/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Arsenic, total (µg/l)	0.55 ND	EPA 200.8
Arsenic, dissolved (µg/l)	1.15	EPA 200.8
Barium, total (µg/l)	11.9	EPA 200.8
Barium, dissolved (µg/l)	10.7	EPA 200.8
Cadmium, total (µg/l)	1 <	EPA 200.8
Cadmium, dissolved (µg/l)	1 <	EPA 200.8
Chromium, total (µg/l)	0.41 ND	EPA 200.8
Chromium, dissolved (µg/l)	0.41 ND	EPA 200.8
Copper, total (µg/l)	1.87	EPA 200.8
Copper, dissolved (µg/l)	1.8	EPA 200.8
Lead, total (µg/l)	0.08 ND	EPA 200.8
Lead, dissolved (µg/l)	0.08 ND	EPA 200.8
Mercury, total (µg/l)	0.72 ND	EPA 200.8
Mercury, dissolved (µg/l)	0.72 ND	EPA 200.8
Selenium, total (µg/l)	16.4	EPA 200.8
Selenium, dissolved (µg/l)	19.3	EPA 200.8
Silver, total (µg/l)	0.13 ND	EPA 200.8
Silver, dissolved (µg/l)	0.13 ND	EPA 200.8
Zinc, total (µg/l)	8.85	EPA 200.8
Zinc, dissolved (µg/l)	9.03	EPA 200.8
Boron, total (µg/l)	1,880	EPA 200.7
Boron, dissolved (µg/l)	1,950	EPA 200.7
Lithium, total (µg/l)	664	EPA 200.8
Lithium, dissolved (µg/l)	680	EPA 200.8
Molybdenum, total (µg/l)	777	EPA 200.8
Molybdenum, dissolved (µg/l)	822	EPA 200.8
Strontium, total (µg/l)	1,500	EPA 200.7
Strontium, dissolved (µg/l)	1,540	EPA 200.7

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-4-10
Sample Date	01/29/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Aluminum, total (µg/l)	101	EPA 200.7
Aluminum, dissolved (µg/l)	100 <	EPA 200.7
Antimony, total (µg/l)	1 <	EPA 200.8
Antimony, dissolved (µg/l)	0.3 ND	EPA 200.8
Beryllium, total (µg/l)	0.19 ND	EPA 200.8
Beryllium, dissolved (µg/l)	0.19 ND	EPA 200.8
Cobalt, total (µg/l)		
Cobalt, dissolved (µg/l)		
Gallium, total (µg/l)		
Gallium, dissolved (µg/l)		
Germanium, total (µg/l)		
Germanium, dissolved (µg/l)		
Nickel, total (µg/l)	9.63	EPA 200.8
Nickel, dissolved (µg/l)	13.7	EPA 200.8
Rubidium, total (µg/l)		
Rubidium, dissolved (µg/l)		
Titanium, total (µg/l)	0.7 ND	EPA 200.8
Titanium, dissolved (µg/l)	0.7 ND	EPA 200.8
Vanadium, total (µg/l)	0.53 ND	EPA 200.8
Vanadium, dissolved (µg/l)	0.53 ND	EPA 200.8
Yttrium, total (µg/l)		
Yttrium, dissolved (µg/l)		

T Please indicate detection limit if analyte is not detected.



Date Prepared/Revised 03/05/2024
DEP USE ONLY
Date Received

**FORM 14R**  
**RESIDUAL WASTE LANDFILLS**  
**AND DISPOSAL IMPOUNDMENTS**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**

This form must be fully and accurately completed. All required information must be typed or legibly printed in the spaces provided. If additional space is necessary, identify each attached sheet as Form 14R, reference the item number and identify the date prepared. The "date prepared/revised" on any attached sheets needs to match the "date prepared/revised" on this page.

General References: Section 288.254, 289.264

**SECTION A. SITE IDENTIFIER**

Applicant/permittee: Brunner Island, LLC - Basin No. 5

Site Name: Basin No. 5

Facility ID (as issued by DEP): 301337

**SECTION B. FACILITY INFORMATION**

Monitoring wells must be designed and constructed in accordance with Department standards. **INDICATE THE LATITUDE AND LONGITUDE TO THE NEAREST ONE TENTH OF A SECOND (DD° MM' SS.S")**.

Monitoring Point Number: MW-4-7A       Well     Spring     Stream     Other  
 Upgradient/Upstream     Downgradient/Downstream

Location: County York      Municipality: East Manchester Township

Sampling Point: Latitude: 40° 5' 20.84"      Longitude: 76° 41' 34.11"

Depth to Water Level: 26.33 ft.      Measured from:  Land Surface     TOC

Casing Stick Up: 2.23 ft.      Elevation of Water Level: 261.68 ft./MSL

Sampling Depth: 35.00 ft.      Volume of Water Column: \_\_\_\_\_ gal.

Total Well Depth: 39.90 ft.      Sampling Method:  Pumped     Bailed     Grab

Well Purged:  Yes     No      Well Volumes Purged: 3 L

Sample Field Filtered (must be 0.45 micron)?  Yes     No

Spring Flow Rate: \_\_\_\_\_ GPM

Sample Date (mm/dd/yy): 01/23/2024      Sample Collection Time: 8:38AM

Sample Collector's Name: JO

Sample Collector's Affiliation: Talen Generation, LLC

Laboratory(ies) Performing Analysis: Hawk Mtn Labs, Inc.

Were any holding times exceeded?  Yes     No. If yes, please explain in comments field.

Lab Certification Number(s): 40-417

Lab Sample Number(s): 240101636-002      Final Lab Analysis Completion Date: 02/02/2024

Name/Affiliation of Person who Filled out Form Martin Mengel / Talen Energy Supply, LLC

Comments: \_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

I.D. No.	301309
Monitoring Point No.	MW-4-7A
Sample Date	01/23/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**  
**ANALYTES**

**1-Q. Inorganics (Enter all data in mg/l except as noted)**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Ammonia, as N (mg/l)	0.235	SM 4500-NH3 F
Bicarbonate (mg/l)	233	SM 2320
Calcium, total (mg/l)	227	EPA 200.7
Calcium, dissolved (mg/l)	243	EPA 200.7
Chemical Oxygen Demand (mg/l)	5.3 ND	SM 5220 D
Chloride, total as Cl (mg/l)	11.6	EPA 300.0
Fluoride, total as F (mg/l)	0.233	EPA 300.0
Iron, total (µg/l)	12.2 ND	EPA 200.7
Iron, dissolved (µg/l)	20 <	EPA 200.7
Magnesium, total (mg/l)	39.1	EPA 200.7
Magnesium, dissolved (mg/l)	41.2	EPA 200.7
Manganese, total (µg/l)	219	EPA 200.7
Manganese, dissolved (µg/l)	219	EPA 200.7
Nitrate, as N (mg/l)	0.022 ND	EPA 300.0
pH, field (su)	6.94	SM 4500-H+B
pH, lab (su)	7.17 H	SM 4500-H+B
Potassium, total (mg/l)	3.98	EPA 200.7
Potassium, dissolved (mg/l)	4.02	EPA 200.7
Sodium, total (mg/l)	57.6	EPA 200.7
Sodium, dissolved (mg/l)	59.1	EPA 200.7
Specific Conductance, field (umhos/cm)	1,496	EPA 120.1, FIELD
Specific Conductance, lab (umhos/cm)	1,530	SM 2510 B
Sulfate, as SO4 (mg/l)	624	EPA 300.0
Alkalinity, total as CaCO3 (mg/l)	233	SM 2320 B
Total Dissolved Solids (mg/l)	1,150	SM 2540 C
Total Organic Carbon (mg/l)	0.998	SM 5310 C
Turbidity, field (n.t.u.)	0.4	Field Meter
Dissolved O2, field (mg/l)	1.01	Field Meter
Redox, field (mv)	249	Field Meter
Temperature, field (°c)	12.53	Field Meter
Acidity, total as CaCO3 (mg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-4-7A
Sample Date	01/23/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**

**1-A. Organics (Enter all data in ug/l)**

<b>ANALYTE</b>	<b>VALUE (T)</b>	<b>ANALYSIS METHOD NUMBER</b>
Benzene (µg/l)		
1,2-Dibromoethane (µg/l)		
1,1-Dichloroethane (µg/l)		
1,1-Dichloroethene (µg/l)		
1,2-Dichloroethane (µg/l)		
cis-1,2-Dichloroethene (µg/l)		
trans-1,2-Dichloroethene (µg/l)		
Ethylbenzene (µg/l)		
Methylene Chloride (µg/l)		
Tetrachloroethene (µg/l)		
Toluene (µg/l)		
1,1,1-Trichloroethane (µg/l)		
Trichloroethene (µg/l)		
Vinyl chloride (µg/l)		
Xylenes (µg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-4-7A
Sample Date	01/23/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Arsenic, total (µg/l)	1 <	EPA 200.8
Arsenic, dissolved (µg/l)	0.55 ND	EPA 200.8
Barium, total (µg/l)	16.8	EPA 200.8
Barium, dissolved (µg/l)	16.4	EPA 200.8
Cadmium, total (µg/l)	0.15 ND	EPA 200.8
Cadmium, dissolved (µg/l)	0.15 ND	EPA 200.8
Chromium, total (µg/l)	0.41 ND	EPA 200.8
Chromium, dissolved (µg/l)	0.41 ND	EPA 200.8
Copper, total (µg/l)	0.39 ND	EPA 200.8
Copper, dissolved (µg/l)	0.39 ND	EPA 200.8
Lead, total (µg/l)	0.08 ND	EPA 200.8
Lead, dissolved (µg/l)	0.08 ND	EPA 200.8
Mercury, total (µg/l)	0.72 ND	EPA 200.8
Mercury, dissolved (µg/l)	0.72 ND	EPA 200.8
Selenium, total (µg/l)	0.63 ND	EPA 200.8
Selenium, dissolved (µg/l)	0.63 ND	EPA 200.8
Silver, total (µg/l)	0.13 ND	EPA 200.8
Silver, dissolved (µg/l)	5 <	EPA 200.8
Zinc, total (µg/l)	1.12 ND	EPA 200.8
Zinc, dissolved (µg/l)	5 <	EPA 200.8
Boron, total (µg/l)	1,650	EPA 200.7
Boron, dissolved (µg/l)	1,710	EPA 200.7
Lithium, total (µg/l)	226	EPA 200.8
Lithium, dissolved (µg/l)	216	EPA 200.8
Molybdenum, total (µg/l)	29.7	EPA 200.8
Molybdenum, dissolved (µg/l)	28.1	EPA 200.8
Strontium, total (µg/l)	350	EPA 200.7
Strontium, dissolved (µg/l)	378	EPA 200.7

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-4-7A
Sample Date	01/23/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Aluminum, total (µg/l)	100 <	EPA 200.7
Aluminum, dissolved (µg/l)	100 <	EPA 200.7
Antimony, total (µg/l)	0.3 ND	EPA 200.8
Antimony, dissolved (µg/l)	0.3 ND	EPA 200.8
Beryllium, total (µg/l)	0.19 ND	EPA 200.8
Beryllium, dissolved (µg/l)	0.19 ND	EPA 200.8
Cobalt, total (µg/l)		
Cobalt, dissolved (µg/l)		
Gallium, total (µg/l)		
Gallium, dissolved (µg/l)		
Germanium, total (µg/l)		
Germanium, dissolved (µg/l)		
Nickel, total (µg/l)	1 <	EPA 200.8
Nickel, dissolved (µg/l)	1 <	EPA 200.8
Rubidium, total (µg/l)		
Rubidium, dissolved (µg/l)		
Titanium, total (µg/l)	0.7 ND	EPA 200.8
Titanium, dissolved (µg/l)	5 <	EPA 200.8
Vanadium, total (µg/l)	5 <	EPA 200.8
Vanadium, dissolved (µg/l)	5 <	EPA 200.8
Yttrium, total (µg/l)		
Yttrium, dissolved (µg/l)		

T Please indicate detection limit if analyte is not detected.



I.D. No.	301309
Monitoring Point No.	MW-8-10A
Sample Date	01/22/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**  
**ANALYTES**

**1-Q. Inorganics (Enter all data in mg/l except as noted)**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Ammonia, as N (mg/l)	0.066 ND	SM 4500-NH3 F
Bicarbonate (mg/l)	148	SM 2320
Calcium, total (mg/l)	157	EPA 200.7
Calcium, dissolved (mg/l)	151	EPA 200.7
Chemical Oxygen Demand (mg/l)	5.3 ND	SM 5220 D
Chloride, total as Cl (mg/l)	58.7	EPA 300.0
Fluoride, total as F (mg/l)	0.2 <	EPA 300.0
Iron, total (µg/l)	12.2 ND	EPA 200.7
Iron, dissolved (µg/l)	20 <	EPA 200.7
Magnesium, total (mg/l)	40.6	EPA 200.7
Magnesium, dissolved (mg/l)	38.9	EPA 200.7
Manganese, total (µg/l)	350	EPA 200.7
Manganese, dissolved (µg/l)	272	EPA 200.7
Nitrate, as N (mg/l)	0.5 <	EPA 300.0
pH, field (su)	6.8	SM 4500-H+B
pH, lab (su)	6.91 H	SM 4500-H+B
Potassium, total (mg/l)	2.76	EPA 200.7
Potassium, dissolved (mg/l)	2.68	EPA 200.7
Sodium, total (mg/l)	21.9	EPA 200.7
Sodium, dissolved (mg/l)	21	EPA 200.7
Specific Conductance, field (umhos/cm)	1,095	EPA 120.1, FIELD
Specific Conductance, lab (umhos/cm)	1,100	SM 2510 B
Sulfate, as SO4 (mg/l)	345	EPA 300.0
Alkalinity, total as CaCO3 (mg/l)	148	SM 2320 B
Total Dissolved Solids (mg/l)	797	SM 2540 C
Total Organic Carbon (mg/l)	0.5 <	SM 5310 C
Turbidity, field (n.t.u.)	1.08	Field Meter
Dissolved O2, field (mg/l)	0.67	Field Meter
Redox, field (mv)	348.4	Field Meter
Temperature, field (°c)	11.01	Field Meter
Acidity, total as CaCO3 (mg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-10A
Sample Date	01/22/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**

**1-A. Organics (Enter all data in ug/l)**

<b>ANALYTE</b>	<b>VALUE (T)</b>	<b>ANALYSIS METHOD NUMBER</b>
Benzene (µg/l)		
1,2-Dibromoethane (µg/l)		
1,1-Dichloroethane (µg/l)		
1,1-Dichloroethene (µg/l)		
1,2-Dichloroethane (µg/l)		
cis-1,2-Dichloroethene (µg/l)		
trans-1,2-Dichloroethene (µg/l)		
Ethylbenzene (µg/l)		
Methylene Chloride (µg/l)		
Tetrachloroethene (µg/l)		
Toluene (µg/l)		
1,1,1-Trichloroethane (µg/l)		
Trichloroethene (µg/l)		
Vinyl chloride (µg/l)		
Xylenes (µg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-10A
Sample Date	01/22/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Arsenic, total (µg/l)	0.55 ND	EPA 200.8
Arsenic, dissolved (µg/l)	0.55 ND	EPA 200.8
Barium, total (µg/l)	19.4	EPA 200.8
Barium, dissolved (µg/l)	18.3	EPA 200.8
Cadmium, total (µg/l)	0.15 ND	EPA 200.8
Cadmium, dissolved (µg/l)	0.15 ND	EPA 200.8
Chromium, total (µg/l)	0.41 ND	EPA 200.8
Chromium, dissolved (µg/l)	0.41 ND	EPA 200.8
Copper, total (µg/l)	0.39 ND	EPA 200.8
Copper, dissolved (µg/l)	0.39 ND	EPA 200.8
Lead, total (µg/l)	0.08 ND	EPA 200.8
Lead, dissolved (µg/l)	0.08 ND	EPA 200.8
Mercury, total (µg/l)	0.72 ND	EPA 200.8
Mercury, dissolved (µg/l)	0.72 ND	EPA 200.8
Selenium, total (µg/l)	0.63 ND	EPA 200.8
Selenium, dissolved (µg/l)	0.63 ND	EPA 200.8
Silver, total (µg/l)	0.13 ND	EPA 200.8
Silver, dissolved (µg/l)	0.13 ND	EPA 200.8
Zinc, total (µg/l)	5 <	EPA 200.8
Zinc, dissolved (µg/l)	5 <	EPA 200.8
Boron, total (µg/l)	472	EPA 200.7
Boron, dissolved (µg/l)	452	EPA 200.7
Lithium, total (µg/l)	14.8	EPA 200.8
Lithium, dissolved (µg/l)	14.5	EPA 200.8
Molybdenum, total (µg/l)	34.5	EPA 200.8
Molybdenum, dissolved (µg/l)	32.6	EPA 200.8
Strontium, total (µg/l)	342	EPA 200.7
Strontium, dissolved (µg/l)	334	EPA 200.7

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-10A
Sample Date	01/22/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Aluminum, total (µg/l)	100 <	EPA 200.7
Aluminum, dissolved (µg/l)	100 <	EPA 200.7
Antimony, total (µg/l)	0.3 ND	EPA 200.8
Antimony, dissolved (µg/l)	1 <	EPA 200.8
Beryllium, total (µg/l)	0.19 ND	EPA 200.8
Beryllium, dissolved (µg/l)	0.19 ND	EPA 200.8
Cobalt, total (µg/l)		
Cobalt, dissolved (µg/l)		
Gallium, total (µg/l)		
Gallium, dissolved (µg/l)		
Germanium, total (µg/l)		
Germanium, dissolved (µg/l)		
Nickel, total (µg/l)	1.07	EPA 200.8
Nickel, dissolved (µg/l)	1.06	EPA 200.8
Rubidium, total (µg/l)		
Rubidium, dissolved (µg/l)		
Titanium, total (µg/l)	0.7 ND	EPA 200.8
Titanium, dissolved (µg/l)	0.7 ND	EPA 200.8
Vanadium, total (µg/l)	0.53 ND	EPA 200.8
Vanadium, dissolved (µg/l)	0.53 ND	EPA 200.8
Yttrium, total (µg/l)		
Yttrium, dissolved (µg/l)		

T Please indicate detection limit if analyte is not detected.



Date Prepared/Revised 03/05/2024
DEP USE ONLY
Date Received

## FORM 14R

### RESIDUAL WASTE LANDFILLS AND DISPOSAL IMPOUNDMENTS

#### QUARTERLY AND ANNUAL WATER QUALITY ANALYSES

This form must be fully and accurately completed. All required information must be typed or legibly printed in the spaces provided. If additional space is necessary, identify each attached sheet as Form 14R, reference the item number and identify the date prepared. The "date prepared/revised" on any attached sheets needs to match the "date prepared/revised" on this page.

General References: Section 288.254, 289.264

#### SECTION A. SITE IDENTIFIER

Applicant/permittee: Brunner Island, LLC - Basin No. 5  
 Site Name: Basin No. 5  
 Facility ID (as issued by DEP): 301337

#### SECTION B. FACILITY INFORMATION

Monitoring wells must be designed and constructed in accordance with Department standards. **INDICATE THE LATITUDE AND LONGITUDE TO THE NEAREST ONE TENTH OF A SECOND (DD° MM' SS.S").**

Monitoring Point Number: MW-8-10B       Well     Spring     Stream     Other  
 Upgradient/Upstream     Downgradient/Downstream  
 Location: County York      Municipality: East Manchester Township  
 Sampling Point: Latitude: 40° 5' 13.72"      Longitude: 76° 41' 31.84"  
 Depth to Water Level: 16.79 ft.      Measured from:  Land Surface     TOC  
 Casing Stick Up: 1.44 ft.      Elevation of Water Level: 259.48 ft./MSL  
 Sampling Depth: 52.00 ft.      Volume of Water Column: \_\_\_\_\_ gal.  
 Total Well Depth: 57.00 ft.      Sampling Method:  Pumped     Bailed     Grab  
 Well Purged:  Yes     No      Well Volumes Purged: 3.3 L

Sample Field Filtered (must be 0.45 micron)?  Yes     No

Spring Flow Rate: \_\_\_\_\_ GPM

Sample Date (mm/dd/yy): 01/22/2024      Sample Collection Time: 11:09AM

Sample Collector's Name: AMC

Sample Collector's Affiliation: Talen Generation, LLC

Laboratory(ies) Performing Analysis: Hawk Mtn Labs, Inc.

Were any holding times exceeded?  Yes     No. If yes, please explain in comments field.

Lab Certification Number(s): 40-417

Lab Sample Number(s): 240101639-014      Final Lab Analysis Completion Date: 02/01/2024

Name/Affiliation of Person who Filled out Form Martin Mengel / Talen Energy Supply, LLC

Comments: \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_

I.D. No.	301309
Monitoring Point No.	MW-8-10B
Sample Date	01/22/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**  
**ANALYTES**

**1-Q. Inorganics (Enter all data in mg/l except as noted)**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Ammonia, as N (mg/l)	0.066 ND	SM 4500-NH3 F
Bicarbonate (mg/l)	107	SM 2320
Calcium, total (mg/l)	130	EPA 200.7
Calcium, dissolved (mg/l)	128	EPA 200.7
Chemical Oxygen Demand (mg/l)	20 <	SM 5220 D
Chloride, total as Cl (mg/l)	110	EPA 300.0
Fluoride, total as F (mg/l)	0.2 <	EPA 300.0
Iron, total (µg/l)	35	EPA 200.7
Iron, dissolved (µg/l)	20 <	EPA 200.7
Magnesium, total (mg/l)	25.5	EPA 200.7
Magnesium, dissolved (mg/l)	25.3	EPA 200.7
Manganese, total (µg/l)	45	EPA 200.7
Manganese, dissolved (µg/l)	40	EPA 200.7
Nitrate, as N (mg/l)	0.022 ND	EPA 300.0
pH, field (su)	7.72	SM 4500-H+B
pH, lab (su)	7.69 H	SM 4500-H+B
Potassium, total (mg/l)	2.37	EPA 200.7
Potassium, dissolved (mg/l)	2.31	EPA 200.7
Sodium, total (mg/l)	7.98	EPA 200.7
Sodium, dissolved (mg/l)	7.67	EPA 200.7
Specific Conductance, field (umhos/cm)	911	EPA 120.1, FIELD
Specific Conductance, lab (umhos/cm)	899	SM 2510 B
Sulfate, as SO4 (mg/l)	171	EPA 300.0
Alkalinity, total as CaCO3 (mg/l)	107	SM 2320 B
Total Dissolved Solids (mg/l)	663	SM 2540 C
Total Organic Carbon (mg/l)	0.192 ND	SM 5310 C
Turbidity, field (n.t.u.)	0.95	Field Meter
Dissolved O2, field (mg/l)	0.49	Field Meter
Redox, field (mv)	87.9	Field Meter
Temperature, field (°c)	12.28	Field Meter
Acidity, total as CaCO3 (mg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-10B
Sample Date	01/22/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**

**1-A. Organics (Enter all data in ug/l)**

<b>ANALYTE</b>	<b>VALUE (T)</b>	<b>ANALYSIS METHOD NUMBER</b>
Benzene (µg/l)		
1,2-Dibromoethane (µg/l)		
1,1-Dichloroethane (µg/l)		
1,1-Dichloroethene (µg/l)		
1,2-Dichloroethane (µg/l)		
cis-1,2-Dichloroethene (µg/l)		
trans-1,2-Dichloroethene (µg/l)		
Ethylbenzene (µg/l)		
Methylene Chloride (µg/l)		
Tetrachloroethene (µg/l)		
Toluene (µg/l)		
1,1,1-Trichloroethane (µg/l)		
Trichloroethene (µg/l)		
Vinyl chloride (µg/l)		
Xylenes (µg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-10B
Sample Date	01/22/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Arsenic, total (µg/l)	1.7	EPA 200.8
Arsenic, dissolved (µg/l)	1.54	EPA 200.8
Barium, total (µg/l)	44.5	EPA 200.8
Barium, dissolved (µg/l)	42	EPA 200.8
Cadmium, total (µg/l)	0.15 ND	EPA 200.8
Cadmium, dissolved (µg/l)	0.15 ND	EPA 200.8
Chromium, total (µg/l)	0.41 ND	EPA 200.8
Chromium, dissolved (µg/l)	0.41 ND	EPA 200.8
Copper, total (µg/l)	0.39 ND	EPA 200.8
Copper, dissolved (µg/l)	0.39 ND	EPA 200.8
Lead, total (µg/l)	0.08 ND	EPA 200.8
Lead, dissolved (µg/l)	0.08 ND	EPA 200.8
Mercury, total (µg/l)	0.72 ND	EPA 200.8
Mercury, dissolved (µg/l)	0.72 ND	EPA 200.8
Selenium, total (µg/l)	0.63 ND	EPA 200.8
Selenium, dissolved (µg/l)	0.63 ND	EPA 200.8
Silver, total (µg/l)	0.13 ND	EPA 200.8
Silver, dissolved (µg/l)	0.13 ND	EPA 200.8
Zinc, total (µg/l)	1.12 ND	EPA 200.8
Zinc, dissolved (µg/l)	1.12 ND	EPA 200.8
Boron, total (µg/l)	262	EPA 200.7
Boron, dissolved (µg/l)	256	EPA 200.7
Lithium, total (µg/l)	10.7	EPA 200.8
Lithium, dissolved (µg/l)	10.5	EPA 200.8
Molybdenum, total (µg/l)	29.6	EPA 200.8
Molybdenum, dissolved (µg/l)	28.4	EPA 200.8
Strontium, total (µg/l)	250	EPA 200.7
Strontium, dissolved (µg/l)	242	EPA 200.7

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-10B
Sample Date	01/22/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Aluminum, total (µg/l)	100 <	EPA 200.7
Aluminum, dissolved (µg/l)	100 <	EPA 200.7
Antimony, total (µg/l)	0.3 ND	EPA 200.8
Antimony, dissolved (µg/l)	0.3 ND	EPA 200.8
Beryllium, total (µg/l)	0.19 ND	EPA 200.8
Beryllium, dissolved (µg/l)	0.19 ND	EPA 200.8
Cobalt, total (µg/l)		
Cobalt, dissolved (µg/l)		
Gallium, total (µg/l)		
Gallium, dissolved (µg/l)		
Germanium, total (µg/l)		
Germanium, dissolved (µg/l)		
Nickel, total (µg/l)	0.28 ND	EPA 200.8
Nickel, dissolved (µg/l)	0.28 ND	EPA 200.8
Rubidium, total (µg/l)		
Rubidium, dissolved (µg/l)		
Titanium, total (µg/l)	0.7 ND	EPA 200.8
Titanium, dissolved (µg/l)	0.7 ND	EPA 200.8
Vanadium, total (µg/l)	5 <	EPA 200.8
Vanadium, dissolved (µg/l)	5 <	EPA 200.8
Yttrium, total (µg/l)		
Yttrium, dissolved (µg/l)		

T Please indicate detection limit if analyte is not detected.



Date Prepared/Revised 03/05/2024
DEP USE ONLY
Date Received

**FORM 14R**  
**RESIDUAL WASTE LANDFILLS**  
**AND DISPOSAL IMPOUNDMENTS**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**

This form must be fully and accurately completed. All required information must be typed or legibly printed in the spaces provided. If additional space is necessary, identify each attached sheet as Form 14R, reference the item number and identify the date prepared. The "date prepared/revised" on any attached sheets needs to match the "date prepared/revised" on this page.

General References: Section 288.254, 289.264

**SECTION A. SITE IDENTIFIER**

Applicant/permittee: Brunner Island, LLC - Basin No. 5

Site Name: Basin No. 5

Facility ID (as issued by DEP): 301337

**SECTION B. FACILITY INFORMATION**

Monitoring wells must be designed and constructed in accordance with Department standards. **INDICATE THE LATITUDE AND LONGITUDE TO THE NEAREST ONE TENTH OF A SECOND (DD° MM' SS.S")**.

Monitoring Point Number: MW-8-1N       Well     Spring     Stream     Other  
 Upgradient/Upstream     Downgradient/Downstream

Location: County York      Municipality: East Manchester Township

Sampling Point: Latitude: 40° 4' 59.01"      Longitude: 76° 41' 21.00"

Depth to Water Level: 12.16 ft.      Measured from:  Land Surface     TOC

Casing Stick Up: 1.95 ft.      Elevation of Water Level: 268.48 ft./MSL

Sampling Depth: 23.00 ft.      Volume of Water Column: \_\_\_\_\_ gal.

Total Well Depth: 26.30 ft.      Sampling Method:  Pumped     Bailed     Grab

Well Purged:  Yes     No      Well Volumes Purged: 3 L

Sample Field Filtered (must be 0.45 micron)?  Yes     No

Spring Flow Rate: \_\_\_\_\_ GPM

Sample Date (mm/dd/yy): 01/19/2024      Sample Collection Time: 11:20AM

Sample Collector's Name: ST

Sample Collector's Affiliation: Talen Generation, LLC

Laboratory(ies) Performing Analysis: Hawk Mtn Labs, Inc.

Were any holding times exceeded?  Yes     No. If yes, please explain in comments field.

Lab Certification Number(s): 40-417

Lab Sample Number(s): 240101639-001      Final Lab Analysis Completion Date: 02/01/2024

Name/Affiliation of Person who Filled out Form Martin Mengel / Talen Energy Supply, LLC

Comments: \_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

I.D. No.	301309
Monitoring Point No.	MW-8-1N
Sample Date	01/19/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**  
**ANALYTES**

**1-Q. Inorganics (Enter all data in mg/l except as noted)**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Ammonia, as N (mg/l)	0.2 <	SM 4500-NH3 F
Bicarbonate (mg/l)	196	SM 2320
Calcium, total (mg/l)	167	EPA 200.7
Calcium, dissolved (mg/l)	168	EPA 200.7
Chemical Oxygen Demand (mg/l)	5.3 ND	SM 5220 D
Chloride, total as Cl (mg/l)	47	EPA 300.0
Fluoride, total as F (mg/l)	0.23	EPA 300.0
Iron, total (µg/l)	603	EPA 200.7
Iron, dissolved (µg/l)	339	EPA 200.7
Magnesium, total (mg/l)	30.2	EPA 200.7
Magnesium, dissolved (mg/l)	30.7	EPA 200.7
Manganese, total (µg/l)	1,370	EPA 200.7
Manganese, dissolved (µg/l)	1,420	EPA 200.7
Nitrate, as N (mg/l)	0.022 ND	EPA 300.0
pH, field (su)	7.51	SM 4500-H+B
pH, lab (su)	6.96 H	SM 4500-H+B
Potassium, total (mg/l)	8.77	EPA 200.7
Potassium, dissolved (mg/l)	8.84	EPA 200.7
Sodium, total (mg/l)	28.3	EPA 200.7
Sodium, dissolved (mg/l)	27.8	EPA 200.7
Specific Conductance, field (umhos/cm)	1,174	EPA 120.1, FIELD
Specific Conductance, lab (umhos/cm)	1,150	SM 2510 B
Sulfate, as SO4 (mg/l)	344	EPA 300.0
Alkalinity, total as CaCO3 (mg/l)	196	SM 2320 B
Total Dissolved Solids (mg/l)	774	SM 2540 C
Total Organic Carbon (mg/l)	0.657	SM 5310 C
Turbidity, field (n.t.u.)	0.72	Field Meter
Dissolved O2, field (mg/l)	0.12	Field Meter
Redox, field (mv)	65.5	Field Meter
Temperature, field (°c)	8.63	Field Meter
Acidity, total as CaCO3 (mg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-1N
Sample Date	01/19/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**

**1-A. Organics (Enter all data in ug/l)**

<b>ANALYTE</b>	<b>VALUE (T)</b>	<b>ANALYSIS METHOD NUMBER</b>
Benzene (µg/l)		
1,2-Dibromoethane (µg/l)		
1,1-Dichloroethane (µg/l)		
1,1-Dichloroethene (µg/l)		
1,2-Dichloroethane (µg/l)		
cis-1,2-Dichloroethene (µg/l)		
trans-1,2-Dichloroethene (µg/l)		
Ethylbenzene (µg/l)		
Methylene Chloride (µg/l)		
Tetrachloroethene (µg/l)		
Toluene (µg/l)		
1,1,1-Trichloroethane (µg/l)		
Trichloroethene (µg/l)		
Vinyl chloride (µg/l)		
Xylenes (µg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-1N
Sample Date	01/19/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Arsenic, total (µg/l)	0.55 ND	EPA 200.8
Arsenic, dissolved (µg/l)	0.55 ND	EPA 200.8
Barium, total (µg/l)	18.6	EPA 200.8
Barium, dissolved (µg/l)	19	EPA 200.8
Cadmium, total (µg/l)	0.15 ND	EPA 200.8
Cadmium, dissolved (µg/l)	0.15 ND	EPA 200.8
Chromium, total (µg/l)	0.41 ND	EPA 200.8
Chromium, dissolved (µg/l)	0.41 ND	EPA 200.8
Copper, total (µg/l)	1.57	EPA 200.8
Copper, dissolved (µg/l)	1.62	EPA 200.8
Lead, total (µg/l)	0.08 ND	EPA 200.8
Lead, dissolved (µg/l)	0.08 ND	EPA 200.8
Mercury, total (µg/l)	0.72 ND	EPA 200.8
Mercury, dissolved (µg/l)	0.72 ND	EPA 200.8
Selenium, total (µg/l)	0.63 ND	EPA 200.8
Selenium, dissolved (µg/l)	0.63 ND	EPA 200.8
Silver, total (µg/l)	0.13 ND	EPA 200.8
Silver, dissolved (µg/l)	0.13 ND	EPA 200.8
Zinc, total (µg/l)	44.1	EPA 200.8
Zinc, dissolved (µg/l)	45.7	EPA 200.8
Boron, total (µg/l)	100 <	EPA 200.7
Boron, dissolved (µg/l)	100 <	EPA 200.7
Lithium, total (µg/l)	1 <	EPA 200.8
Lithium, dissolved (µg/l)	1 <	EPA 200.8
Molybdenum, total (µg/l)	1.6	EPA 200.8
Molybdenum, dissolved (µg/l)	0.78 ND	EPA 200.8
Strontium, total (µg/l)	1,250	EPA 200.7
Strontium, dissolved (µg/l)	1,280	EPA 200.7

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-1N
Sample Date	01/19/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Aluminum, total (µg/l)	100 <	EPA 200.7
Aluminum, dissolved (µg/l)	100 <	EPA 200.7
Antimony, total (µg/l)	0.3 ND	EPA 200.8
Antimony, dissolved (µg/l)	0.3 ND	EPA 200.8
Beryllium, total (µg/l)	0.19 ND	EPA 200.8
Beryllium, dissolved (µg/l)	0.19 ND	EPA 200.8
Cobalt, total (µg/l)		
Cobalt, dissolved (µg/l)		
Gallium, total (µg/l)		
Gallium, dissolved (µg/l)		
Germanium, total (µg/l)		
Germanium, dissolved (µg/l)		
Nickel, total (µg/l)	1 <	EPA 200.8
Nickel, dissolved (µg/l)	1 <	EPA 200.8
Rubidium, total (µg/l)		
Rubidium, dissolved (µg/l)		
Titanium, total (µg/l)	0.7 ND	EPA 200.8
Titanium, dissolved (µg/l)	0.7 ND	EPA 200.8
Vanadium, total (µg/l)	0.53 ND	EPA 200.8
Vanadium, dissolved (µg/l)	0.53 ND	EPA 200.8
Yttrium, total (µg/l)		
Yttrium, dissolved (µg/l)		

T Please indicate detection limit if analyte is not detected.



Date Prepared/Revised 03/05/2024
DEP USE ONLY
Date Received

**FORM 14R**  
**RESIDUAL WASTE LANDFILLS**  
**AND DISPOSAL IMPOUNDMENTS**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**

This form must be fully and accurately completed. All required information must be typed or legibly printed in the spaces provided. If additional space is necessary, identify each attached sheet as Form 14R, reference the item number and identify the date prepared. The "date prepared/revised" on any attached sheets needs to match the "date prepared/revised" on this page.

General References: Section 288.254, 289.264

**SECTION A. SITE IDENTIFIER**

Applicant/permittee: Brunner Island, LLC - Basin No. 5

Site Name: Basin No. 5

Facility ID (as issued by DEP): 301337

**SECTION B. FACILITY INFORMATION**

Monitoring wells must be designed and constructed in accordance with Department standards. **INDICATE THE LATITUDE AND LONGITUDE TO THE NEAREST ONE TENTH OF A SECOND (DD° MM' SS.S")**.

Monitoring Point Number: MW-8-2       Well     Spring     Stream     Other

Upgradient/Upstream     Downgradient/Downstream

Location: County York      Municipality: East Manchester Township

Sampling Point: Latitude: 40° 5' 4.33"      Longitude: 76° 40' 59.57"

Depth to Water Level: 6.65 ft.      Measured from:  Land Surface     TOC

Casing Stick Up: 2.00 ft.      Elevation of Water Level: 264.85 ft./MSL

Sampling Depth: 15.00 ft.      Volume of Water Column: \_\_\_\_\_ gal.

Total Well Depth: 22.30 ft.      Sampling Method:  Pumped     Bailed     Grab

Well Purged:  Yes     No      Well Volumes Purged: 7.7 L

Sample Field Filtered (must be 0.45 micron)?  Yes     No

Spring Flow Rate: \_\_\_\_\_ GPM

Sample Date (mm/dd/yy): 01/19/2024      Sample Collection Time: 8:45AM

Sample Collector's Name: ST

Sample Collector's Affiliation: Talen Generation, LLC

Laboratory(ies) Performing Analysis: Hawk Mtn Labs, Inc.

Were any holding times exceeded?  Yes     No. If yes, please explain in comments field.

Lab Certification Number(s): 40-417

Lab Sample Number(s): 240101639-002      Final Lab Analysis Completion Date: 02/01/2024

Name/Affiliation of Person who Filled out Form Martin Mengel / Talen Energy Supply, LLC

Comments: \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

I.D. No.	301309
Monitoring Point No.	MW-8-2
Sample Date	01/19/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**  
**ANALYTES**

**1-Q. Inorganics (Enter all data in mg/l except as noted)**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Ammonia, as N (mg/l)	0.2 <	SM 4500-NH3 F
Bicarbonate (mg/l)	149	SM 2320
Calcium, total (mg/l)	110	EPA 200.7
Calcium, dissolved (mg/l)	109	EPA 200.7
Chemical Oxygen Demand (mg/l)	5.3 ND	SM 5220 D
Chloride, total as Cl (mg/l)	28.4	EPA 300.0
Fluoride, total as F (mg/l)	0.8	EPA 300.0
Iron, total (µg/l)	23	EPA 200.7
Iron, dissolved (µg/l)	20 <	EPA 200.7
Magnesium, total (mg/l)	20.1	EPA 200.7
Magnesium, dissolved (mg/l)	19.7	EPA 200.7
Manganese, total (µg/l)	368	EPA 200.7
Manganese, dissolved (µg/l)	328	EPA 200.7
Nitrate, as N (mg/l)	0.5 <	EPA 300.0
pH, field (su)	6.96	SM 4500-H+B
pH, lab (su)	6.99 H	SM 4500-H+B
Potassium, total (mg/l)	6.3	EPA 200.7
Potassium, dissolved (mg/l)	6.05	EPA 200.7
Sodium, total (mg/l)	16.8	EPA 200.7
Sodium, dissolved (mg/l)	16.5	EPA 200.7
Specific Conductance, field (umhos/cm)	752	EPA 120.1, FIELD
Specific Conductance, lab (umhos/cm)	757	SM 2510 B
Sulfate, as SO4 (mg/l)	190	EPA 300.0
Alkalinity, total as CaCO3 (mg/l)	149	SM 2320 B
Total Dissolved Solids (mg/l)	475	SM 2540 C
Total Organic Carbon (mg/l)	0.872	SM 5310 C
Turbidity, field (n.t.u.)	1.04	Field Meter
Dissolved O2, field (mg/l)	0.39	Field Meter
Redox, field (mv)	196.3	Field Meter
Temperature, field (°c)	10.61	Field Meter
Acidity, total as CaCO3 (mg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-2
Sample Date	01/19/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**

**1-A. Organics (Enter all data in ug/l)**

<b>ANALYTE</b>	<b>VALUE (T)</b>	<b>ANALYSIS METHOD NUMBER</b>
Benzene (µg/l)		
1,2-Dibromoethane (µg/l)		
1,1-Dichloroethane (µg/l)		
1,1-Dichloroethene (µg/l)		
1,2-Dichloroethane (µg/l)		
cis-1,2-Dichloroethene (µg/l)		
trans-1,2-Dichloroethene (µg/l)		
Ethylbenzene (µg/l)		
Methylene Chloride (µg/l)		
Tetrachloroethene (µg/l)		
Toluene (µg/l)		
1,1,1-Trichloroethane (µg/l)		
Trichloroethene (µg/l)		
Vinyl chloride (µg/l)		
Xylenes (µg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-2
Sample Date	01/19/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Arsenic, total (µg/l)	0.55 ND	EPA 200.8
Arsenic, dissolved (µg/l)	0.55 ND	EPA 200.8
Barium, total (µg/l)	28.4	EPA 200.8
Barium, dissolved (µg/l)	30.5	EPA 200.8
Cadmium, total (µg/l)	1.07	EPA 200.8
Cadmium, dissolved (µg/l)	1.13	EPA 200.8
Chromium, total (µg/l)	0.41 ND	EPA 200.8
Chromium, dissolved (µg/l)	0.41 ND	EPA 200.8
Copper, total (µg/l)	1.89	EPA 200.8
Copper, dissolved (µg/l)	1.96	EPA 200.8
Lead, total (µg/l)	1 <	EPA 200.8
Lead, dissolved (µg/l)	0.08 ND	EPA 200.8
Mercury, total (µg/l)	0.72 ND	EPA 200.8
Mercury, dissolved (µg/l)	0.72 ND	EPA 200.8
Selenium, total (µg/l)	0.63 ND	EPA 200.8
Selenium, dissolved (µg/l)	0.63 ND	EPA 200.8
Silver, total (µg/l)	0.13 ND	EPA 200.8
Silver, dissolved (µg/l)	0.13 ND	EPA 200.8
Zinc, total (µg/l)	43.7	EPA 200.8
Zinc, dissolved (µg/l)	47.4	EPA 200.8
Boron, total (µg/l)	454	EPA 200.7
Boron, dissolved (µg/l)	448	EPA 200.7
Lithium, total (µg/l)	17.1	EPA 200.8
Lithium, dissolved (µg/l)	17.7	EPA 200.8
Molybdenum, total (µg/l)	255	EPA 200.8
Molybdenum, dissolved (µg/l)	268	EPA 200.8
Strontium, total (µg/l)	660	EPA 200.7
Strontium, dissolved (µg/l)	647	EPA 200.7

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-2
Sample Date	01/19/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Aluminum, total (µg/l)	100 <	EPA 200.7
Aluminum, dissolved (µg/l)	100 <	EPA 200.7
Antimony, total (µg/l)	1 <	EPA 200.8
Antimony, dissolved (µg/l)	1 <	EPA 200.8
Beryllium, total (µg/l)	0.19 ND	EPA 200.8
Beryllium, dissolved (µg/l)	0.19 ND	EPA 200.8
Cobalt, total (µg/l)		
Cobalt, dissolved (µg/l)		
Gallium, total (µg/l)		
Gallium, dissolved (µg/l)		
Germanium, total (µg/l)		
Germanium, dissolved (µg/l)		
Nickel, total (µg/l)	1.44	EPA 200.8
Nickel, dissolved (µg/l)	1.47	EPA 200.8
Rubidium, total (µg/l)		
Rubidium, dissolved (µg/l)		
Titanium, total (µg/l)	0.7 ND	EPA 200.8
Titanium, dissolved (µg/l)	0.7 ND	EPA 200.8
Vanadium, total (µg/l)	5 <	EPA 200.8
Vanadium, dissolved (µg/l)	5 <	EPA 200.8
Yttrium, total (µg/l)		
Yttrium, dissolved (µg/l)		

T Please indicate detection limit if analyte is not detected.



Date Prepared/Revised 03/05/2024
DEP USE ONLY
Date Received

**FORM 14R**  
**RESIDUAL WASTE LANDFILLS**  
**AND DISPOSAL IMPOUNDMENTS**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**

This form must be fully and accurately completed. All required information must be typed or legibly printed in the spaces provided. If additional space is necessary, identify each attached sheet as Form 14R, reference the item number and identify the date prepared. The "date prepared/revised" on any attached sheets needs to match the "date prepared/revised" on this page.

General References: Section 288.254, 289.264

**SECTION A. SITE IDENTIFIER**

Applicant/permittee: Brunner Island, LLC - Basin No. 5

Site Name: Basin No. 5

Facility ID (as issued by DEP): 301337

**SECTION B. FACILITY INFORMATION**

Monitoring wells must be designed and constructed in accordance with Department standards. **INDICATE THE LATITUDE AND LONGITUDE TO THE NEAREST ONE TENTH OF A SECOND (DD° MM' SS.S")**.

Monitoring Point Number: MW-8-3A  Well  Spring  Stream  Other  
 Upgradient/Upstream  Downgradient/Downstream

Location: County York Municipality: East Manchester Township

Sampling Point: Latitude: 40° 5' 12.49" Longitude: 76° 41' 6.87"

Depth to Water Level: 9.77 ft. Measured from:  Land Surface  TOC

Casing Stick Up: 1.72 ft. Elevation of Water Level: 257.61 ft./MSL

Sampling Depth: 20.00 ft. Volume of Water Column: \_\_\_\_\_ gal.

Total Well Depth: 26.90 ft. Sampling Method:  Pumped  Bailed  Grab

Well Purged:  Yes  No Well Volumes Purged: 3.3 L

Sample Field Filtered (must be 0.45 micron)?  Yes  No

Spring Flow Rate: \_\_\_\_\_ GPM

Sample Date (mm/dd/yy): 01/20/2024 Sample Collection Time: 10:51AM

Sample Collector's Name: AMC

Sample Collector's Affiliation: Talen Generation, LLC

Laboratory(ies) Performing Analysis: Hawk Mtn Labs, Inc.

Were any holding times exceeded?  Yes  No. If yes, please explain in comments field.

Lab Certification Number(s): 40-417

Lab Sample Number(s): 240101639-003 Final Lab Analysis Completion Date: 02/01/2024

Name/Affiliation of Person who Filled out Form Martin Mengel / Talen Energy Supply, LLC

Comments: \_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

I.D. No.	301309
Monitoring Point No.	MW-8-3A
Sample Date	01/20/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**  
**ANALYTES**

**1-Q. Inorganics (Enter all data in mg/l except as noted)**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Ammonia, as N (mg/l)	0.2 <	SM 4500-NH3 F
Bicarbonate (mg/l)	215	SM 2320
Calcium, total (mg/l)	181	EPA 200.7
Calcium, dissolved (mg/l)	180	EPA 200.7
Chemical Oxygen Demand (mg/l)	5.3 ND	SM 5220 D
Chloride, total as Cl (mg/l)	133	EPA 300.0
Fluoride, total as F (mg/l)	0.38	EPA 300.0
Iron, total (µg/l)	3,180	EPA 200.7
Iron, dissolved (µg/l)	1,370	EPA 200.7
Magnesium, total (mg/l)	36.5	EPA 200.7
Magnesium, dissolved (mg/l)	35.9	EPA 200.7
Manganese, total (µg/l)	2,590	EPA 200.7
Manganese, dissolved (µg/l)	2,280	EPA 200.7
Nitrate, as N (mg/l)	0.5 <	EPA 300.0
pH, field (su)	6.71	SM 4500-H+B
pH, lab (su)	6.84 H	SM 4500-H+B
Potassium, total (mg/l)	3.52	EPA 200.7
Potassium, dissolved (mg/l)	3.55	EPA 200.7
Sodium, total (mg/l)	38	EPA 200.7
Sodium, dissolved (mg/l)	40.9	EPA 200.7
Specific Conductance, field (umhos/cm)	1,272	EPA 120.1, FIELD
Specific Conductance, lab (umhos/cm)	1,280	SM 2510 B
Sulfate, as SO4 (mg/l)	267	EPA 300.0
Alkalinity, total as CaCO3 (mg/l)	215	SM 2320 B
Total Dissolved Solids (mg/l)	832	SM 2540 C
Total Organic Carbon (mg/l)	0.665	SM 5310 C
Turbidity, field (n.t.u.)	32.3	Field Meter
Dissolved O2, field (mg/l)	2.6	Field Meter
Redox, field (mv)	112.2	Field Meter
Temperature, field (°c)	8.68	Field Meter
Acidity, total as CaCO3 (mg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-3A
Sample Date	01/20/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**

**1-A. Organics (Enter all data in ug/l)**

<b>ANALYTE</b>	<b>VALUE (T)</b>	<b>ANALYSIS METHOD NUMBER</b>
Benzene (µg/l)		
1,2-Dibromoethane (µg/l)		
1,1-Dichloroethane (µg/l)		
1,1-Dichloroethene (µg/l)		
1,2-Dichloroethane (µg/l)		
cis-1,2-Dichloroethene (µg/l)		
trans-1,2-Dichloroethene (µg/l)		
Ethylbenzene (µg/l)		
Methylene Chloride (µg/l)		
Tetrachloroethene (µg/l)		
Toluene (µg/l)		
1,1,1-Trichloroethane (µg/l)		
Trichloroethene (µg/l)		
Vinyl chloride (µg/l)		
Xylenes (µg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-3A
Sample Date	01/20/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Arsenic, total (µg/l)	7.2	EPA 200.8
Arsenic, dissolved (µg/l)	3.91	EPA 200.8
Barium, total (µg/l)	27.1	EPA 200.8
Barium, dissolved (µg/l)	25.6	EPA 200.8
Cadmium, total (µg/l)	0.15 ND	EPA 200.8
Cadmium, dissolved (µg/l)	0.15 ND	EPA 200.8
Chromium, total (µg/l)	1 <	EPA 200.8
Chromium, dissolved (µg/l)	0.41 ND	EPA 200.8
Copper, total (µg/l)	1.32	EPA 200.8
Copper, dissolved (µg/l)	1.41	EPA 200.8
Lead, total (µg/l)	0.08 ND	EPA 200.8
Lead, dissolved (µg/l)	0.08 ND	EPA 200.8
Mercury, total (µg/l)	0.72 ND	EPA 200.8
Mercury, dissolved (µg/l)	0.72 ND	EPA 200.8
Selenium, total (µg/l)	0.63 ND	EPA 200.8
Selenium, dissolved (µg/l)	0.63 ND	EPA 200.8
Silver, total (µg/l)	0.13 ND	EPA 200.8
Silver, dissolved (µg/l)	0.13 ND	EPA 200.8
Zinc, total (µg/l)	40.7	EPA 200.8
Zinc, dissolved (µg/l)	44.4	EPA 200.8
Boron, total (µg/l)	463	EPA 200.7
Boron, dissolved (µg/l)	454	EPA 200.7
Lithium, total (µg/l)	19.7	EPA 200.8
Lithium, dissolved (µg/l)	19.6	EPA 200.8
Molybdenum, total (µg/l)	32.2	EPA 200.8
Molybdenum, dissolved (µg/l)	32	EPA 200.8
Strontium, total (µg/l)	1,010	EPA 200.7
Strontium, dissolved (µg/l)	1,020	EPA 200.7

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-3A
Sample Date	01/20/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Aluminum, total (µg/l)	100 <	EPA 200.7
Aluminum, dissolved (µg/l)	100 <	EPA 200.7
Antimony, total (µg/l)	0.3 ND	EPA 200.8
Antimony, dissolved (µg/l)	0.3 ND	EPA 200.8
Beryllium, total (µg/l)	0.19 ND	EPA 200.8
Beryllium, dissolved (µg/l)	0.19 ND	EPA 200.8
Cobalt, total (µg/l)		
Cobalt, dissolved (µg/l)		
Gallium, total (µg/l)		
Gallium, dissolved (µg/l)		
Germanium, total (µg/l)		
Germanium, dissolved (µg/l)		
Nickel, total (µg/l)	1.24	EPA 200.8
Nickel, dissolved (µg/l)	1 <	EPA 200.8
Rubidium, total (µg/l)		
Rubidium, dissolved (µg/l)		
Titanium, total (µg/l)	0.7 ND	EPA 200.8
Titanium, dissolved (µg/l)	0.7 ND	EPA 200.8
Vanadium, total (µg/l)	0.53 ND	EPA 200.8
Vanadium, dissolved (µg/l)	0.53 ND	EPA 200.8
Yttrium, total (µg/l)		
Yttrium, dissolved (µg/l)		

T Please indicate detection limit if analyte is not detected.



Date Prepared/Revised 03/05/2024
DEP USE ONLY
Date Received

**FORM 14R**  
**RESIDUAL WASTE LANDFILLS**  
**AND DISPOSAL IMPOUNDMENTS**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**

This form must be fully and accurately completed. All required information must be typed or legibly printed in the spaces provided. If additional space is necessary, identify each attached sheet as Form 14R, reference the item number and identify the date prepared. The "date prepared/revised" on any attached sheets needs to match the "date prepared/revised" on this page.

General References: Section 288.254, 289.264

**SECTION A. SITE IDENTIFIER**

Applicant/permittee: Brunner Island, LLC - Basin No. 5  
 Site Name: Basin No. 5  
 Facility ID (as issued by DEP): 301337

**SECTION B. FACILITY INFORMATION**

Monitoring wells must be designed and constructed in accordance with Department standards. **INDICATE THE LATITUDE AND LONGITUDE TO THE NEAREST ONE TENTH OF A SECOND (DD° MM' SS.S")**.

Monitoring Point Number: MW-8-3B       Well     Spring     Stream     Other  
 Upgradient/Upstream     Downgradient/Downstream

Location: County York      Municipality: East Manchester Township

Sampling Point: Latitude: 40° 5' 12.49"      Longitude: 76° 41' 6.87"

Depth to Water Level: 11.32 ft.      Measured from:  Land Surface     TOC

Casing Stick Up: 1.90 ft.      Elevation of Water Level: 256.39 ft./MSL

Sampling Depth: 40.00 ft.      Volume of Water Column: \_\_\_\_\_ gal.

Total Well Depth: 47.00 ft.      Sampling Method:  Pumped     Bailed     Grab

Well Purged:  Yes     No      Well Volumes Purged: 3 L

Sample Field Filtered (must be 0.45 micron)?  Yes     No

Spring Flow Rate: \_\_\_\_\_ GPM

Sample Date (mm/dd/yy): 01/20/2024      Sample Collection Time: 12:25PM

Sample Collector's Name: AMC

Sample Collector's Affiliation: Talen Generation, LLC

Laboratory(ies) Performing Analysis: Hawk Mtn Labs, Inc.

Were any holding times exceeded?  Yes     No. If yes, please explain in comments field.

Lab Certification Number(s): 40-417

Lab Sample Number(s): 240101639-004      Final Lab Analysis Completion Date: 02/01/2024

Name/Affiliation of Person who Filled out Form Martin Mengel / Talen Energy Supply, LLC

Comments: \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_

I.D. No.	301309
Monitoring Point No.	MW-8-3B
Sample Date	01/20/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**  
**ANALYTES**

**1-Q. Inorganics (Enter all data in mg/l except as noted)**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Ammonia, as N (mg/l)	0.066 ND	SM 4500-NH3 F
Bicarbonate (mg/l)	253	SM 2320
Calcium, total (mg/l)	140	EPA 200.7
Calcium, dissolved (mg/l)	136	EPA 200.7
Chemical Oxygen Demand (mg/l)	5.3 ND	SM 5220 D
Chloride, total as Cl (mg/l)	62.7	EPA 300.0
Fluoride, total as F (mg/l)	0.42	EPA 300.0
Iron, total (µg/l)	399	EPA 200.7
Iron, dissolved (µg/l)	246	EPA 200.7
Magnesium, total (mg/l)	27.4	EPA 200.7
Magnesium, dissolved (mg/l)	26.1	EPA 200.7
Manganese, total (µg/l)	1,160	EPA 200.7
Manganese, dissolved (µg/l)	1,060	EPA 200.7
Nitrate, as N (mg/l)	0.022 ND	EPA 300.0
pH, field (su)	7.23	SM 4500-H+B
pH, lab (su)	7.31 H	SM 4500-H+B
Potassium, total (mg/l)	1.73	EPA 200.7
Potassium, dissolved (mg/l)	1.66	EPA 200.7
Sodium, total (mg/l)	7.77	EPA 200.7
Sodium, dissolved (mg/l)	7.91	EPA 200.7
Specific Conductance, field (umhos/cm)	883	EPA 120.1, FIELD
Specific Conductance, lab (umhos/cm)	883	SM 2510 B
Sulfate, as SO4 (mg/l)	124	EPA 300.0
Alkalinity, total as CaCO3 (mg/l)	253	SM 2320 B
Total Dissolved Solids (mg/l)	542	SM 2540 C
Total Organic Carbon (mg/l)	0.5 <	SM 5310 C
Turbidity, field (n.t.u.)	2.19	Field Meter
Dissolved O2, field (mg/l)	0.37	Field Meter
Redox, field (mv)	29.9	Field Meter
Temperature, field (°c)	10.2	Field Meter
Acidity, total as CaCO3 (mg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-3B
Sample Date	01/20/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**

**1-A. Organics (Enter all data in ug/l)**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Benzene (µg/l)		
1,2-Dibromoethane (µg/l)		
1,1-Dichloroethane (µg/l)		
1,1-Dichloroethene (µg/l)		
1,2-Dichloroethane (µg/l)		
cis-1,2-Dichloroethene (µg/l)		
trans-1,2-Dichloroethene (µg/l)		
Ethylbenzene (µg/l)		
Methylene Chloride (µg/l)		
Tetrachloroethene (µg/l)		
Toluene (µg/l)		
1,1,1-Trichloroethane (µg/l)		
Trichloroethene (µg/l)		
Vinyl chloride (µg/l)		
Xylenes (µg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-3B
Sample Date	01/20/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Arsenic, total (µg/l)	8.69	EPA 200.8
Arsenic, dissolved (µg/l)	6.99	EPA 200.8
Barium, total (µg/l)	66.1	EPA 200.8
Barium, dissolved (µg/l)	59.8	EPA 200.8
Cadmium, total (µg/l)	0.15 ND	EPA 200.8
Cadmium, dissolved (µg/l)	0.15 ND	EPA 200.8
Chromium, total (µg/l)	0.41 ND	EPA 200.8
Chromium, dissolved (µg/l)	0.41 ND	EPA 200.8
Copper, total (µg/l)	1.5	EPA 200.8
Copper, dissolved (µg/l)	1.46	EPA 200.8
Lead, total (µg/l)	0.08 ND	EPA 200.8
Lead, dissolved (µg/l)	0.08 ND	EPA 200.8
Mercury, total (µg/l)	0.72 ND	EPA 200.8
Mercury, dissolved (µg/l)	0.72 ND	EPA 200.8
Selenium, total (µg/l)	0.63 ND	EPA 200.8
Selenium, dissolved (µg/l)	0.63 ND	EPA 200.8
Silver, total (µg/l)	0.13 ND	EPA 200.8
Silver, dissolved (µg/l)	0.13 ND	EPA 200.8
Zinc, total (µg/l)	43	EPA 200.8
Zinc, dissolved (µg/l)	45.4	EPA 200.8
Boron, total (µg/l)	362	EPA 200.7
Boron, dissolved (µg/l)	351	EPA 200.7
Lithium, total (µg/l)	25.2	EPA 200.8
Lithium, dissolved (µg/l)	26.3	EPA 200.8
Molybdenum, total (µg/l)	149	EPA 200.8
Molybdenum, dissolved (µg/l)	146	EPA 200.8
Strontium, total (µg/l)	397	EPA 200.7
Strontium, dissolved (µg/l)	383	EPA 200.7

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-3B
Sample Date	01/20/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Aluminum, total (µg/l)	100 <	EPA 200.7
Aluminum, dissolved (µg/l)	100 <	EPA 200.7
Antimony, total (µg/l)	0.3 ND	EPA 200.8
Antimony, dissolved (µg/l)	0.3 ND	EPA 200.8
Beryllium, total (µg/l)	0.19 ND	EPA 200.8
Beryllium, dissolved (µg/l)	0.19 ND	EPA 200.8
Cobalt, total (µg/l)		
Cobalt, dissolved (µg/l)		
Gallium, total (µg/l)		
Gallium, dissolved (µg/l)		
Germanium, total (µg/l)		
Germanium, dissolved (µg/l)		
Nickel, total (µg/l)	1 <	EPA 200.8
Nickel, dissolved (µg/l)	1 <	EPA 200.8
Rubidium, total (µg/l)		
Rubidium, dissolved (µg/l)		
Titanium, total (µg/l)	0.7 ND	EPA 200.8
Titanium, dissolved (µg/l)	0.7 ND	EPA 200.8
Vanadium, total (µg/l)	5 <	EPA 200.8
Vanadium, dissolved (µg/l)	0.53 ND	EPA 200.8
Yttrium, total (µg/l)		
Yttrium, dissolved (µg/l)		

T Please indicate detection limit if analyte is not detected.



Date Prepared/Revised 03/05/2024
DEP USE ONLY
Date Received

**FORM 14R**  
**RESIDUAL WASTE LANDFILLS**  
**AND DISPOSAL IMPOUNDMENTS**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**

This form must be fully and accurately completed. All required information must be typed or legibly printed in the spaces provided. If additional space is necessary, identify each attached sheet as Form 14R, reference the item number and identify the date prepared. The "date prepared/revised" on any attached sheets needs to match the "date prepared/revised" on this page.

General References: Section 288.254, 289.264

**SECTION A. SITE IDENTIFIER**

Applicant/permittee: Brunner Island, LLC - Basin No. 5

Site Name: Basin No. 5

Facility ID (as issued by DEP): 301337

**SECTION B. FACILITY INFORMATION**

Monitoring wells must be designed and constructed in accordance with Department standards. **INDICATE THE LATITUDE AND LONGITUDE TO THE NEAREST ONE TENTH OF A SECOND (DD° MM' SS.S")**.

Monitoring Point Number: MW-8-4  Well  Spring  Stream  Other  
 Upgradient/Upstream  Downgradient/Downstream

Location: County York Municipality: East Manchester Township

Sampling Point: Latitude: 40° 5' 25.61" Longitude: 76° 41' 13.82"

Depth to Water Level: 12.06 ft. Measured from:  Land Surface  TOC

Casing Stick Up: 1.81 ft. Elevation of Water Level: 258.13 ft./MSL

Sampling Depth: 18.00 ft. Volume of Water Column: \_\_\_\_\_ gal.

Total Well Depth: 21.70 ft. Sampling Method:  Pumped  Bailed  Grab

Well Purged:  Yes  No Well Volumes Purged: 3.3 L

Sample Field Filtered (must be 0.45 micron)?  Yes  No

Spring Flow Rate: \_\_\_\_\_ GPM

Sample Date (mm/dd/yy): 01/20/2024 Sample Collection Time: 8:12AM

Sample Collector's Name: ST

Sample Collector's Affiliation: Talen Generation, LLC

Laboratory(ies) Performing Analysis: Hawk Mtn Labs, Inc.

Were any holding times exceeded?  Yes  No. If yes, please explain in comments field.

Lab Certification Number(s): 40-417

Lab Sample Number(s): 240101639-006 Final Lab Analysis Completion Date: 02/01/2024

Name/Affiliation of Person who Filled out Form Martin Mengel / Talen Energy Supply, LLC

Comments: \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

I.D. No.	301309
Monitoring Point No.	MW-8-4
Sample Date	01/20/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**  
**ANALYTES**

**1-Q. Inorganics (Enter all data in mg/l except as noted)**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Ammonia, as N (mg/l)	0.066 ND	SM 4500-NH3 F
Bicarbonate (mg/l)	64.2	SM 2320
Calcium, total (mg/l)	66.8	EPA 200.7
Calcium, dissolved (mg/l)	65.4	EPA 200.7
Chemical Oxygen Demand (mg/l)	5.3 ND	SM 5220 D
Chloride, total as Cl (mg/l)	10.3	EPA 300.0
Fluoride, total as F (mg/l)	0.26	EPA 300.0
Iron, total (µg/l)	20	EPA 200.7
Iron, dissolved (µg/l)	20 <	EPA 200.7
Magnesium, total (mg/l)	25.2	EPA 200.7
Magnesium, dissolved (mg/l)	24.6	EPA 200.7
Manganese, total (µg/l)	3,370	EPA 200.7
Manganese, dissolved (µg/l)	3,360	EPA 200.7
Nitrate, as N (mg/l)	0.5 <	EPA 300.0
pH, field (su)	5.36	SM 4500-H+B
pH, lab (su)	6.22 H	SM 4500-H+B
Potassium, total (mg/l)	1.29	EPA 200.7
Potassium, dissolved (mg/l)	1.21	EPA 200.7
Sodium, total (mg/l)	11.3	EPA 200.7
Sodium, dissolved (mg/l)	10.7	EPA 200.7
Specific Conductance, field (umhos/cm)	600	EPA 120.1, FIELD
Specific Conductance, lab (umhos/cm)	591	SM 2510 B
Sulfate, as SO4 (mg/l)	212	EPA 300.0
Alkalinity, total as CaCO3 (mg/l)	64.2	SM 2320 B
Total Dissolved Solids (mg/l)	397	SM 2540 C
Total Organic Carbon (mg/l)	0.5 <	SM 5310 C
Turbidity, field (n.t.u.)	0.73	Field Meter
Dissolved O2, field (mg/l)	2.6	Field Meter
Redox, field (mv)	222.9	Field Meter
Temperature, field (°c)	9.87	Field Meter
Acidity, total as CaCO3 (mg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-4
Sample Date	01/20/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**

**1-A. Organics (Enter all data in ug/l)**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Benzene (µg/l)		
1,2-Dibromoethane (µg/l)		
1,1-Dichloroethane (µg/l)		
1,1-Dichloroethene (µg/l)		
1,2-Dichloroethane (µg/l)		
cis-1,2-Dichloroethene (µg/l)		
trans-1,2-Dichloroethene (µg/l)		
Ethylbenzene (µg/l)		
Methylene Chloride (µg/l)		
Tetrachloroethene (µg/l)		
Toluene (µg/l)		
1,1,1-Trichloroethane (µg/l)		
Trichloroethene (µg/l)		
Vinyl chloride (µg/l)		
Xylenes (µg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-4
Sample Date	01/20/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Arsenic, total (µg/l)	0.55 ND	EPA 200.8
Arsenic, dissolved (µg/l)	0.55 ND	EPA 200.8
Barium, total (µg/l)	16.4	EPA 200.8
Barium, dissolved (µg/l)	16.8	EPA 200.8
Cadmium, total (µg/l)	1 <	EPA 200.8
Cadmium, dissolved (µg/l)	1 <	EPA 200.8
Chromium, total (µg/l)	1.16	EPA 200.8
Chromium, dissolved (µg/l)	0.41 ND	EPA 200.8
Copper, total (µg/l)	1.74	EPA 200.8
Copper, dissolved (µg/l)	2.05	EPA 200.8
Lead, total (µg/l)	1 <	EPA 200.8
Lead, dissolved (µg/l)	0.08 ND	EPA 200.8
Mercury, total (µg/l)	0.72 ND	EPA 200.8
Mercury, dissolved (µg/l)	0.72 ND	EPA 200.8
Selenium, total (µg/l)	0.63 ND	EPA 200.8
Selenium, dissolved (µg/l)	0.63 ND	EPA 200.8
Silver, total (µg/l)	0.13 ND	EPA 200.8
Silver, dissolved (µg/l)	0.13 ND	EPA 200.8
Zinc, total (µg/l)	71.1	EPA 200.8
Zinc, dissolved (µg/l)	71.9	EPA 200.8
Boron, total (µg/l)	213	EPA 200.7
Boron, dissolved (µg/l)	217	EPA 200.7
Lithium, total (µg/l)	10	EPA 200.8
Lithium, dissolved (µg/l)	10.8	EPA 200.8
Molybdenum, total (µg/l)	7.22	EPA 200.8
Molybdenum, dissolved (µg/l)	9.28	EPA 200.8
Strontium, total (µg/l)	211	EPA 200.7
Strontium, dissolved (µg/l)	191	EPA 200.7

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-4
Sample Date	01/20/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Aluminum, total (µg/l)	257	EPA 200.7
Aluminum, dissolved (µg/l)	100 <	EPA 200.7
Antimony, total (µg/l)	0.3 ND	EPA 200.8
Antimony, dissolved (µg/l)	0.3 ND	EPA 200.8
Beryllium, total (µg/l)	0.19 ND	EPA 200.8
Beryllium, dissolved (µg/l)	0.19 ND	EPA 200.8
Cobalt, total (µg/l)		
Cobalt, dissolved (µg/l)		
Gallium, total (µg/l)		
Gallium, dissolved (µg/l)		
Germanium, total (µg/l)		
Germanium, dissolved (µg/l)		
Nickel, total (µg/l)	27.4	EPA 200.8
Nickel, dissolved (µg/l)	27.9	EPA 200.8
Rubidium, total (µg/l)		
Rubidium, dissolved (µg/l)		
Titanium, total (µg/l)	0.7 ND	EPA 200.8
Titanium, dissolved (µg/l)	0.7 ND	EPA 200.8
Vanadium, total (µg/l)	0.53 ND	EPA 200.8
Vanadium, dissolved (µg/l)	0.53 ND	EPA 200.8
Yttrium, total (µg/l)		
Yttrium, dissolved (µg/l)		

T Please indicate detection limit if analyte is not detected.



Date Prepared/Revised 03/05/2024
DEP USE ONLY
Date Received

**FORM 14R**  
**RESIDUAL WASTE LANDFILLS**  
**AND DISPOSAL IMPOUNDMENTS**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**

This form must be fully and accurately completed. All required information must be typed or legibly printed in the spaces provided. If additional space is necessary, identify each attached sheet as Form 14R, reference the item number and identify the date prepared. The "date prepared/revised" on any attached sheets needs to match the "date prepared/revised" on this page.

General References: Section 288.254, 289.264

**SECTION A. SITE IDENTIFIER**

Applicant/permittee: Brunner Island, LLC - Basin No. 5

Site Name: Basin No. 5

Facility ID (as issued by DEP): 301337

**SECTION B. FACILITY INFORMATION**

Monitoring wells must be designed and constructed in accordance with Department standards. **INDICATE THE LATITUDE AND LONGITUDE TO THE NEAREST ONE TENTH OF A SECOND (DD° MM' SS.S")**.

Monitoring Point Number: MW-8-5A  Well  Spring  Stream  Other  
 Upgradient/Upstream  Downgradient/Downstream

Location: County York Municipality: East Manchester Township

Sampling Point: Latitude: 40° 5' 16.91" Longitude: 76° 41' 31.04"

Depth to Water Level: 23.18 ft. Measured from:  Land Surface  TOC

Casing Stick Up: 1.97 ft. Elevation of Water Level: 261.86 ft./MSL

Sampling Depth: 33.00 ft. Volume of Water Column: \_\_\_\_\_ gal.

Total Well Depth: 39.20 ft. Sampling Method:  Pumped  Bailed  Grab

Well Purged:  Yes  No Well Volumes Purged: 4.25 L

Sample Field Filtered (must be 0.45 micron)?  Yes  No

Spring Flow Rate: \_\_\_\_\_ GPM

Sample Date (mm/dd/yy): 01/20/2024 Sample Collection Time: 10:10AM

Sample Collector's Name: ST

Sample Collector's Affiliation: Talen Generation, LLC

Laboratory(ies) Performing Analysis: Hawk Mtn Labs, Inc.

Were any holding times exceeded?  Yes  No. If yes, please explain in comments field.

Lab Certification Number(s): 40-417

Lab Sample Number(s): 240101639-007 Final Lab Analysis Completion Date: 02/01/2024

Name/Affiliation of Person who Filled out Form Martin Mengel / Talen Energy Supply, LLC

Comments: \_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

I.D. No.	301309
Monitoring Point No.	MW-8-5A
Sample Date	01/20/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**  
**ANALYTES**

**1-Q. Inorganics (Enter all data in mg/l except as noted)**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Ammonia, as N (mg/l)	0.462	SM 4500-NH3 F
Bicarbonate (mg/l)	257	SM 2320
Calcium, total (mg/l)	175	EPA 200.7
Calcium, dissolved (mg/l)	182	EPA 200.7
Chemical Oxygen Demand (mg/l)	5.3 ND	SM 5220 D
Chloride, total as Cl (mg/l)	25.5	EPA 300.0
Fluoride, total as F (mg/l)	0.82	EPA 300.0
Iron, total (µg/l)	20 <	EPA 200.7
Iron, dissolved (µg/l)	29	EPA 200.7
Magnesium, total (mg/l)	38.1	EPA 200.7
Magnesium, dissolved (mg/l)	39.5	EPA 200.7
Manganese, total (µg/l)	416	EPA 200.7
Manganese, dissolved (µg/l)	475	EPA 200.7
Nitrate, as N (mg/l)	0.022 ND	EPA 300.0
pH, field (su)	7.38	SM 4500-H+B
pH, lab (su)	7.37 H	SM 4500-H+B
Potassium, total (mg/l)	4.5	EPA 200.7
Potassium, dissolved (mg/l)	4.68	EPA 200.7
Sodium, total (mg/l)	12.5	EPA 200.7
Sodium, dissolved (mg/l)	13.8	EPA 200.7
Specific Conductance, field (umhos/cm)	1,125	EPA 120.1, FIELD
Specific Conductance, lab (umhos/cm)	1,110	SM 2510 B
Sulfate, as SO4 (mg/l)	266	EPA 300.0
Alkalinity, total as CaCO3 (mg/l)	257	SM 2320 B
Total Dissolved Solids (mg/l)	761	SM 2540 C
Total Organic Carbon (mg/l)	0.5 <	SM 5310 C
Turbidity, field (n.t.u.)	0.36	Field Meter
Dissolved O2, field (mg/l)	0.85	Field Meter
Redox, field (mv)	111.9	Field Meter
Temperature, field (°c)	10.81	Field Meter
Acidity, total as CaCO3 (mg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-5A
Sample Date	01/20/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**

**1-A. Organics (Enter all data in ug/l)**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Benzene (µg/l)		
1,2-Dibromoethane (µg/l)		
1,1-Dichloroethane (µg/l)		
1,1-Dichloroethene (µg/l)		
1,2-Dichloroethane (µg/l)		
cis-1,2-Dichloroethene (µg/l)		
trans-1,2-Dichloroethene (µg/l)		
Ethylbenzene (µg/l)		
Methylene Chloride (µg/l)		
Tetrachloroethene (µg/l)		
Toluene (µg/l)		
1,1,1-Trichloroethane (µg/l)		
Trichloroethene (µg/l)		
Vinyl chloride (µg/l)		
Xylenes (µg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-5A
Sample Date	01/20/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Arsenic, total (µg/l)	119	EPA 200.8
Arsenic, dissolved (µg/l)	122	EPA 200.8
Barium, total (µg/l)	40.1	EPA 200.8
Barium, dissolved (µg/l)	41.6	EPA 200.8
Cadmium, total (µg/l)	1 <	EPA 200.8
Cadmium, dissolved (µg/l)	0.15 ND	EPA 200.8
Chromium, total (µg/l)	0.41 ND	EPA 200.8
Chromium, dissolved (µg/l)	0.41 ND	EPA 200.8
Copper, total (µg/l)	3.5	EPA 200.8
Copper, dissolved (µg/l)	1.87	EPA 200.8
Lead, total (µg/l)	1 <	EPA 200.8
Lead, dissolved (µg/l)	1 <	EPA 200.8
Mercury, total (µg/l)	0.72 ND	EPA 200.8
Mercury, dissolved (µg/l)	0.72 ND	EPA 200.8
Selenium, total (µg/l)	0.63 ND	EPA 200.8
Selenium, dissolved (µg/l)	0.63 ND	EPA 200.8
Silver, total (µg/l)	0.13 ND	EPA 200.8
Silver, dissolved (µg/l)	0.13 ND	EPA 200.8
Zinc, total (µg/l)	51.9	EPA 200.8
Zinc, dissolved (µg/l)	51.9	EPA 200.8
Boron, total (µg/l)	925	EPA 200.7
Boron, dissolved (µg/l)	972	EPA 200.7
Lithium, total (µg/l)	179	EPA 200.8
Lithium, dissolved (µg/l)	186	EPA 200.8
Molybdenum, total (µg/l)	359	EPA 200.8
Molybdenum, dissolved (µg/l)	378	EPA 200.8
Strontium, total (µg/l)	797	EPA 200.7
Strontium, dissolved (µg/l)	831	EPA 200.7

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-5A
Sample Date	01/20/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Aluminum, total (µg/l)	100 <	EPA 200.7
Aluminum, dissolved (µg/l)	100 <	EPA 200.7
Antimony, total (µg/l)	0.3 ND	EPA 200.8
Antimony, dissolved (µg/l)	0.3 ND	EPA 200.8
Beryllium, total (µg/l)	0.19 ND	EPA 200.8
Beryllium, dissolved (µg/l)	0.19 ND	EPA 200.8
Cobalt, total (µg/l)		
Cobalt, dissolved (µg/l)		
Gallium, total (µg/l)		
Gallium, dissolved (µg/l)		
Germanium, total (µg/l)		
Germanium, dissolved (µg/l)		
Nickel, total (µg/l)	1 <	EPA 200.8
Nickel, dissolved (µg/l)	1 <	EPA 200.8
Rubidium, total (µg/l)		
Rubidium, dissolved (µg/l)		
Titanium, total (µg/l)	0.7 ND	EPA 200.8
Titanium, dissolved (µg/l)	0.7 ND	EPA 200.8
Vanadium, total (µg/l)	5 <	EPA 200.8
Vanadium, dissolved (µg/l)	5 <	EPA 200.8
Yttrium, total (µg/l)		
Yttrium, dissolved (µg/l)		

T Please indicate detection limit if analyte is not detected.



I.D. No.	301309
Monitoring Point No.	MW-8-5B
Sample Date	01/20/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**  
**ANALYTES**

**1-Q. Inorganics (Enter all data in mg/l except as noted)**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Ammonia, as N (mg/l)	0.317	SM 4500-NH3 F
Bicarbonate (mg/l)	239	SM 2320
Calcium, total (mg/l)	159	EPA 200.7
Calcium, dissolved (mg/l)	162	EPA 200.7
Chemical Oxygen Demand (mg/l)	5.3 ND	SM 5220 D
Chloride, total as Cl (mg/l)	20.7	EPA 300.0
Fluoride, total as F (mg/l)	0.72	EPA 300.0
Iron, total (µg/l)	26	EPA 200.7
Iron, dissolved (µg/l)	20 <	EPA 200.7
Magnesium, total (mg/l)	31.6	EPA 200.7
Magnesium, dissolved (mg/l)	32.5	EPA 200.7
Manganese, total (µg/l)	392	EPA 200.7
Manganese, dissolved (µg/l)	402	EPA 200.7
Nitrate, as N (mg/l)	0.022 ND	EPA 300.0
pH, field (su)	7.28	SM 4500-H+B
pH, lab (su)	7.45 H	SM 4500-H+B
Potassium, total (mg/l)	4.35	EPA 200.7
Potassium, dissolved (mg/l)	4.41	EPA 200.7
Sodium, total (mg/l)	11.1	EPA 200.7
Sodium, dissolved (mg/l)	11	EPA 200.7
Specific Conductance, field (umhos/cm)	1,001	EPA 120.1, FIELD
Specific Conductance, lab (umhos/cm)	985	SM 2510 B
Sulfate, as SO4 (mg/l)	260	EPA 300.0
Alkalinity, total as CaCO3 (mg/l)	239	SM 2320 B
Total Dissolved Solids (mg/l)	665	SM 2540 C
Total Organic Carbon (mg/l)	0.5 <	SM 5310 C
Turbidity, field (n.t.u.)	0.83	Field Meter
Dissolved O2, field (mg/l)	0.44	Field Meter
Redox, field (mv)	116.4	Field Meter
Temperature, field (°c)	10.75	Field Meter
Acidity, total as CaCO3 (mg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-5B
Sample Date	01/20/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**

**1-A. Organics (Enter all data in ug/l)**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Benzene (µg/l)		
1,2-Dibromoethane (µg/l)		
1,1-Dichloroethane (µg/l)		
1,1-Dichloroethene (µg/l)		
1,2-Dichloroethane (µg/l)		
cis-1,2-Dichloroethene (µg/l)		
trans-1,2-Dichloroethene (µg/l)		
Ethylbenzene (µg/l)		
Methylene Chloride (µg/l)		
Tetrachloroethene (µg/l)		
Toluene (µg/l)		
1,1,1-Trichloroethane (µg/l)		
Trichloroethene (µg/l)		
Vinyl chloride (µg/l)		
Xylenes (µg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-5B
Sample Date	01/20/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Arsenic, total (µg/l)	214	EPA 200.8
Arsenic, dissolved (µg/l)	239	EPA 200.8
Barium, total (µg/l)	58	EPA 200.8
Barium, dissolved (µg/l)	59.9	EPA 200.8
Cadmium, total (µg/l)	1 <	EPA 200.8
Cadmium, dissolved (µg/l)	1 <	EPA 200.8
Chromium, total (µg/l)	0.41 ND	EPA 200.8
Chromium, dissolved (µg/l)	0.41 ND	EPA 200.8
Copper, total (µg/l)	2.53	EPA 200.8
Copper, dissolved (µg/l)	2.47	EPA 200.8
Lead, total (µg/l)	1 <	EPA 200.8
Lead, dissolved (µg/l)	1 <	EPA 200.8
Mercury, total (µg/l)	0.72 ND	EPA 200.8
Mercury, dissolved (µg/l)	0.72 ND	EPA 200.8
Selenium, total (µg/l)	0.63 ND	EPA 200.8
Selenium, dissolved (µg/l)	0.63 ND	EPA 200.8
Silver, total (µg/l)	0.13 ND	EPA 200.8
Silver, dissolved (µg/l)	0.13 ND	EPA 200.8
Zinc, total (µg/l)	43.4	EPA 200.8
Zinc, dissolved (µg/l)	43.7	EPA 200.8
Boron, total (µg/l)	860	EPA 200.7
Boron, dissolved (µg/l)	904	EPA 200.7
Lithium, total (µg/l)	143	EPA 200.8
Lithium, dissolved (µg/l)	151	EPA 200.8
Molybdenum, total (µg/l)	313	EPA 200.8
Molybdenum, dissolved (µg/l)	342	EPA 200.8
Strontium, total (µg/l)	880	EPA 200.7
Strontium, dissolved (µg/l)	873	EPA 200.7

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-5B
Sample Date	01/20/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Aluminum, total (µg/l)	100 <	EPA 200.7
Aluminum, dissolved (µg/l)	100 <	EPA 200.7
Antimony, total (µg/l)	0.3 ND	EPA 200.8
Antimony, dissolved (µg/l)	0.3 ND	EPA 200.8
Beryllium, total (µg/l)	0.19 ND	EPA 200.8
Beryllium, dissolved (µg/l)	0.19 ND	EPA 200.8
Cobalt, total (µg/l)		
Cobalt, dissolved (µg/l)		
Gallium, total (µg/l)		
Gallium, dissolved (µg/l)		
Germanium, total (µg/l)		
Germanium, dissolved (µg/l)		
Nickel, total (µg/l)	1 <	EPA 200.8
Nickel, dissolved (µg/l)	1 <	EPA 200.8
Rubidium, total (µg/l)		
Rubidium, dissolved (µg/l)		
Titanium, total (µg/l)	0.7 ND	EPA 200.8
Titanium, dissolved (µg/l)	0.7 ND	EPA 200.8
Vanadium, total (µg/l)	5 <	EPA 200.8
Vanadium, dissolved (µg/l)	5 <	EPA 200.8
Yttrium, total (µg/l)		
Yttrium, dissolved (µg/l)		

T Please indicate detection limit if analyte is not detected.



Date Prepared/Revised 03/05/2024
DEP USE ONLY
Date Received

**FORM 14R**  
**RESIDUAL WASTE LANDFILLS**  
**AND DISPOSAL IMPOUNDMENTS**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**

This form must be fully and accurately completed. All required information must be typed or legibly printed in the spaces provided. If additional space is necessary, identify each attached sheet as Form 14R, reference the item number and identify the date prepared. The "date prepared/revised" on any attached sheets needs to match the "date prepared/revised" on this page.

General References: Section 288.254, 289.264

**SECTION A. SITE IDENTIFIER**

Applicant/permittee: Brunner Island, LLC - Basin No. 5

Site Name: Basin No. 5

Facility ID (as issued by DEP): 301337

**SECTION B. FACILITY INFORMATION**

Monitoring wells must be designed and constructed in accordance with Department standards. **INDICATE THE LATITUDE AND LONGITUDE TO THE NEAREST ONE TENTH OF A SECOND (DD° MM' SS.S")**.

Monitoring Point Number: MW-8-8A       Well     Spring     Stream     Other

Upgradient/Upstream     Downgradient/Downstream

Location: County York      Municipality: East Manchester Township

Sampling Point: Latitude: 40° 5' 15.96"      Longitude: 76° 41' 30.54"

Depth to Water Level: 24.55 ft.      Measured from:  Land Surface     TOC

Casing Stick Up: 2.11 ft.      Elevation of Water Level: 259.65 ft./MSL

Sampling Depth: 46.00 ft.      Volume of Water Column: \_\_\_\_\_ gal.

Total Well Depth: 52.60 ft.      Sampling Method:  Pumped     Bailed     Grab

Well Purged:  Yes     No      Well Volumes Purged: 3.2 L

Sample Field Filtered (must be 0.45 micron)?  Yes     No

Spring Flow Rate: \_\_\_\_\_ GPM

Sample Date (mm/dd/yy): 01/22/2024      Sample Collection Time: 10:39AM

Sample Collector's Name: AF

Sample Collector's Affiliation: Talen Generation, LLC

Laboratory(ies) Performing Analysis: Hawk Mtn Labs, Inc.

Were any holding times exceeded?  Yes     No. If yes, please explain in comments field.

Lab Certification Number(s): 40-417

Lab Sample Number(s): 240101639-009      Final Lab Analysis Completion Date: 01/30/2024

Name/Affiliation of Person who Filled out Form Martin Mengel / Talen Energy Supply, LLC

Comments: \_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

I.D. No.	301309
Monitoring Point No.	MW-8-8A
Sample Date	01/22/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**  
**ANALYTES**

**1-Q. Inorganics (Enter all data in mg/l except as noted)**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Ammonia, as N (mg/l)	0.487	SM 4500-NH3 F
Bicarbonate (mg/l)	233	SM 2320
Calcium, total (mg/l)		
Calcium, dissolved (mg/l)		
Chemical Oxygen Demand (mg/l)	20 <	SM 5220 D
Chloride, total as Cl (mg/l)	242	EPA 300.0
Fluoride, total as F (mg/l)	0.62	EPA 300.0
Iron, total (µg/l)		
Iron, dissolved (µg/l)		
Magnesium, total (mg/l)		
Magnesium, dissolved (mg/l)		
Manganese, total (µg/l)	1,100	EPA 200.7
Manganese, dissolved (µg/l)	1,080	EPA 200.7
Nitrate, as N (mg/l)	0.022 ND	EPA 300.0
pH, field (su)	7.15	SM 4500-H+B
pH, lab (su)	7.44 H	SM 4500-H+B
Potassium, total (mg/l)		
Potassium, dissolved (mg/l)		
Sodium, total (mg/l)		
Sodium, dissolved (mg/l)		
Specific Conductance, field (umhos/cm)	1,662	EPA 120.1, FIELD
Specific Conductance, lab (umhos/cm)	1,620	SM 2510 B
Sulfate, as SO4 (mg/l)	204	EPA 300.0
Alkalinity, total as CaCO3 (mg/l)	233	SM 2320 B
Total Dissolved Solids (mg/l)	1,000	SM 2540 C
Total Organic Carbon (mg/l)	0.5 <	SM 5310 C
Turbidity, field (n.t.u.)	0.84	Field Meter
Dissolved O2, field (mg/l)	0.29	Field Meter
Redox, field (mv)	74.4	Field Meter
Temperature, field (°c)	10.26	Field Meter
Acidity, total as CaCO3 (mg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-8A
Sample Date	01/22/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**

**1-A. Organics (Enter all data in ug/l)**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Benzene (µg/l)		
1,2-Dibromoethane (µg/l)		
1,1-Dichloroethane (µg/l)		
1,1-Dichloroethene (µg/l)		
1,2-Dichloroethane (µg/l)		
cis-1,2-Dichloroethene (µg/l)		
trans-1,2-Dichloroethene (µg/l)		
Ethylbenzene (µg/l)		
Methylene Chloride (µg/l)		
Tetrachloroethene (µg/l)		
Toluene (µg/l)		
1,1,1-Trichloroethane (µg/l)		
Trichloroethene (µg/l)		
Vinyl chloride (µg/l)		
Xylenes (µg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-8A
Sample Date	01/22/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Arsenic, total (µg/l)	593	EPA 200.8
Arsenic, dissolved (µg/l)	615	EPA 200.8
Barium, total (µg/l)		
Barium, dissolved (µg/l)		
Cadmium, total (µg/l)		
Cadmium, dissolved (µg/l)		
Chromium, total (µg/l)		
Chromium, dissolved (µg/l)		
Copper, total (µg/l)		
Copper, dissolved (µg/l)		
Lead, total (µg/l)		
Lead, dissolved (µg/l)		
Mercury, total (µg/l)		
Mercury, dissolved (µg/l)		
Selenium, total (µg/l)		
Selenium, dissolved (µg/l)		
Silver, total (µg/l)		
Silver, dissolved (µg/l)		
Zinc, total (µg/l)		
Zinc, dissolved (µg/l)		
Boron, total (µg/l)		
Boron, dissolved (µg/l)		
Lithium, total (µg/l)	223	EPA 200.8
Lithium, dissolved (µg/l)	226	EPA 200.8
Molybdenum, total (µg/l)	332	EPA 200.8
Molybdenum, dissolved (µg/l)	336	EPA 200.8
Strontium, total (µg/l)		
Strontium, dissolved (µg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-8A
Sample Date	01/22/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Aluminum, total (µg/l)		
Aluminum, dissolved (µg/l)		
Antimony, total (µg/l)		
Antimony, dissolved (µg/l)		
Beryllium, total (µg/l)		
Beryllium, dissolved (µg/l)		
Cobalt, total (µg/l)		
Cobalt, dissolved (µg/l)		
Gallium, total (µg/l)		
Gallium, dissolved (µg/l)		
Germanium, total (µg/l)		
Germanium, dissolved (µg/l)		
Nickel, total (µg/l)		
Nickel, dissolved (µg/l)		
Rubidium, total (µg/l)		
Rubidium, dissolved (µg/l)		
Titanium, total (µg/l)		
Titanium, dissolved (µg/l)		
Vanadium, total (µg/l)		
Vanadium, dissolved (µg/l)		
Yttrium, total (µg/l)		
Yttrium, dissolved (µg/l)		

T Please indicate detection limit if analyte is not detected.



Date Prepared/Revised 03/05/2024
DEP USE ONLY
Date Received

**FORM 14R  
RESIDUAL WASTE LANDFILLS  
AND DISPOSAL IMPOUNDMENTS  
QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**

This form must be fully and accurately completed. All required information must be typed or legibly printed in the spaces provided. If additional space is necessary, identify each attached sheet as Form 14R, reference the item number and identify the date prepared. The "date prepared/revised" on any attached sheets needs to match the "date prepared/revised" on this page.

General References: Section 288.254, 289.264

**SECTION A. SITE IDENTIFIER**

Applicant/permittee: Brunner Island, LLC - Basin No. 5  
 Site Name: Basin No. 5  
 Facility ID (as issued by DEP): 301337

**SECTION B. FACILITY INFORMATION**

Monitoring wells must be designed and constructed in accordance with Department standards. **INDICATE THE LATITUDE AND LONGITUDE TO THE NEAREST ONE TENTH OF A SECOND (DD° MM' SS.S").**

Monitoring Point Number: MW-8-8B  Well  Spring  Stream  Other  
 Upgradient/Upstream  Downgradient/Downstream  
 Location: County York Municipality: East Manchester Township  
 Sampling Point: Latitude: 40° 5' 15.87" Longitude: 76° 41' 30.60"  
 Depth to Water Level: 23.99 ft. Measured from:  Land Surface  TOC  
 Casing Stick Up: 2.02 ft. Elevation of Water Level: 259.65 ft./MSL  
 Sampling Depth: 54.00 ft. Volume of Water Column: \_\_\_\_\_ gal.  
 Total Well Depth: 60.60 ft. Sampling Method:  Pumped  Bailed  Grab  
 Well Purged:  Yes  No Well Volumes Purged: 3.3 L  
 Sample Field Filtered (must be 0.45 micron)?  Yes  No  
 Spring Flow Rate: \_\_\_\_\_ GPM  
 Sample Date (mm/dd/yy): 01/22/2024 Sample Collection Time: 11:55AM  
 Sample Collector's Name: AF  
 Sample Collector's Affiliation: Talen Generation, LLC  
 Laboratory(ies) Performing Analysis: Hawk Mtn Labs, Inc.  
 Were any holding times exceeded?  Yes  No. If yes, please explain in comments field.  
 Lab Certification Number(s): 40-417  
 Lab Sample Number(s): 240101639-010 Final Lab Analysis Completion Date: 01/30/2024  
 Name/Affiliation of Person who Filled out Form Martin Mengel / Talen Energy Supply, LLC

Comments: \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_

I.D. No.	301309
Monitoring Point No.	MW-8-8B
Sample Date	01/22/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**  
**ANALYTES**

**1-Q. Inorganics (Enter all data in mg/l except as noted)**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Ammonia, as N (mg/l)	0.066 ND	SM 4500-NH3 F
Bicarbonate (mg/l)	217	SM 2320
Calcium, total (mg/l)		
Calcium, dissolved (mg/l)		
Chemical Oxygen Demand (mg/l)	20 <	SM 5220 D
Chloride, total as Cl (mg/l)	138	EPA 300.0
Fluoride, total as F (mg/l)	0.72	EPA 300.0
Iron, total (µg/l)		
Iron, dissolved (µg/l)		
Magnesium, total (mg/l)		
Magnesium, dissolved (mg/l)		
Manganese, total (µg/l)	5.31 ND	EPA 200.7
Manganese, dissolved (µg/l)	5.31 ND	EPA 200.7
Nitrate, as N (mg/l)	0.8	EPA 300.0
pH, field (su)	7.49	SM 4500-H+B
pH, lab (su)	7.68 H	SM 4500-H+B
Potassium, total (mg/l)		
Potassium, dissolved (mg/l)		
Sodium, total (mg/l)		
Sodium, dissolved (mg/l)		
Specific Conductance, field (umhos/cm)	1,433	EPA 120.1, FIELD
Specific Conductance, lab (umhos/cm)	1,390	SM 2510 B
Sulfate, as SO4 (mg/l)	299	EPA 300.0
Alkalinity, total as CaCO3 (mg/l)	217	SM 2320 B
Total Dissolved Solids (mg/l)	950	SM 2540 C
Total Organic Carbon (mg/l)	0.5 <	SM 5310 C
Turbidity, field (n.t.u.)	0.35	Field Meter
Dissolved O2, field (mg/l)	1.5	Field Meter
Redox, field (mv)	105.6	Field Meter
Temperature, field (°c)	10.84	Field Meter
Acidity, total as CaCO3 (mg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-8B
Sample Date	01/22/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**

**1-A. Organics (Enter all data in ug/l)**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Benzene (µg/l)		
1,2-Dibromoethane (µg/l)		
1,1-Dichloroethane (µg/l)		
1,1-Dichloroethene (µg/l)		
1,2-Dichloroethane (µg/l)		
cis-1,2-Dichloroethene (µg/l)		
trans-1,2-Dichloroethene (µg/l)		
Ethylbenzene (µg/l)		
Methylene Chloride (µg/l)		
Tetrachloroethene (µg/l)		
Toluene (µg/l)		
1,1,1-Trichloroethane (µg/l)		
Trichloroethene (µg/l)		
Vinyl chloride (µg/l)		
Xylenes (µg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-8B
Sample Date	01/22/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Arsenic, total (µg/l)	380	EPA 200.8
Arsenic, dissolved (µg/l)	420	EPA 200.8
Barium, total (µg/l)		
Barium, dissolved (µg/l)		
Cadmium, total (µg/l)		
Cadmium, dissolved (µg/l)		
Chromium, total (µg/l)		
Chromium, dissolved (µg/l)		
Copper, total (µg/l)		
Copper, dissolved (µg/l)		
Lead, total (µg/l)		
Lead, dissolved (µg/l)		
Mercury, total (µg/l)		
Mercury, dissolved (µg/l)		
Selenium, total (µg/l)		
Selenium, dissolved (µg/l)		
Silver, total (µg/l)		
Silver, dissolved (µg/l)		
Zinc, total (µg/l)		
Zinc, dissolved (µg/l)		
Boron, total (µg/l)		
Boron, dissolved (µg/l)		
Lithium, total (µg/l)	240	EPA 200.8
Lithium, dissolved (µg/l)	240	EPA 200.8
Molybdenum, total (µg/l)	307	EPA 200.8
Molybdenum, dissolved (µg/l)	306	EPA 200.8
Strontium, total (µg/l)		
Strontium, dissolved (µg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-8B
Sample Date	01/22/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Aluminum, total (µg/l)		
Aluminum, dissolved (µg/l)		
Antimony, total (µg/l)		
Antimony, dissolved (µg/l)		
Beryllium, total (µg/l)		
Beryllium, dissolved (µg/l)		
Cobalt, total (µg/l)		
Cobalt, dissolved (µg/l)		
Gallium, total (µg/l)		
Gallium, dissolved (µg/l)		
Germanium, total (µg/l)		
Germanium, dissolved (µg/l)		
Nickel, total (µg/l)		
Nickel, dissolved (µg/l)		
Rubidium, total (µg/l)		
Rubidium, dissolved (µg/l)		
Titanium, total (µg/l)		
Titanium, dissolved (µg/l)		
Vanadium, total (µg/l)		
Vanadium, dissolved (µg/l)		
Yttrium, total (µg/l)		
Yttrium, dissolved (µg/l)		

T Please indicate detection limit if analyte is not detected.



Date Prepared/Revised 03/05/2024
DEP USE ONLY
Date Received

**FORM 14R**  
**RESIDUAL WASTE LANDFILLS**  
**AND DISPOSAL IMPOUNDMENTS**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**

This form must be fully and accurately completed. All required information must be typed or legibly printed in the spaces provided. If additional space is necessary, identify each attached sheet as Form 14R, reference the item number and identify the date prepared. The "date prepared/revised" on any attached sheets needs to match the "date prepared/revised" on this page.

General References: Section 288.254, 289.264

**SECTION A. SITE IDENTIFIER**

Applicant/permittee: Brunner Island, LLC - Basin No. 5

Site Name: Basin No. 5

Facility ID (as issued by DEP): 301337

**SECTION B. FACILITY INFORMATION**

Monitoring wells must be designed and constructed in accordance with Department standards. **INDICATE THE LATITUDE AND LONGITUDE TO THE NEAREST ONE TENTH OF A SECOND (DD° MM' SS.S")**.

Monitoring Point Number: MW-8-9B  Well  Spring  Stream  Other

Upgradient/Upstream  Downgradient/Downstream

Location: County York Municipality: East Manchester Township

Sampling Point: Latitude: 40° 5' 14.68" Longitude: 76° 41' 30.61"

Depth to Water Level: 23.36 ft. Measured from:  Land Surface  TOC

Casing Stick Up: 1.82 ft. Elevation of Water Level: 260.98 ft./MSL

Sampling Depth: 64.00 ft. Volume of Water Column: \_\_\_\_\_ gal.

Total Well Depth: 68.25 ft. Sampling Method:  Pumped  Bailed  Grab

Well Purged:  Yes  No Well Volumes Purged: 3.5 L

Sample Field Filtered (must be 0.45 micron)?  Yes  No

Spring Flow Rate: \_\_\_\_\_ GPM

Sample Date (mm/dd/yy): 01/22/2024 Sample Collection Time: 8:46AM

Sample Collector's Name: AF

Sample Collector's Affiliation: Talen Generation, LLC

Laboratory(ies) Performing Analysis: Hawk Mtn Labs, Inc.

Were any holding times exceeded?  Yes  No. If yes, please explain in comments field.

Lab Certification Number(s): 40-417

Lab Sample Number(s): 240101639-011 Final Lab Analysis Completion Date: 01/30/2024

Name/Affiliation of Person who Filled out Form Martin Mengel / Talen Energy Supply, LLC

Comments: \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

I.D. No.	301309
Monitoring Point No.	MW-8-9B
Sample Date	01/22/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**  
**ANALYTES**

**1-Q. Inorganics (Enter all data in mg/l except as noted)**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Ammonia, as N (mg/l)	0.344	SM 4500-NH3 F
Bicarbonate (mg/l)	295	SM 2320
Calcium, total (mg/l)		
Calcium, dissolved (mg/l)		
Chemical Oxygen Demand (mg/l)	20 <	SM 5220 D
Chloride, total as Cl (mg/l)	110	EPA 300.0
Fluoride, total as F (mg/l)	0.35	EPA 300.0
Iron, total (µg/l)		
Iron, dissolved (µg/l)		
Magnesium, total (mg/l)		
Magnesium, dissolved (mg/l)		
Manganese, total (µg/l)	1,410	EPA 200.7
Manganese, dissolved (µg/l)	1,320	EPA 200.7
Nitrate, as N (mg/l)	0.022 ND	EPA 300.0
pH, field (su)	6.81	SM 4500-H+B
pH, lab (su)	7.4 H	SM 4500-H+B
Potassium, total (mg/l)		
Potassium, dissolved (mg/l)		
Sodium, total (mg/l)		
Sodium, dissolved (mg/l)		
Specific Conductance, field (umhos/cm)	1,501	EPA 120.1, FIELD
Specific Conductance, lab (umhos/cm)	1,480	SM 2510 B
Sulfate, as SO4 (mg/l)	314	EPA 300.0
Alkalinity, total as CaCO3 (mg/l)	295	SM 2320 B
Total Dissolved Solids (mg/l)	951	SM 2540 C
Total Organic Carbon (mg/l)	0.5 <	SM 5310 C
Turbidity, field (n.t.u.)	0.29	Field Meter
Dissolved O2, field (mg/l)	0.78	Field Meter
Redox, field (mv)	-26.4	Field Meter
Temperature, field (°c)	7.76	Field Meter
Acidity, total as CaCO3 (mg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-9B
Sample Date	01/22/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**

**1-A. Organics (Enter all data in ug/l)**

<b>ANALYTE</b>	<b>VALUE (T)</b>	<b>ANALYSIS METHOD NUMBER</b>
Benzene (µg/l)		
1,2-Dibromoethane (µg/l)		
1,1-Dichloroethane (µg/l)		
1,1-Dichloroethene (µg/l)		
1,2-Dichloroethane (µg/l)		
cis-1,2-Dichloroethene (µg/l)		
trans-1,2-Dichloroethene (µg/l)		
Ethylbenzene (µg/l)		
Methylene Chloride (µg/l)		
Tetrachloroethene (µg/l)		
Toluene (µg/l)		
1,1,1-Trichloroethane (µg/l)		
Trichloroethene (µg/l)		
Vinyl chloride (µg/l)		
Xylenes (µg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-9B
Sample Date	01/22/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Arsenic, total (µg/l)	776	EPA 200.8
Arsenic, dissolved (µg/l)	718	EPA 200.8
Barium, total (µg/l)		
Barium, dissolved (µg/l)		
Cadmium, total (µg/l)		
Cadmium, dissolved (µg/l)		
Chromium, total (µg/l)		
Chromium, dissolved (µg/l)		
Copper, total (µg/l)		
Copper, dissolved (µg/l)		
Lead, total (µg/l)		
Lead, dissolved (µg/l)		
Mercury, total (µg/l)		
Mercury, dissolved (µg/l)		
Selenium, total (µg/l)		
Selenium, dissolved (µg/l)		
Silver, total (µg/l)		
Silver, dissolved (µg/l)		
Zinc, total (µg/l)		
Zinc, dissolved (µg/l)		
Boron, total (µg/l)		
Boron, dissolved (µg/l)		
Lithium, total (µg/l)	198	EPA 200.8
Lithium, dissolved (µg/l)	177	EPA 200.8
Molybdenum, total (µg/l)	232	EPA 200.8
Molybdenum, dissolved (µg/l)	219	EPA 200.8
Strontium, total (µg/l)		
Strontium, dissolved (µg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-9B
Sample Date	01/22/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Aluminum, total (µg/l)		
Aluminum, dissolved (µg/l)		
Antimony, total (µg/l)		
Antimony, dissolved (µg/l)		
Beryllium, total (µg/l)		
Beryllium, dissolved (µg/l)		
Cobalt, total (µg/l)		
Cobalt, dissolved (µg/l)		
Gallium, total (µg/l)		
Gallium, dissolved (µg/l)		
Germanium, total (µg/l)		
Germanium, dissolved (µg/l)		
Nickel, total (µg/l)		
Nickel, dissolved (µg/l)		
Rubidium, total (µg/l)		
Rubidium, dissolved (µg/l)		
Titanium, total (µg/l)		
Titanium, dissolved (µg/l)		
Vanadium, total (µg/l)		
Vanadium, dissolved (µg/l)		
Yttrium, total (µg/l)		
Yttrium, dissolved (µg/l)		

T Please indicate detection limit if analyte is not detected.



Date Prepared/Revised 03/05/2024
DEP USE ONLY
Date Received

**FORM 14R**  
**RESIDUAL WASTE LANDFILLS**  
**AND DISPOSAL IMPOUNDMENTS**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**

This form must be fully and accurately completed. All required information must be typed or legibly printed in the spaces provided. If additional space is necessary, identify each attached sheet as Form 14R, reference the item number and identify the date prepared. The "date prepared/revised" on any attached sheets needs to match the "date prepared/revised" on this page.

General References: Section 288.254, 289.264

**SECTION A. SITE IDENTIFIER**

Applicant/permittee: Brunner Island, LLC - Basin No. 5

Site Name: Basin No. 5

Facility ID (as issued by DEP): 301337

**SECTION B. FACILITY INFORMATION**

Monitoring wells must be designed and constructed in accordance with Department standards. **INDICATE THE LATITUDE AND LONGITUDE TO THE NEAREST ONE TENTH OF A SECOND (DD° MM' SS.S")**.

Monitoring Point Number: MW-8-9C       Well     Spring     Stream     Other  
 Upgradient/Upstream     Downgradient/Downstream

Location: County York      Municipality: East Manchester Township

Sampling Point: Latitude: 40° 5' 14.60"      Longitude: 76° 41' 30.60"

Depth to Water Level: 22.8 ft.      Measured from:  Land Surface     TOC

Casing Stick Up: 1.69 ft.      Elevation of Water Level: 261.88 ft./MSL

Sampling Depth: 85.00 ft.      Volume of Water Column: \_\_\_\_\_ gal.

Total Well Depth: 88.10 ft.      Sampling Method:  Pumped     Bailed     Grab

Well Purged:  Yes     No      Well Volumes Purged: 3.15 L

Sample Field Filtered (must be 0.45 micron)?  Yes     No

Spring Flow Rate: \_\_\_\_\_ GPM

Sample Date (mm/dd/yy): 01/22/2024      Sample Collection Time: 1:45PM

Sample Collector's Name: AMC

Sample Collector's Affiliation: Talen Generation, LLC

Laboratory(ies) Performing Analysis: Hawk Mtn Labs, Inc.

Were any holding times exceeded?  Yes     No. If yes, please explain in comments field.

Lab Certification Number(s): 40-417

Lab Sample Number(s): 240101639-012      Final Lab Analysis Completion Date: 01/30/2024

Name/Affiliation of Person who Filled out Form Martin Mengel / Talen Energy Supply, LLC

Comments: \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_

I.D. No.	301309
Monitoring Point No.	MW-8-9C
Sample Date	01/22/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**  
**ANALYTES**

**1-Q. Inorganics (Enter all data in mg/l except as noted)**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Ammonia, as N (mg/l)	0.367	SM 4500-NH3 F
Bicarbonate (mg/l)	242	SM 2320
Calcium, total (mg/l)		
Calcium, dissolved (mg/l)		
Chemical Oxygen Demand (mg/l)	5.3 ND	SM 5220 D
Chloride, total as Cl (mg/l)	17.5	EPA 300.0
Fluoride, total as F (mg/l)	1.39	EPA 300.0
Iron, total (µg/l)		
Iron, dissolved (µg/l)		
Magnesium, total (mg/l)		
Magnesium, dissolved (mg/l)		
Manganese, total (µg/l)	878	EPA 200.7
Manganese, dissolved (µg/l)	839	EPA 200.7
Nitrate, as N (mg/l)	0.022 ND	EPA 300.0
pH, field (su)	7.22	SM 4500-H+B
pH, lab (su)	7.42 H	SM 4500-H+B
Potassium, total (mg/l)		
Potassium, dissolved (mg/l)		
Sodium, total (mg/l)		
Sodium, dissolved (mg/l)		
Specific Conductance, field (umhos/cm)	784	EPA 120.1, FIELD
Specific Conductance, lab (umhos/cm)	803	SM 2510 B
Sulfate, as SO4 (mg/l)	146	EPA 300.0
Alkalinity, total as CaCO3 (mg/l)	242	SM 2320 B
Total Dissolved Solids (mg/l)	497	SM 2540 C
Total Organic Carbon (mg/l)	0.5 <	SM 5310 C
Turbidity, field (n.t.u.)	1.07	Field Meter
Dissolved O2, field (mg/l)	1.34	Field Meter
Redox, field (mv)	-62.3	Field Meter
Temperature, field (°c)	10.6	Field Meter
Acidity, total as CaCO3 (mg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-9C
Sample Date	01/22/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**

**1-A. Organics (Enter all data in ug/l)**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Benzene (µg/l)		
1,2-Dibromoethane (µg/l)		
1,1-Dichloroethane (µg/l)		
1,1-Dichloroethene (µg/l)		
1,2-Dichloroethane (µg/l)		
cis-1,2-Dichloroethene (µg/l)		
trans-1,2-Dichloroethene (µg/l)		
Ethylbenzene (µg/l)		
Methylene Chloride (µg/l)		
Tetrachloroethene (µg/l)		
Toluene (µg/l)		
1,1,1-Trichloroethane (µg/l)		
Trichloroethene (µg/l)		
Vinyl chloride (µg/l)		
Xylenes (µg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-9C
Sample Date	01/22/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Arsenic, total (µg/l)	355	EPA 200.8
Arsenic, dissolved (µg/l)	348	EPA 200.8
Barium, total (µg/l)		
Barium, dissolved (µg/l)		
Cadmium, total (µg/l)		
Cadmium, dissolved (µg/l)		
Chromium, total (µg/l)		
Chromium, dissolved (µg/l)		
Copper, total (µg/l)		
Copper, dissolved (µg/l)		
Lead, total (µg/l)		
Lead, dissolved (µg/l)		
Mercury, total (µg/l)		
Mercury, dissolved (µg/l)		
Selenium, total (µg/l)		
Selenium, dissolved (µg/l)		
Silver, total (µg/l)		
Silver, dissolved (µg/l)		
Zinc, total (µg/l)		
Zinc, dissolved (µg/l)		
Boron, total (µg/l)		
Boron, dissolved (µg/l)		
Lithium, total (µg/l)	130	EPA 200.8
Lithium, dissolved (µg/l)	128	EPA 200.8
Molybdenum, total (µg/l)	293	EPA 200.8
Molybdenum, dissolved (µg/l)	275	EPA 200.8
Strontium, total (µg/l)		
Strontium, dissolved (µg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-8-9C
Sample Date	01/22/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Aluminum, total (µg/l)		
Aluminum, dissolved (µg/l)		
Antimony, total (µg/l)		
Antimony, dissolved (µg/l)		
Beryllium, total (µg/l)		
Beryllium, dissolved (µg/l)		
Cobalt, total (µg/l)		
Cobalt, dissolved (µg/l)		
Gallium, total (µg/l)		
Gallium, dissolved (µg/l)		
Germanium, total (µg/l)		
Germanium, dissolved (µg/l)		
Nickel, total (µg/l)		
Nickel, dissolved (µg/l)		
Rubidium, total (µg/l)		
Rubidium, dissolved (µg/l)		
Titanium, total (µg/l)		
Titanium, dissolved (µg/l)		
Vanadium, total (µg/l)		
Vanadium, dissolved (µg/l)		
Yttrium, total (µg/l)		
Yttrium, dissolved (µg/l)		

T Please indicate detection limit if analyte is not detected.



Date Prepared/Revised 03/05/2024
DEP USE ONLY
Date Received

## FORM 14R RESIDUAL WASTE LANDFILLS AND DISPOSAL IMPOUNDMENTS QUARTERLY AND ANNUAL WATER QUALITY ANALYSES

This form must be fully and accurately completed. All required information must be typed or legibly printed in the spaces provided. If additional space is necessary, identify each attached sheet as Form 14R, reference the item number and identify the date prepared. The "date prepared/revised" on any attached sheets needs to match the "date prepared/revised" on this page.

General References: Section 288.254, 289.264

### SECTION A. SITE IDENTIFIER

Applicant/permittee: Brunner Island, LLC - Basin No. 5  
 Site Name: Basin No. 5  
 Facility ID (as issued by DEP): 301337

### SECTION B. FACILITY INFORMATION

Monitoring wells must be designed and constructed in accordance with Department standards. **INDICATE THE LATITUDE AND LONGITUDE TO THE NEAREST ONE TENTH OF A SECOND (DD° MM' SS.S").**

Monitoring Point Number: MW-PT-1  Well  Spring  Stream  Other  
 Upgradient/Upstream  Downgradient/Downstream  
 Location: County York Municipality: East Manchester Township  
 Sampling Point: Latitude: 40° 55' 26.53" Longitude: 76° 40' 28.05"  
 Depth to Water Level: 12.72 ft. Measured from:  Land Surface  TOC  
 Casing Stick Up: 2.04 ft. Elevation of Water Level: 259.046 ft./MSL  
 Sampling Depth: 19.00 ft. Volume of Water Column: \_\_\_\_\_ gal.  
 Total Well Depth: \_\_\_\_\_ ft. Sampling Method:  Pumped  Bailed  Grab  
 Well Purged:  Yes  No Well Volumes Purged: 3 L  
 Sample Field Filtered (must be 0.45 micron)?  Yes  No  
 Spring Flow Rate: \_\_\_\_\_ GPM  
 Sample Date (mm/dd/yy): 01/23/2024 Sample Collection Time: 1:37PM  
 Sample Collector's Name: JO  
 Sample Collector's Affiliation: Talen Generation, LLC  
 Laboratory(ies) Performing Analysis: Hawk Mtn Labs, Inc.  
 Were any holding times exceeded?  Yes  No. If yes, please explain in comments field.  
 Lab Certification Number(s): 40-417  
 Lab Sample Number(s): 240101640-001 Final Lab Analysis Completion Date: 02/06/2024  
 Name/Affiliation of Person who Filled out Form Martin Mengel / Talen Energy Supply, LLC

Comments: \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_

I.D. No.	301309
Monitoring Point No.	MW-PT-1
Sample Date	01/23/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**  
**ANALYTES**

**1-Q. Inorganics (Enter all data in mg/l except as noted)**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Ammonia, as N (mg/l)	0.066 ND	SM 4500-NH3 F
Bicarbonate (mg/l)	21.2	SM 2320
Calcium, total (mg/l)	101	EPA 200.7
Calcium, dissolved (mg/l)		
Chemical Oxygen Demand (mg/l)	20 <	SM 5220 D
Chloride, total as Cl (mg/l)	3.7	EPA 300.0
Fluoride, total as F (mg/l)	0.27	EPA 300.0
Iron, total (µg/l)	63	EPA 200.7
Iron, dissolved (µg/l)		
Magnesium, total (mg/l)	26.6	EPA 200.7
Magnesium, dissolved (mg/l)		
Manganese, total (µg/l)	1,590	EPA 200.7
Manganese, dissolved (µg/l)		
Nitrate, as N (mg/l)	9.57	EPA 300.0
pH, field (su)	5.07	SM 4500-H+B
pH, lab (su)	5.2 H	SM 4500-H+B
Potassium, total (mg/l)	3.24	EPA 200.7
Potassium, dissolved (mg/l)		
Sodium, total (mg/l)	10.6	EPA 200.7
Sodium, dissolved (mg/l)		
Specific Conductance, field (umhos/cm)	768	EPA 120.1, FIELD
Specific Conductance, lab (umhos/cm)	766	SM 2510 B
Sulfate, as SO4 (mg/l)	332	EPA 300.0
Alkalinity, total as CaCO3 (mg/l)	21.2	SM 2320 B
Total Dissolved Solids (mg/l)	539	SM 2540 C
Total Organic Carbon (mg/l)	1.87	SM 5310 C
Turbidity, field (n.t.u.)	0.96	Field Meter
Dissolved O2, field (mg/l)	3.19	Field Meter
Redox, field (mv)	350	Field Meter
Temperature, field (°c)	12.24	Field Meter
Acidity, total as CaCO3 (mg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-PT-1
Sample Date	01/23/2024

**FORM 14 R**  
**QUARTERLY AND ANNUAL WATER QUALITY ANALYSES**

**1-A. Organics (Enter all data in ug/l)**

<b>ANALYTE</b>	<b>VALUE (T)</b>	<b>ANALYSIS METHOD NUMBER</b>
Benzene (µg/l)		
1,2-Dibromoethane (µg/l)		
1,1-Dichloroethane (µg/l)		
1,1-Dichloroethene (µg/l)		
1,2-Dichloroethane (µg/l)		
cis-1,2-Dichloroethene (µg/l)		
trans-1,2-Dichloroethene (µg/l)		
Ethylbenzene (µg/l)		
Methylene Chloride (µg/l)		
Tetrachloroethene (µg/l)		
Toluene (µg/l)		
1,1,1-Trichloroethane (µg/l)		
Trichloroethene (µg/l)		
Vinyl chloride (µg/l)		
Xylenes (µg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-PT-1
Sample Date	01/23/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Arsenic, total (µg/l)	1 <	EPA 200.8
Arsenic, dissolved (µg/l)		
Barium, total (µg/l)	20	EPA 200.8
Barium, dissolved (µg/l)		
Cadmium, total (µg/l)	1 <	EPA 200.8
Cadmium, dissolved (µg/l)		
Chromium, total (µg/l)	1.18	EPA 200.8
Chromium, dissolved (µg/l)		
Copper, total (µg/l)	2.42	EPA 200.8
Copper, dissolved (µg/l)		
Lead, total (µg/l)	1 <	EPA 200.8
Lead, dissolved (µg/l)		
Mercury, total (µg/l)	0.72 ND	EPA 200.8
Mercury, dissolved (µg/l)		
Selenium, total (µg/l)	0.63 ND	EPA 200.8
Selenium, dissolved (µg/l)		
Silver, total (µg/l)	0.13 ND	EPA 200.8
Silver, dissolved (µg/l)		
Zinc, total (µg/l)	85	EPA 200.8
Zinc, dissolved (µg/l)		
Boron, total (µg/l)	100 <	EPA 200.7
Boron, dissolved (µg/l)		
Lithium, total (µg/l)	19.7	EPA 200.8
Lithium, dissolved (µg/l)		
Molybdenum, total (µg/l)	12.3	EPA 200.8
Molybdenum, dissolved (µg/l)		
Strontium, total (µg/l)	376	EPA 200.7
Strontium, dissolved (µg/l)		

T Please indicate detection limit if analyte is not detected.

I.D. No.	301309
Monitoring Point No.	MW-PT-1
Sample Date	01/23/2024

**FORM 14 R**  
**ANNUAL WATER QUALITY ANALYSES**

**2-A. Metals (Enter all data in ug/l) If initial background analyses of four consecutive analyses show essentially identical (within 5%) dissolved and total analyses, dissolved analyses may not be required, subject to written DEP approval.**

ANALYTE	VALUE (T)	ANALYSIS METHOD NUMBER
Aluminum, total (µg/l)	982	EPA 200.7
Aluminum, dissolved (µg/l)		
Antimony, total (µg/l)	0.3 ND	EPA 200.8
Antimony, dissolved (µg/l)		
Beryllium, total (µg/l)	1.46	EPA 200.8
Beryllium, dissolved (µg/l)		
Cobalt, total (µg/l)		
Cobalt, dissolved (µg/l)		
Gallium, total (µg/l)		
Gallium, dissolved (µg/l)		
Germanium, total (µg/l)		
Germanium, dissolved (µg/l)		
Nickel, total (µg/l)	50.1	EPA 200.8
Nickel, dissolved (µg/l)		
Rubidium, total (µg/l)		
Rubidium, dissolved (µg/l)		
Titanium, total (µg/l)	0.7 ND	EPA 200.8
Titanium, dissolved (µg/l)		
Vanadium, total (µg/l)	0.53 ND	EPA 200.8
Vanadium, dissolved (µg/l)		
Yttrium, total (µg/l)		
Yttrium, dissolved (µg/l)		

T Please indicate detection limit if analyte is not detected.

## Attachment – Statistics Summary

---

### Statistical Analysis

Temporal trends of selected parameters were analyzed using a Theil-Sen estimator, a robust linear regression method. The Theil-Sen estimator is insensitive to outlying spikes in data, making it advantageous over the traditional least squares method of linear regression in identifying significant temporal trends. To comply with proposed RCRA Subtitle D regulations, a nonparametric analysis of variants (ANOVA) of the data is also utilized. The nonparametric ANOVA analysis is a method for comparing medians of two or more groups. In this case, it is utilized to determine if parameter concentrations in downgradient wells are significantly greater than or less than parameter concentrations in the upgradient wells.

An Excel workbook was developed to evaluate historical groundwater monitoring data from Talen sites with the aforementioned statistical tools. This Excel application was used to perform statistical analyses of each site-related groundwater parameter at all monitoring locations for each basin/area of the site. The Excel workbook includes a worksheet containing a summary table of the statistical analyses results for all groundwater parameters and monitoring locations along with other supporting worksheets containing raw data and more detailed statistical information. The most pronounced parameter trends and regulatory exceedances are highlighted on the summary table.

PARAMETER	UNITS	STD.	UPGRADIENT VS DOWNGRAIENT	Up																Down																Up															
				MW-19																MW-4-10																MW-4-7A															
				Trend (%)	p	$\bar{x}$	$\bar{x}$ (%)	n	ND	J	>	Max	$\rho$ (comparison)	Trend (%)	p	$\bar{x}$	$\bar{x}$ (%)	n	ND	J	>	Max	$\rho$ (comparison)	Trend (%)	p	$\bar{x}$	$\bar{x}$ (%)	n	ND	J	>	Max	$\rho$ (comparison)																		
Arsenic, dissolved	µg/l	10	60.93	NC	NC	0.6	5.9	41	32	0	0		1.9	08/26/20	0.00	> Up n	NC	NC	1.4	14.1	41	27	0	1	08/14/18	10.2	08/14/18	0.31	n	NC	NC	0.5	5.0	41	40	0	0		0.6	03/03/14	0.00	< Up n									
Iron, dissolved	mg/l	0.3	60.44	NC	NC	0.0	4.8	41	35	0	0		0.1	06/10/14	0.00	> Up n	NC	NC	0.0	3.9	41	30	0	0		0.1	09/08/14	0.22	n	NC	NC	0.0	2.3	41	37	0	0		0.1	04/18/22	0.00	> Up n									
Manganese, dissolved	µg/l	300	21.55	NC	NC	3.4	1.1	41	41	0	0		20.0	08/16/19	0.00	< Up n	-35.9	↓	0.00	2285.3	761.8	41	0	0	41	01/29/24	7220.0	06/05/14	0.00	> Up n	58.5	↑	0.08	206.8	68.9	41	0	0	7	10/14/22	559.0	11/05/20	0.00	> Up n							
Molybdenum, dissolved	µg/l	40	17.14	NC	NC	0.6	1.5	41	34	0	0		3.9	04/20/22	0.00	< Up n	-51.5	↓	0.02	565.4	1413.4	41	0	0	40	01/29/24	1360.0	02/12/18	0.00	> Up n	25.9	↑	0.03	21.5	53.6	41	0	0		29.9	07/24/21	0.00	> Up n								
Zinc, dissolved	µg/l	2000	8.58	NC	NC	2.8	0.1	41	30	0	0		18.4	08/16/19	0.31	n	-11.3	↓	0.36	71.3	3.6	41	0	0	0		488.0	08/14/18	0.00	> Up n	NC	NC	1.9	0.1	41	36	0	0		11.1	08/21/19	0.18	n								
Nickel, dissolved	µg/l	100	6.18	NC	NC	1.0	1.0	41	36	0	0		5.0	08/16/18	0.00	< Up n	26.1	↑	0.27	36.3	36.3	41	0	0	3	08/14/18	175.0	06/07/16	0.00	> Up n	NC	NC	3.1	3.1	41	24	0	0		17.2	11/11/19	0.30	n								
Aluminum, dissolved	µg/l	200	6.15	NC	NC	28.0	14.0	41	41	0	0		100.0	01/24/24	NC		NC	NC	2140.4	1070.2	41	25	0	10	07/26/23	28800.0	08/14/18	0.00	> Up n	NC	NC	71.4	35.7	41	41	0	0		100.0	01/23/24	NC										
Cadmium, dissolved	µg/l	5	5.16	NC	NC	0.1	1.8	41	41	0	0		0.2	10/13/21	NC		48.1	↑	0.02	1.0	20.2	41	9	0	0		2.4	08/14/18	0.00	> Up n	NC	NC	0.1	2.3	41	41	0	0		0.2	11/05/18	NC									
Potassium, dissolved	mg/l	--	5.14	61.6	↑	0.00	0.8	NA	41	19	0	0		1.0	01/24/24	0.00	< Up n	34.4	↑	0.00	104.3	NA	41	0	0	0		139.0	01/27/22	0.00	> Up n	12.3	↑	0.01	3.9	NA	41	0	0	0		4.9	10/13/23	0.00	> Up n						
Fluoride, total as F	mg/l	2	3.70	NC	NC	0.0	1.8	41	38	0	0		0.2	01/18/23	0.00	< Up n	NC	NC	0.2	8.7	41	32	0	0		1.8	08/14/18	0.00	> Up n	6.8	↔	0.14	0.2	9.0	41	10	0	0		0.3	06/04/14	0.34	n								
Strontium, dissolved	µg/l	4000	2.89	-6.5	↔	0.01	49.8	1.2	41	0	0	0		59.3	03/12/15	0.00	< Up n	76.7	↑	0.00	1254.8	31.4	41	0	0	0		2190.0	08/25/19	0.00	> Up n	18.9	↑	0.00	354.5	8.9	41	0	0	0		430.0	11/05/20	0.00	> Up n						
Chloride, total as Cl	mg/l	250	2.38	11.3	↑	0.00	8.4	3.4	41	0	0	0		9.9	08/26/20	0.00	< Up n	-62.0	↓	0.00	11.4	4.5	41	0	0	0		19.1	01/29/24	0.07	n	-36.2	↓	0.00	16.6	6.6	41	0	0	0		19.9	06/06/17	0.00	> Up n						
Beryllium, dissolved	µg/l	4	1.95	NC	NC	0.1	3.6	41	41	0	0		0.5	06/10/14	NC		NC	NC	0.7	16.8	41	36	0	2	08/14/18	5.4	06/05/14	0.00	> Up n	NC	NC	0.1	3.3	41	41	0	0		0.2	01/23/24	NC										
Lithium, dissolved	µg/l	83	1.56	-25.1	↓	0.00	3.4	4.1	41	0	0	0		4.4	03/12/15	0.00	< Up n	-26.6	↓	0.01	1016.5	1224.7	41	0	0	41	01/29/24	1380.0	03/08/17	0.00	> Up n	251.1	↑	0.00	157.6	189.8	41	0	0	38	01/23/24	330.0	07/21/23	0.00	> Up n						
Ammonia, as N	mg/l	--	1.28	NC	NC	0.0	NA	41	41	0	0		0.2	01/26/22	0.00	< Up n	14.4	↑	0.19	0.3	NA	41	11	0	0		0.9	05/19/20	0.01	> Up n	-0.8	↔	0.34	0.2	NA	41	10	0	0		0.7	06/06/16	0.00	> Up n							
Magnesium, dissolved	mg/l	--	1.24	-12.5	↓	0.00	4.6	NA	41	0	0	0		5.7	03/12/15	0.00	< Up n	5.6	↔	0.30	15.5	NA	41	0	0	0		27.2	08/14/18	0.49	n	17.8	↑	0.00	39.6	NA	41	0	0	0		53.8	11/05/20	0.00	> Up n						
Copper, dissolved	µg/l	1000	1.23	NC	NC	1.3	0.1	41	39	0	0		5.0	11/12/18	0.00	< Up n	-14.2	↓	0.15	5.6	0.6	41	19	0	0		32.2	06/05/14	0.00	> Up n	NC	NC	1.5	0.2	41	34	0	0		5.0	02/11/19	0.03	> Up n								
Total Organic Carbon	mg/l	--	1.19	NC	NC	0.2	NA	41	38	0	0		1.1	07/19/22	0.00	< Up n	-11.5	↓	0.12	0.7	NA	41	7	0	0		2.2	07/20/22	0.12	n	19.7	↑	0.13	1.2	NA	41	0	0	0		3.1	07/19/22	0.00	> Up n							
Titanium, dissolved	µg/l	--	1.15	NC	NC	0.8	NA	41	40	0	0		6.1	01/26/22	0.15	n	NC	NC	2.0	NA	41	41	0	0		5.0	07/26/23	0.24	n	NC	NC	2.4	NA	41	41	0	0		5.0	01/23/24	0.24	n									
Silver, dissolved	µg/l	100	1.15	NC	NC	0.2	0.2	41	41	0	0		0.2	05/13/19	NC		NC	NC	0.2	0.2	41	41	0	0		0.2	05/07/19	NC		NC	NC	0.3	0.3	41	41	0	0		5.0	01/23/24	NC										
Vanadium, dissolved	µg/l	170	1.15	NC	NC	1.3	0.8	41	41	0	0		2.3	01/18/23	0.00	< Up n	NC	NC	1.3	0.7	41	41	0	0		2.3	01/26/23	0.00	< Up n	NC	NC	1.7	1.0	41	32	0	0		5.0	01/23/24	0.00	> Up n									
Chemical Oxygen Demand	mg/l	--	1.14	NC	NC	2.6	NA	41	40	0	0		25.4	01/26/22	0.15	n	NC	NC	2.5	NA	41	40	0	0		20.7	05/19/20	0.31	n	NC	NC	7.3	NA	41	41	0	0		20.0	04/18/22	0.24	n									
Specific Conductance, field	umhos/cm	--	1.10	-2.9	↔	0.22	225.5	NA	41	0	0	0		267.0	10/13/21	0.00	< Up n	5.1	↔	0.17	1537.6	NA	41	0	0	0		1953.0	05/07/19	0.00	> Up n	18.2	↑	0.00	1471.3	NA	41	0	0	0		1643.0	11/05/20	0.00	> Up n						
Chromium, dissolved	µg/l	100	1.05	NC	NC	0.8	0.8	41	41	0	0		1.0	08/26/20	NC		NC	NC	0.7	0.7	41	41	0	0		1.0	05/07/19	NC		NC	NC	0.7	0.7	41	41	0	0		1.0	08/21/19	NC										
Total Dissolved Solids	mg/l	500	1.03	-10.2	↓	0.00	142.2	28.4	41	0	0	0		173.0	08/16/19	0.00	< Up n	2.4	↔	0.35	1150.7	230.1	41	0	0	41	01/29/24	1670.0	05/07/19	0.00	> Up n	19.4	↑	0.00	1154.2	230.8	41	0	0	41	01/23/24	1300.0	11/05/20	0.00	> Up n						
Calcium, dissolved	mg/l	--	1.02	-8.0	↔	0.02	26.6	NA	41	0	0	0		32.0	08/26/20	0.00	< Up n	79.0	↑	0.00	157.3	NA	41	0	0	0		328.0	08/25/19	0.12	n	20.4	↑	0.00	235.5	NA	41	0	0	0		340.0	08/21/19	0.00	> Up n						
Antimony, dissolved	µg/l	6	1.00	NC	NC	0.4	6.7	1	1	0	0		0.4	02/19/19	NC		NC	NC	0.4	6.7	1	1	0	0		0.4	02/19/19	NC		NC	NC	0.4	6.7	1	1	0	0		0.4	02/11/19	NC										
pH, field	s.u.	6.5-8.5	0.99	3.7	↔	0.08	6.6	85.9	41	0	0	11	10/13/21	7.2	08/26/20	0.02	< Up n	8.8	↔	0.00	5.5	195.6	41	0	0	41	01/29/24	6.4	04/21/22	0.00	< Up n	-2.6	↔	0.02	6.9	64.2	41	0	0	1	05/12/15	7.2	12/07/15	0.01	> Up n						
Mercury, dissolved	µg/l	2	0.96	NC	NC	0.3	17.2	41	41	0	0		0.7	01/24/24	0.00	< Up n	NC	NC	0.3	17.2	41	41	0	0		0.7	01/29/24	0.00	< Up n	NC	NC	0.4	18.1	41	40	0	0		0.7	01/23/24	0.00	> Up n									
Sulfate, as SO4	mg/l	250	0.96	-19.9	↓	0.03	26.2	10.5	41	0	0	0		49.2	05/20/20	0.00	< Up n	12.8	↑	0.04	736.7	294.7	41	0	0	41	01/29/24	1502.0	01/29/24	0.00	> Up n	25.6	↑	0.00	592.2	236.9	41	0	0	41	01/23/24	718.0	01/27/21	0.00	> Up n						
Lead, dissolved	µ																																																		

PARAMETER	UNITS	STD.	UPGRADIENT VS DOWNGRADIENT	Down													Down													Down															
				MW-8-10A													MW-8-10B													MW-8-10C															
				Trend (%)	p	$\bar{x}$	$\bar{x}$ (%)	n	ND	J	>	Max	p (comparison)	Trend (%)	p	$\bar{x}$	$\bar{x}$ (%)	n	ND	J	>	Max	p (comparison)	Trend (%)	p	$\bar{x}$	$\bar{x}$ (%)	n	ND	J	>	Max	p (comparison)												
Arsenic, dissolved	µg/l	10	60.93	NC	NC	0.5	5.2	41	41	0	0		0.6	01/22/24	0.00	< Up n	-25.1	↓	0.00	1.5	15.3	41	5	0	0		2.0	05/12/15	0.00	> Up n	-42.2	↓	0.20	0.8	8.5	11	5	0	0		1.8	06/08/16	0.01	> Up n	
Iron, dissolved	mg/l	0.3	60.44	NC	NC	0.0	5.2	41	34	0	0		0.1	06/05/14	0.01	> Up n	NC		NC	0.0	4.5	41	37	0	0		0.1	06/05/14	0.00	> Up n	248.2	↑	0.18	0.3	110.2	11	2	0	4	04/15/23	1.4	04/15/23	0.00	> Up n	
Manganese, dissolved	µg/l	300	21.55	-88.4	↓	0.00	443.9	148.0	41	6	0	12	10/14/23	1950.0	12/07/16	0.00	> Up n	NC		NC	4.2	1.4	41	28	0	0		40.0	01/22/24	0.00	< Up n	455.4	↑	0.11	329.8	109.9	11	2	0	8	04/15/23	826.0	04/15/23	0.00	> Up n
Molybdenum, dissolved	µg/l	40	17.14	-58.9	↓	0.00	30.5	76.4	41	0	0	9	02/13/18	78.7	12/07/16	0.00	> Up n	-23.8	↓	0.00	33.5	83.8	41	0	0	1	08/11/19	41.2	08/11/19	0.00	> Up n	-13.1	↓	0.11	53.9	134.7	11	0	0	10	04/16/22	67.0	04/24/21	0.00	> Up n
Zinc, dissolved	µg/l	2000	8.58	-29.7	↓	0.01	6.7	0.3	41	15	0	0		29.1	11/11/19	0.00	> Up n	NC		NC	2.3	0.1	41	35	0	0		31.0	11/11/19	0.00	< Up n	NC		NC	3.9	0.2	11	11	0	0		5.0	04/15/23	0.06	n
Nickel, dissolved	µg/l	100	6.18	NC	NC	1.0	1.0	41	34	0	0		9.2	11/11/19	0.00	< Up n	NC		NC	0.8	0.8	41	37	0	0		8.2	11/11/19	0.00	< Up n	NC		NC	0.5	0.5	11	10	0	0		2.8	04/15/23	0.00	< Up n	
Aluminum, dissolved	µg/l	200	6.15	NC	NC	68.0	34.0	41	41	0	0		100.0	01/22/24	NC		NC		NC	63.8	31.9	41	41	0	0		100.0	01/22/24	NC		NC		NC	35.5	17.7	11	11	0	0		100.0	04/24/21	NC		
Cadmium, dissolved	µg/l	5	5.16	NC	NC	0.2	3.5	41	41	0	0		1.0	10/16/21	NC		NC		NC	0.1	2.4	41	41	0	0		1.0	08/24/20	NC		NC		NC	0.1	2.2	11	11	0	0		0.2	05/08/19	NC		
Potassium, dissolved	mg/l	--	5.14	0.0	↔	0.47	2.4	NA	41	0	0	0		3.0	10/14/23	0.47	n	14.1	↑	0.03	2.3	NA	41	0	0	0		3.4	06/05/14	0.48	n	-71.5	↓	0.00	3.0	NA	11	1	0	0		6.8	05/12/15	0.22	n
Fluoride, total as F	mg/l	2	3.70	NC	NC	0.2	7.8	41	26	0	0		0.2	01/22/24	0.00	> Up n	NC		NC	0.1	6.4	41	24	0	0		0.2	01/22/24	0.00	> Up n	42.6	↑	0.07	0.1	6.3	11	3	0	0		0.2	04/15/23	0.05	n	
Strontium, dissolved	µg/l	4000	2.89	-28.2	↓	0.00	294.1	7.4	41	0	0	0		417.0	12/07/16	0.02	> Up n	37.4	↑	0.00	251.6	6.3	41	0	0	0		362.0	05/19/20	0.32	n	17.9	↑	0.02	205.6	5.1	11	0	0	0		240.0	04/24/21	0.50	n
Chloride, total as Cl	mg/l	250	2.38	96.5	↑	0.00	37.8	15.1	41	0	0	0		63.4	10/14/23	0.00	> Up n	1060.7	↑	0.00	56.3	22.5	41	0	0	0		116.0	10/14/23	0.00	> Up n	86.6	↑	0.00	11.4	4.6	11	0	0	0		14.3	04/24/21	0.19	n
Beryllium, dissolved	µg/l	4	1.95	NC	NC	0.1	3.3	41	41	0	0		0.2	01/22/24	NC		NC		NC	0.1	3.6	41	41	0	0		0.5	09/14/16	NC		NC		NC	0.2	4.2	11	11	0	0		0.5	05/08/19	NC		
Lithium, dissolved	µg/l	83	1.56	-32.8	↓	0.00	13.3	16.1	41	1	0	0		19.3	12/07/16	0.43	n	-5.2	↔	0.33	14.3	17.3	41	0	0	0		31.6	06/05/14	0.42	n	-76.3	↓	0.00	14.0	16.9	11	0	0	0		35.5	05/12/15	0.31	n
Ammonia, as N	mg/l	--	1.28	NC	NC	0.1	NA	41	29	0	0		0.4	02/02/20	0.00	< Up n	NC		NC	0.1	NA	41	41	0	0		0.2	11/05/20	0.00	< Up n	NC		NC	0.0	NA	11	11	0	0		0.1	04/15/23	0.00	< Up n	
Magnesium, dissolved	mg/l	--	1.24	-13.9	↓	0.01	37.6	NA	41	0	0	0		44.1	09/16/15	0.00	> Up n	28.5	↑	0.00	21.6	NA	41	0	0	0		26.1	10/15/22	0.47	n	23.6	↑	0.14	17.0	NA	11	0	0	0		20.7	04/24/21	0.50	n
Copper, dissolved	µg/l	1000	1.23	NC	NC	1.6	0.2	41	37	0	0		5.0	05/08/19	0.00	> Up n	NC		NC	1.0	0.1	41	37	0	0		5.0	03/07/17	0.00	< Up n	NC		NC	1.7	0.2	11	9	0	0		14.2	06/09/14	0.35	n	
Total Organic Carbon	mg/l	--	1.19	0.0	↔	0.32	0.6	NA	41	17	0	0		3.2	07/16/22	0.00	< Up n	NC		NC	0.3	NA	41	35	0	0		1.4	07/16/22	0.00	< Up n	NC		NC	0.6	NA	11	8	0	0		0.8	05/08/19	0.00	< Up n
Titanium, dissolved	µg/l	--	1.15	NC	NC	2.1	NA	39	39	0	0		5.0	07/22/23	0.25	n	NC		NC	2.2	NA	39	39	0	0		5.0	07/22/23	0.25	n	NC		NC	1.9	NA	10	10	0	0		5.0	04/15/23	0.36	n	
Silver, dissolved	µg/l	100	1.15	NC	NC	0.2	0.2	41	41	0	0		0.2	05/08/19	NC		NC		NC	0.2	0.2	41	41	0	0		0.2	05/08/19	NC		NC		NC	0.2	0.2	11	11	0	0		1.0	06/09/14	NC		
Vanadium, dissolved	µg/l	170	1.15	NC	NC	1.3	0.8	41	41	0	0		2.3	01/21/23	0.00	< Up n	NC		NC	4.3	2.5	41	32	0	0		5.0	01/22/24	0.24	n	NC		NC	1.2	0.7	11	11	0	0		2.3	04/16/22	0.00	< Up n	
Chemical Oxygen Demand	mg/l	--	1.14	NC	NC	6.0	NA	41	41	0	0		20.0	07/16/22	0.24	n	NC		NC	6.8	NA	41	41	0	0		20.0	01/22/24	0.24	n	NC		NC	7.3	NA	11	11	0	0		20.0	04/24/21	0.36	n	
Specific Conductance, field	umhos/cm	--	1.10	2.8	↔	0.40	993.6	NA	41	0	0	0		1181.0	10/14/23	0.50	n	41.8	↑	0.00	769.0	NA	41	0	0	0		929.0	10/14/23	0.50	n	15.5	↑	0.00	517.1	NA	11	0	0	0		553.0	04/24/21	0.49	n
Chromium, dissolved	µg/l	100	1.05	NC	NC	0.8	0.8	41	41	0	0		1.0	07/22/23	NC		NC		NC	0.7	0.7	41	41	0	0		1.0	08/24/20	NC		NC		NC	1.1	1.1	11	11	0	0		5.0	05/12/15	NC		
Total Dissolved Solids	mg/l	500	1.03	-8.4	↔	0.19	737.4	147.5	41	0	0	41	01/22/24	949.0	09/19/17	0.49	n	29.5	↑	0.00	526.1	105.2	41	0	0	24	01/22/24	731.0	07/22/23	0.50	n	11.0	↑	0.01	344.3	68.9	11	0	0	0		363.0	04/16/22	0.49	n
Calcium, dissolved	mg/l	--	1.02	-7.0	↔	0.11	146.2	NA	41	0	0	0		173.0	10/14/23	0.47	n	23.7	↑	0.00	116.1	NA	41	0	0	0		149.0	10/15/22	0.46	n	9.4	↔	0.18	59.5	NA	11	0	0	0		69.1	04/24/21	0.50	n
Antimony, dissolved	µg/l	6	1.00	NC	NC	NC	NC	0	0	0	0		NC		NC		NC		NC	NC	NC	0	0	0	0		NC		NC		NC	NC	NC	NC	0	0	0	0		NC		NC			
pH, field	s.u.	6.5-8.5	0.99	2.4	↔	0.07	6.5	99.1	41	0	0	23	07/22/23	7.1	02/02/20	0.00	< Up n	-1.0	↔	0.25	7.4	10.5	41	0	0	0		7.8	09/09/14	0.00	> Up n	-6.0	↔	0.02	7.2	25.9	11	0	0	0		7.6	06/09/14	0.00	> Up n
Mercury, dissolved	µg/l	2	0.96	NC	NC	0.3	17.2	41	41	0	0		0.7	01/22/24	0.00	< Up n	NC		NC	0.3	17.2	41	40	0	0		0.7	01/22/24	0.00	< Up n	NC		NC	0.3	13.8	11	11	0	0		0.7	04/15/23	0.00	< Up n	
Sulfate, as SO4	mg/l	250	0.96	-21.1	↓	0.01	337.8	135.1	41	0	0	39	01/22/24	421.0	05/12/15	0.50	n	-17.1	↓	0.00	188.2	75.3	41	0	0	0		213.0	05/12/15	0.47	n	0.0	↔	0.38	118.7	47.5	11	0	0	0		125.0	06/08/16	0.48	n
Lead, dissolved	µg/l	5	0.92	NC	NC	0.2	4.1	41	41	0	0		1.0	0																															

PARAMETER	UNITS	STD.	UPGRADIENT VS DOWNGRAIDENT	Down													Down													Down																			
				MW-8-12C													MW-8-1N													MW-8-2																			
				Trend (%)	p	$\bar{x}$	$\bar{x}$ (%)	n	ND	J	>	Max	p (comparison)	Trend (%)	p	$\bar{x}$	$\bar{x}$ (%)	n	ND	J	>	Max	p (comparison)	Trend (%)	p	$\bar{x}$	$\bar{x}$ (%)	n	ND	J	>	Max	p (comparison)																
Arsenic, dissolved	µg/l	10	60.93	191.2	↑	0.20	1.1	10.7	11	3	0	0		2.0	06/10/14	0.00	> Up n	NC	NC	0.5	5.1	41	41	0	0					0.6	01/19/24	0.00	< Up n	NC	NC	0.1	1.2	41	40	0	0					1.0	08/24/20	0.00	< Up n
Iron, dissolved	mg/l	0.3	60.44	-52.2	↓	0.00	0.8	269.7	11	0	0	10	04/18/23	1.2	06/10/14	0.00	> Up n	-66.0	↓	0.01	0.7	223.6	41	0	0	25	01/19/24	5.4	09/15/16	0.00	> Up n	NC	NC	0.0	1.3	41	38	0	0					0.1	01/25/21	0.00	< Up n		
Manganese, dissolved	µg/l	300	21.55	6.8	↔	0.09	1412.5	470.8	11	0	0	10	04/18/23	1730.0	04/24/21	0.00	> Up n	-35.3	↓	0.00	1715.1	571.7	41	0	0	41	01/19/24	3210.0	09/15/16	0.00	> Up n	29.5	↑	0.02	376.1	125.4	41	0	0	32	01/19/24	727.0	10/12/23	0.00	> Up n				
Molybdenum, dissolved	µg/l	40	17.14	2.7	↔	0.35	365.1	912.7	11	0	0	11	04/18/23	520.0	04/24/21	0.00	> Up n	NC	NC	1.4	3.5	41	34	0	0			5.0	11/08/18	0.00	< Up n	-12.6	↓	0.01	291.8	729.4	41	0	0	41	01/19/24	420.0	07/20/23	0.00	> Up n				
Zinc, dissolved	µg/l	2000	8.58	NC		NC	2.1	0.1	11	10	0	0		12.8	06/10/14	0.24	n	NC	NC	3.6	0.2	41	37	0	0			45.7	01/19/24	0.08	n	NC	NC	4.0	0.2	41	32	0	0					47.4	01/19/24	0.00	> Up n		
Nickel, dissolved	µg/l	100	6.18	NC		NC	3.3	3.3	11	7	0	0		5.0	05/09/18	0.22	n	NC	NC	1.5	1.5	41	36	0	0			15.8	11/03/19	0.00	> Up n	NC	NC	1.9	1.9	41	23	0	0					7.4	11/04/19	0.47	n		
Aluminum, dissolved	µg/l	200	6.15	NC		NC	70.6	35.3	11	11	0	0		100.0	04/18/23	NC		NC	NC	71.6	35.8	41	41	0	0			100.0	01/19/24	NC		NC	NC	57.7	28.9	41	41	0	0					100.0	01/19/24	NC			
Cadmium, dissolved	µg/l	5	5.16	NC		NC	0.5	9.9	11	8	0	0		1.0	04/18/23	0.00	> Up n	NC	NC	0.2	3.5	41	41	0	0			0.2	05/12/19	NC		NC	NC	0.6	11.7	41	27	0	0					1.1	01/19/24	0.00	> Up n		
Potassium, dissolved	mg/l	--	5.14	-81.2	↓	0.00	7.4	NA	11	0	0	0		12.4	05/11/15	0.00	> Up n	20.5	↑	0.04	7.8	NA	41	0	0	0			12.1	09/15/16	0.00	> Up n	16.2	↑	0.00	5.2	NA	41	0	0	0					6.5	10/12/23	0.00	> Up n
Fluoride, total as F	mg/l	2	3.70	23.5	↑	0.35	0.2	7.8	11	1	0	0		0.3	05/20/20	0.49	n	0.0	↔	0.25	0.2	11.3	41	12	0	0			0.3	05/19/20	0.00	> Up n	-8.0	↔	0.08	1.0	47.6	41	0	0	0					1.1	09/08/14	0.00	> Up n
Strontium, dissolved	µg/l	4000	2.89	-5.0	↔	0.18	307.7	7.7	11	0	0	0		424.0	05/08/19	0.30	n	22.3	↑	0.01	1111.6	27.8	41	0	0	0			1440.0	10/12/23	0.00	> Up n	35.5	↑	0.00	481.3	12.0	41	0	0	0					712.0	10/12/23	0.00	> Up n
Chloride, total as Cl	mg/l	250	2.38	-7.5	↔	0.12	8.6	3.4	11	0	0	0		9.1	06/10/14	0.01	< Up n	-72.9	↓	0.00	64.9	26.0	41	0	0	0			209.0	03/06/14	0.00	> Up n	0.6	↔	0.45	27.6	11.1	41	0	0	0					34.2	10/12/23	0.00	> Up n
Beryllium, dissolved	µg/l	4	1.95	NC		NC	0.2	4.2	11	11	0	0		0.5	06/10/14	NC		NC	NC	0.1	3.3	41	41	0	0			0.2	01/19/24	NC		NC	NC	0.1	3.3	41	41	0	0					0.2	01/19/24	NC			
Lithium, dissolved	µg/l	83	1.56	-77.3	↓	0.01	16.1	19.4	11	0	0	0		28.7	06/08/16	0.50	n	-78.0	↓	0.00	1.9	2.3	41	12	0	0			4.8	09/15/16	0.00	< Up n	-14.7	↓	0.02	21.0	25.3	41	0	0	0					26.0	09/14/15	0.49	n
Ammonia, as N	mg/l	--	1.28	NC		NC	0.1	NA	11	6	0	0		0.2	05/20/20	0.01	< Up n	-38.4	↓	0.00	0.2	NA	41	17	0	0			1.1	02/02/20	0.04	> Up n	56.3	↑	0.06	0.1	NA	41	16	0	0					0.3	02/03/20	0.16	n
Magnesium, dissolved	mg/l	--	1.24	4.9	↔	0.22	18.1	NA	11	0	0	0		20.0	04/24/21	0.49	n	-28.8	↓	0.00	34.6	NA	41	0	0	0			48.4	05/13/15	0.02	> Up n	26.0	↑	0.00	14.6	NA	41	0	0	0					20.6	10/12/23	0.48	n
Copper, dissolved	µg/l	1000	1.23	NC		NC	0.8	0.1	11	11	0	0		1.0	06/03/22	0.01	< Up n	NC	NC	1.1	0.1	41	36	0	0			5.0	05/12/19	0.00	< Up n	NC	NC	0.8	0.1	41	32	0	0					6.0	07/20/23	0.21	n		
Total Organic Carbon	mg/l	--	1.19	5.5	↔	0.38	1.3	NA	11	1	0	0		2.2	06/03/22	0.00	> Up n	-19.2	↓	0.04	1.1	NA	41	1	0	0			4.4	07/16/22	0.00	> Up n	9.3	↔	0.05	0.8	NA	41	5	0	0					3.7	07/18/22	0.37	n
Titanium, dissolved	µg/l	--	1.15	NC		NC	1.6	NA	10	9	0	0		5.0	04/18/23	0.02	> Up n	NC	NC	1.4	NA	39	39	0	0			5.0	08/25/20	0.25	n	NC	NC	1.6	NA	39	39	0	0					5.0	10/17/22	0.25	n		
Silver, dissolved	µg/l	100	1.15	NC		NC	0.4	0.4	11	10	0	0		2.2	06/10/14	0.00	> Up n	NC	NC	0.2	0.2	41	41	0	0			0.2	05/12/19	NC		NC	NC	0.2	0.2	41	41	0	0					0.2	05/09/19	NC			
Vanadium, dissolved	µg/l	170	1.15	NC		NC	1.2	0.7	11	11	0	0		2.3	06/03/22	0.00	< Up n	NC	NC	1.3	0.8	41	41	0	0			2.3	01/18/23	0.00	< Up n	NC	NC	1.4	0.9	41	40	0	0					5.0	01/19/24	0.00	< Up n		
Chemical Oxygen Demand	mg/l	--	1.14	NC		NC	8.7	NA	11	11	0	0		20.0	06/03/22	0.36	n	NC	NC	8.5	NA	41	41	0	0			20.0	10/12/23	0.24	n	NC	NC	6.7	NA	41	41	0	0					20.0	10/12/23	0.24	n		
Specific Conductance, field	umhos/cm	--	1.10	2.1	↔	0.14	624.5	NA	11	0	0	0		663.0	04/18/23	0.50	n	-37.3	↓	0.00	1328.5	NA	41	0	0	0			1886.0	05/13/15	0.01	> Up n	13.5	↑	0.02	609.2	NA	41	0	0	0					953.0	07/18/22	0.49	n
Chromium, dissolved	µg/l	100	1.05	NC		NC	0.8	0.8	11	11	0	0		1.0	05/08/19	NC		NC	NC	0.7	0.7	41	41	0	0			1.0	08/25/20	NC		NC	NC	0.8	0.8	41	41	0	0					1.0	04/19/22	NC			
Total Dissolved Solids	mg/l	500	1.03	-2.7	↔	0.32	421.2	84.2	11	0	0	0		452.0	05/20/20	0.50	n	-47.0	↓	0.00	974.9	195.0	41	0	0	41	01/19/24	1520.0	09/15/16	0.01	> Up n	9.3	↔	0.01	383.2	76.6	41	0	0	2	10/12/23	560.0	07/20/23	0.49	n				
Calcium, dissolved	mg/l	--	1.02	2.3	↔	0.38	92.6	NA	11	0	0	0		109.0	04/24/21	0.50	n	-30.3	↓	0.00	203.4	NA	41	0	0	0			299.0	09/15/16	0.02	> Up n	17.3	↑	0.04	85.3	NA	41	0	0	0					124.0	10/12/23	0.49	n
Antimony, dissolved	µg/l	6	1.00	NC		NC	NC	NC	0	0	0	0		NC		NC		NC	NC	NC	NC	0	0	0	0			NC		NC		NC	NC	NC	0	0	0	0					NC		NC				
pH, field	s.u.	6.5-8.5	0.99	-3.3	↔	0.08	7.1	37.4	11	0	0	0		7.4	09/09/14	0.00	> Up n	3.1	↔	0.01	6.6	86.5	41	0	0	10	04/15/23	7.5	01/19/24	0.00	< Up n	0.0	↔	0.50	6.7	81.0	41	0	0	7	07/20/23	7.0	12/07/15	0.17	n				
Mercury, dissolved	µg/l	2	0.96	NC		NC	0.3	14.2	11	10	0	0		0.7	04/18/23	0.00	< Up n	NC	NC	0.4	17.8	41	41	0	0			0.7	01/19/24	0.00	> Up n	NC	NC	0.3	17.4	41	41	0	0					0.7	01/19/24	0.00			

PARAMETER	UNITS	STD.	UPGRADIENT VS DOWNGRADIENT	Down												Down												Down																					
				MW-8-3A												MW-8-3B												MW-8-4																					
				Trend (%)	p	$\bar{x}$	$\bar{x}$ (%)	n	ND	J	>	Max	p (comparison)	Trend (%)	p	$\bar{x}$	$\bar{x}$ (%)	n	ND	J	>	Max	p (comparison)	Trend (%)	p	$\bar{x}$	$\bar{x}$ (%)	n	ND	J	>	Max	p (comparison)																
Arsenic, dissolved	µg/l	10	60.93	18.8	↑	0.25	10.3	103.4	41	1	0	23	10/12/23	21.1	10/12/23	0.00	> Up n	-24.9	↓	0.12	5.7	56.6	41	0	0	0	0	0	0	0	0	9.8	11/08/18	0.00	> Up n	NC	NC	0.9	8.7	41	30	0	0	0	0	3.8	09/16/14	0.45	n
Iron, dissolved	mg/l	0.3	60.44	-22.6	↓	0.08	5.5	1834.5	41	0	0	40	01/20/24	11.0	06/06/17	0.00	> Up n	-49.4	↓	0.04	0.3	111.4	41	5	0	19	01/24/22	0.9	09/19/16	0.00	> Up n	NC	NC	0.0	1.2	41	40	0	0	0	0	0.1	04/18/22	0.00	< Up n				
Manganese, dissolved	µg/l	300	21.55	21.5	↑	0.13	6347.1	2115.7	41	0	0	41	01/20/24	9120.0	10/14/21	0.00	> Up n	5.2	↔	0.38	1304.1	434.7	41	0	0	40	01/20/24	2000.0	07/18/22	0.00	> Up n	-73.1	↓	0.00	12144.1	4048.0	41	0	0	41	01/20/24	31600.0	09/16/14	0.00	> Up n				
Molybdenum, dissolved	µg/l	40	17.14	-0.7	↔	0.49	62.2	155.6	41	0	0	34	10/12/23	94.6	11/04/19	0.00	> Up n	-1.2	↔	0.39	142.6	356.6	41	0	0	41	01/20/24	177.0	07/20/23	0.00	> Up n	NC	NC	1.4	3.4	41	32	0	0	0	0	11.1	04/17/23	0.00	< Up n				
Zinc, dissolved	µg/l	2000	8.58	NC	NC	3.0	0.2	41	32	0	0	0	0	44.4	01/20/24	0.46	n	NC	NC	4.0	0.2	41	33	0	0	0	0	45.4	01/20/24	0.48	n	-80.7	↓	0.00	137.2	6.9	41	0	0	0	0	467.0	09/24/15	0.00	> Up n				
Nickel, dissolved	µg/l	100	6.18	NC	NC	3.0	3.0	41	24	0	0	0	0	11.7	11/04/19	0.33	n	NC	NC	1.0	1.0	41	36	0	0	0	0	9.8	11/04/19	0.00	< Up n	-70.9	↓	0.00	98.2	98.2	41	0	0	13	07/19/22	237.0	09/24/15	0.00	> Up n				
Aluminum, dissolved	µg/l	200	6.15	NC	NC	69.6	34.8	41	41	0	0	0	0	100.0	01/20/24	NC		NC	NC	65.9	32.9	41	41	0	0	0	0	100.0	01/20/24	NC		-70.3	↓	0.00	876.5	438.2	41	6	0	16	07/19/22	6260.0	09/16/14	0.00	> Up n				
Cadmium, dissolved	µg/l	5	5.16	NC	NC	0.1	2.7	41	41	0	0	0	0	1.0	08/24/20	NC		NC	NC	0.4	8.1	41	41	0	0	0	0	1.0	01/20/23	NC		-57.4	↓	0.00	2.1	41.7	41	9	0	3	09/22/16	6.1	09/24/15	0.00	> Up n				
Potassium, dissolved	mg/l	--	5.14	36.1	↑	0.00	2.9	NA	41	0	0	0	0	3.5	01/20/24	0.42	n	12.5	↑	0.00	1.7	NA	41	0	0	0	0	2.0	07/18/22	0.47	n	-37.4	↓	0.00	1.9	NA	41	0	0	0	0	3.6	09/24/15	0.48	n				
Fluoride, total as F	mg/l	2	3.70	-8.9	↔	0.13	0.4	21.0	41	0	0	0	0	0.7	02/03/20	0.00	> Up n	-15.6	↓	0.01	0.5	23.7	41	2	0	0	0	0.9	05/13/15	0.00	> Up n	-29.2	↓	0.19	0.3	17.3	41	7	0	0	0	0.9	09/16/14	0.00	> Up n				
Strontium, dissolved	µg/l	4000	2.89	57.2	↑	0.00	798.1	20.0	41	0	0	0	0	1040.0	04/14/23	0.00	> Up n	18.8	↑	0.00	371.0	9.3	41	0	0	0	0	447.0	10/12/23	0.00	> Up n	-56.9	↓	0.00	362.7	9.1	41	0	0	0	0	661.0	09/16/14	0.00	> Up n				
Chloride, total as Cl	mg/l	250	2.38	667.5	↑	0.00	45.8	18.3	41	1	0	0	0	140.0	01/24/22	0.39	n	1176.0	↑	0.00	22.6	9.0	41	0	0	0	0	92.4	11/06/20	0.16	n	-60.6	↓	0.00	30.7	12.3	41	0	0	0	0	82.5	09/24/15	0.00	> Up n				
Beryllium, dissolved	µg/l	4	1.95	NC	NC	0.1	3.6	41	41	0	0	0	0	0.5	08/22/18	NC		NC	NC	0.1	3.3	41	41	0	0	0	0	0.2	01/20/24	NC		NC	NC	1.1	28.0	41	26	0	3	09/22/16	5.0	09/24/15	0.01	> Up n					
Lithium, dissolved	µg/l	83	1.56	12.8	↑	0.10	16.4	19.8	41	0	0	0	0	22.0	07/20/23	0.49	n	-7.6	↔	0.05	25.6	30.9	41	0	0	0	0	35.8	01/24/22	0.48	n	-51.3	↓	0.00	17.1	20.5	41	1	0	0	0	37.0	09/24/15	0.42	n				
Ammonia, as N	mg/l	--	1.28	8.6	↔	0.25	0.2	NA	41	9	0	0	0	0.4	08/24/20	0.00	> Up n	NC	NC	0.0	NA	41	26	0	0	0	0	0.3	02/03/20	0.00	< Up n	NC	NC	0.0	NA	41	31	0	0	0	0	0.3	05/20/20	0.00	< Up n				
Magnesium, dissolved	mg/l	--	1.24	39.5	↑	0.00	31.2	NA	41	0	0	0	0	39.3	01/24/22	0.34	n	27.2	↑	0.00	24.0	NA	41	0	0	0	0	30.5	01/24/22	0.49	n	-54.2	↓	0.00	45.7	NA	41	0	0	0	0	65.4	09/16/14	0.00	> Up n				
Copper, dissolved	µg/l	1000	1.23	NC	NC	0.7	0.1	41	34	0	0	0	0	3.1	04/18/22	0.11	n	NC	NC	0.7	0.1	41	34	0	0	0	0	6.1	03/07/17	0.10	n	-90.6	↓	0.00	3.8	0.4	41	20	0	0	0	16.7	09/24/15	0.00	> Up n				
Total Organic Carbon	mg/l	--	1.19	-31.5	↓	0.02	1.6	NA	41	2	0	0	0	4.2	07/18/22	0.00	> Up n	-4.6	↔	0.30	0.8	NA	41	8	0	0	0	2.8	07/18/22	0.31	n	-7.8	↔	0.21	0.8	NA	41	8	0	0	0	2.6	07/19/22	0.35	n				
Titanium, dissolved	µg/l	--	1.15	NC	NC	2.4	NA	39	39	0	0	0	0	5.0	07/20/23	0.25	n	NC	NC	2.2	NA	39	39	0	0	0	0	5.0	07/20/23	0.25	n	NC	NC	1.1	NA	39	35	0	0	0	0	5.6	01/22/22	0.00	> Up n				
Silver, dissolved	µg/l	100	1.15	NC	NC	0.2	0.2	41	41	0	0	0	0	0.2	05/06/19	NC		NC	NC	1.0	1.0	41	40	0	0	0	0	34.3	09/21/15	0.08	n	NC	NC	0.2	0.2	41	41	0	0	0	0	0.2	05/09/19	NC					
Vanadium, dissolved	µg/l	170	1.15	NC	NC	1.3	0.8	41	41	0	0	0	0	2.3	01/20/23	0.00	< Up n	NC	NC	1.5	0.9	41	35	0	0	0	0	5.0	10/12/23	0.00	< Up n	NC	NC	1.3	0.8	41	41	0	0	0	0	2.3	01/19/23	0.00	< Up n				
Chemical Oxygen Demand	mg/l	--	1.14	NC	NC	2.5	NA	41	40	0	0	0	0	22.1	07/18/22	0.31	n	NC	NC	5.8	NA	41	41	0	0	0	0	20.0	10/12/23	0.24	n	NC	NC	2.9	NA	41	39	0	0	0	0	21.2	07/23/21	0.11	n				
Specific Conductance, field	umhos/cm	--	1.10	76.4	↑	0.00	980.9	NA	41	0	0	0	0	1315.0	07/18/22	0.41	n	35.2	↑	0.00	787.2	NA	41	0	0	0	0	1011.0	10/12/23	0.50	n	-45.8	↓	0.00	1059.7	NA	41	0	0	0	0	1588.0	09/16/14	0.34	n				
Chromium, dissolved	µg/l	100	1.05	NC	NC	0.7	0.7	41	41	0	0	0	0	1.0	01/25/21	NC		NC	NC	0.7	0.7	41	41	0	0	0	0	1.0	11/04/19	NC		NC	NC	0.7	0.7	41	41	0	0	0	0	1.0	02/08/21	NC					
Total Dissolved Solids	mg/l	500	1.03	49.6	↑	0.00	703.1	140.6	41	0	0	41	01/20/24	886.0	07/18/22	0.50	n	22.0	↑	0.00	518.9	103.8	41	0	0	26	01/20/24	631.0	07/20/23	0.49	n	-52.5	↓	0.00	848.3	169.7	41	0	0	37	07/20/23	1340.0	09/16/14	0.14	n				
Calcium, dissolved	mg/l	--	1.02	59.5	↑	0.00	153.5	NA	41	0	0	0	0	198.0	04/26/21	0.49	n	33.8	↑	0.00	128.8	NA	41	0	0	0	0	169.0	10/17/22	0.47	n	-48.5	↓	0.00	130.1	NA	41	0	0	0	0	195.0	09/16/14	0.49	n				
Antimony, dissolved	µg/l	6	1.00	NC	NC	NC	NC	0	0	0	0	0	0	NC		NC		NC	NC	NC	NC	0	0	0	0	0	NC		NC		NC	NC	NC	NC	0	0	0	0	0	NC		NC							
pH, field	s.u.	6.5-8.5	0.99	-0.5	↔	0.40	6.4	106.0	41	0	0	25	04/14/23	6.8	04/18/22	0.00	< Up n	0.9	↔	0.25	6.9	61.8	41	0	0	0	0	7.2	01/20/24	0.00	> Up n	11.7	↑	0.00	5.5	205.0	41	0	0	40	01/20/24	7.0	10/13/23	0.00	< Up n				
Mercury, dissolved	µg/l	2	0.96	NC	NC	0.4	17.6	41	41	0	0	0	0	0.7	01/20/24	0.00	< Up n	NC	NC	0.3	17.4	41	41	0	0	0	0	0.7	01/20/24	0.00	< Up n	NC	NC	0.3	17.4	41	41	0	0	0	0	0.7	01/20/24	0.00	< Up n				
Sulfate, as SO4																																																	

PARAMETER	UNITS	STD.	UPGRADIENT VS DOWNGRADIENT	Down												Down												0.0																			
				MW-8-5A												MW-8-5B												MW-8-8A																			
				Trend (%)	p	$\bar{x}$	$\bar{x}$ (%)	n	ND	J	>	Max	p (comparison)	Trend (%)	p	$\bar{x}$	$\bar{x}$ (%)	n	ND	J	>	Max	p (comparison)	Trend (%)	p	$\bar{x}$	$\bar{x}$ (%)	n	ND	J	>	Max	p (comparison)														
Arsenic, dissolved	µg/l	10	60.93	-8.2	↔	0.04	122.0	1220.0	41	0	0	41	01/20/24	150.0	04/14/23	0.00	> Up n	-16.9	↓	0.00	256.4	2564.4	41	0	0	41	01/20/24	372.0	07/23/21	0.00	> Up n	17.6	↑	0.38	488.6	4885.7	7	0	0	7	01/22/24	615.0	01/22/24	0.00	> Up n		
Iron, dissolved	mg/l	0.3	60.44	NC		NC	0.0	6.1	41	34	0	0		0.1	06/04/14	0.00	> Up n	NC		NC	0.0	2.0	41	36	0	0		0.1	01/22/22	0.00	> Up n	NC		NC	NC	NC	0	0	0	0		NC		NC		NC	
Manganese, dissolved	µg/l	300	21.55	24.0	↑	0.00	414.7	138.2	41	0	0	41	01/20/24	496.0	01/22/22	0.00	> Up n	-6.1	↔	0.15	411.1	137.0	41	0	0	41	01/20/24	529.0	12/04/14	0.00	> Up n	23.6	↑	0.27	959.7	319.9	7	0	0	7	01/22/24	1130.0	10/15/22	0.00	> Up n		
Molybdenum, dissolved	µg/l	40	17.14	-8.1	↔	0.06	380.0	950.1	41	0	0	41	01/20/24	529.0	07/20/23	0.00	> Up n	-5.3	↔	0.22	342.3	855.9	41	0	0	41	01/20/24	487.0	07/20/23	0.00	> Up n	6.6	↔	0.50	321.6	803.9	7	0	0	7	01/22/24	359.0	07/21/23	0.00	> Up n		
Zinc, dissolved	µg/l	2000	8.58	NC		NC	3.7	0.2	41	35	0	0		51.9	01/20/24	0.23	n	NC		NC	2.5	0.1	41	37	0	0		43.7	01/20/24	0.07	n	NC		NC	NC	NC	0	0	0	0		NC		NC		NC	
Nickel, dissolved	µg/l	100	6.18	NC		NC	1.5	1.5	41	36	0	0		14.7	08/25/20	0.00	> Up n	NC		NC	1.3	1.3	41	37	0	0		13.8	08/25/20	0.00	< Up n	NC		NC	NC	NC	0	0	0	0		NC		NC		NC	
Aluminum, dissolved	µg/l	200	6.15	NC		NC	71.4	35.7	41	41	0	0		100.0	01/20/24	NC		NC		NC	75.1	37.6	41	41	0	0		100.0	01/20/24	NC		NC		NC	NC	NC	NC	0	0	0	0		NC		NC		NC
Cadmium, dissolved	µg/l	5	5.16	NC		NC	0.5	10.7	41	30	0	0		1.0	10/13/23	0.01	> Up n	NC		NC	0.6	11.1	41	34	0	0		1.0	01/20/24	0.31	n	NC		NC	NC	NC	0	0	0	0		NC		NC		NC	
Potassium, dissolved	mg/l	--	5.14	15.3	↑	0.00	4.2	NA	41	0	0	0		4.7	04/15/22	0.00	> Up n	19.8	↑	0.00	4.0	NA	41	0	0	0		4.7	10/14/22	0.00	> Up n	NC		NC	NC	NC	0	0	0	0		NC		NC		NC	
Fluoride, total as F	mg/l	2	3.70	-1.2	↔	0.36	0.9	45.2	41	0	0	0		1.1	05/20/20	0.00	> Up n	-5.0	↔	0.19	0.7	35.3	41	0	0	0		0.8	06/04/14	0.00	> Up n	-16.1	↓	0.18	0.7	35.6	7	0	0	0		1.0	04/17/23	0.00	> Up n		
Strontium, dissolved	µg/l	4000	2.89	20.7	↑	0.00	734.7	18.4	41	0	0	0		844.0	10/13/23	0.00	> Up n	18.1	↑	0.00	848.0	21.2	41	0	0	0		1030.0	10/13/23	0.00	> Up n	NC		NC	NC	NC	0	0	0	0		NC		NC		NC	
Chloride, total as Cl	mg/l	250	2.38	40.3	↑	0.01	22.4	9.0	41	0	0	0		33.0	02/13/19	0.00	> Up n	60.5	↑	0.00	16.9	6.8	41	0	0	0		25.2	10/13/23	0.00	> Up n	42.5	↑	0.18	217.7	87.1	7	0	0	2	10/13/23	284.0	10/13/23	0.00	> Up n		
Beryllium, dissolved	µg/l	4	1.95	NC		NC	0.1	3.6	41	41	0	0		0.5	09/15/14	NC		NC		NC	0.1	3.3	41	41	0	0		0.2	01/20/24	NC		NC		NC	NC	NC	NC	0	0	0	0		NC		NC		NC
Lithium, dissolved	µg/l	83	1.56	8.8	↔	0.10	198.0	238.6	41	0	0	41	01/20/24	307.0	04/14/23	0.00	> Up n	10.3	↑	0.10	156.4	188.4	41	0	0	41	01/20/24	229.0	04/14/23	0.00	> Up n	-2.5	↔	0.50	243.0	292.8	7	0	0	7	01/22/24	301.0	10/15/22	0.00	> Up n		
Ammonia, as N	mg/l	--	1.28	5.0	↔	0.32	0.4	NA	41	0	0	0		0.6	11/06/19	0.00	> Up n	-13.1	↓	0.04	0.3	NA	41	3	0	0		1.2	08/25/20	0.00	> Up n	34.3	↑	0.11	0.4	NA	7	0	0	0		0.5	01/22/24	0.00	> Up n		
Magnesium, dissolved	mg/l	--	1.24	3.2	↔	0.17	37.9	NA	41	0	0	0		42.8	01/22/22	0.00	> Up n	8.8	↔	0.01	31.3	NA	41	0	0	0		36.1	11/05/20	0.47	n	NC		NC	NC	NC	0	0	0	0		NC		NC		NC	
Copper, dissolved	µg/l	1000	1.23	NC		NC	1.6	0.2	41	28	0	0		10.4	03/07/17	0.22	n	NC		NC	1.7	0.2	41	35	0	0		5.0	05/07/19	0.00	> Up n	NC		NC	NC	NC	0	0	0	0		NC		NC		NC	
Total Organic Carbon	mg/l	--	1.19	0.0	↔	0.41	0.7	NA	41	13	0	0		4.7	07/16/22	0.03	< Up n	-6.6	↔	0.28	0.6	NA	41	13	0	0		4.0	07/16/22	0.01	< Up n	NC		NC	0.5	NA	7	6	0	0		2.5	07/19/22	0.05	< Up n		
Titanium, dissolved	µg/l	--	1.15	NC		NC	1.9	NA	39	39	0	0		5.0	04/14/23	0.25	n	NC		NC	2.0	NA	39	39	0	0		5.0	07/20/23	0.25	n	NC		NC	NC	NC	0	0	0	0		NC		NC		NC	
Silver, dissolved	µg/l	100	1.15	NC		NC	0.2	0.2	41	41	0	0		1.0	09/15/14	NC		NC		NC	0.2	0.2	41	41	0	0		0.2	05/07/19	NC		NC		NC	NC	NC	NC	0	0	0	0		NC		NC		NC
Vanadium, dissolved	µg/l	170	1.15	NC		NC	3.4	2.0	41	32	0	0		5.0	01/20/24	0.09	n	NC		NC	1.6	0.9	41	38	0	0		5.0	01/20/24	0.00	> Up n	NC		NC	NC	NC	0	0	0	0		NC		NC		NC	
Chemical Oxygen Demand	mg/l	--	1.14	NC		NC	4.7	NA	41	41	0	0		20.0	10/15/21	0.24	n	NC		NC	4.9	NA	41	41	0	0		20.0	07/23/21	0.24	n	NC		NC	7.6	NA	7	6	0	0		21.3	07/19/22	0.01	> Up n		
Specific Conductance, field	umhos/cm	--	1.10	15.6	↑	0.00	1055.6	NA	41	0	0	0		1143.0	01/22/22	0.49	n	16.2	↑	0.00	956.7	NA	41	0	0	0		1078.0	10/13/23	0.50	n	14.2	↑	0.27	1573.9	NA	7	0	0	0		1744.0	10/15/22	0.00	> Up n		
Chromium, dissolved	µg/l	100	1.05	NC		NC	0.8	0.8	41	39	0	0		1.1	08/14/19	0.02	> Up n	NC		NC	0.8	0.8	41	41	0	0		1.0	08/25/20	NC		NC		NC	NC	NC	0	0	0	0		NC		NC		NC	
Total Dissolved Solids	mg/l	500	1.03	6.0	↔	0.02	757.9	151.6	41	0	0	41	01/20/24	828.0	09/12/17	0.49	n	6.8	↔	0.01	675.3	135.1	41	0	0	41	01/20/24	754.0	07/23/21	0.49	n	7.0	↔	0.38	990.0	198.0	7	0	0	7	01/22/24	1170.0	10/13/23	0.20	n		
Calcium, dissolved	mg/l	--	1.02	12.7	↑	0.00	170.4	NA	41	0	0	0		204.0	10/14/22	0.46	n	17.2	↑	0.00	156.7	NA	41	0	0	0		193.0	07/23/21	0.46	n	NC		NC	NC	NC	0	0	0	0		NC		NC		NC	
Antimony, dissolved	µg/l	6	1.00	NC		NC	NC	NC	0	0	0	0		NC		NC		NC		NC	NC	NC	0	0	0	0		NC		NC		NC	NC	NC	NC	0	0	0	0		NC		NC		NC		
pH, field	s.u.	6.5-8.5	0.99	-1.2	↔	0.26	7.0	51.3	41	0	0	1	02/13/19	7.4	10/13/23	0.00	> Up n	-1.0	↔	0.31	7.1	37.5	41	0	0	0		7.5	10/13/23	0.00	> Up n	3.5	↔	0.27	7.1	43.7	7	0	0	0		7.3	10/15/22	0.00	> Up n		
Mercury, dissolved	µg/l	2	0.96	NC		NC	0.4	18.1	41	41	0	0		0.7	01/20/24	0.00	> Up n	NC		NC	0.4	18.5	41	28	0	0		0.7	01/20/24	0.00	> Up n	NC		NC	NC	NC	0	0	0	0		NC		NC		NC	
Sulfate, as SO4	mg/l	250	0.96	7.1	↔	0.04	303.7	121.5	41	0	0	41	01/20/24	340.0	05/11/15	0.48	n	11.8	↑	0.02	268.4	107.3	41	0	0	32	01/20/24	325.0	07/23/21	0.48	n	-15.6	↓	0.07	244.9	97.9	7	0	0	3	10/13/23	283.0	10/15/22	0.50	n		
Lead, dissolved	µg/l	5	0.																																												




**Notes:**

1. Upgradient vs downgradient represents the ratio of average concentration in all downgradient wells to average concentration of all upgradient wells (i.e. how many times greater is the concentration in downgradient v
2. Rows are sorted according to "Upgradient vs. Downgradient" ratio. Parameters with higher downgradient concentrations are on top (orange formatting indicates greater downgradient concentrations; blue formatting in
3. Sub-headings for each location are as follows:

- Trend (%):** Percent increase/decrease in concentration of the Theil-Sen trendline over 10-year period (red arrow = increase; blue arrow = decrease; arrow size is proportional to increase/decrease).
- p:** p-value of Theil-Sen trend.
- $\bar{x}$ :** Mean measured concentration over time frame.
- $\bar{x}$  (%):** Proportion of  $\bar{x}$  to applicable standard (red formatting indicates  $\bar{x}$  is 1000% of the standard; orange formatting indicates  $\bar{x}$  is 100% of the standard; gradation of orange and red are proportional to
- n:** Number of samples over time frame.
- ND:** Number of "non-detect" samples over time frame. For concentrations between LOD and LOQ (reported as "< LOQ"), the LOQ is treated as an additional detection limit in the analysis.
- J:** Number of samples with estimated concentrations (J-values). Currently concentrations between LOD and LOQ are reported as "< LOQ" instead of estimated values.
- >:** Number of exceedances over time frame; date of most recent exceedance.
- Max:** Maximum measured concentration over time frame; date of maximum concentration.
- p (comparison):** p-value of two-group comparison analysis (comparison to upgradient wells).  
Analysis test results based on either: p = parametric (t-test) or n = nonparametric (Wilcoxon test); determined based on number of detections and Shapiro-Wilk (S-W) normality test results.  
If p-value of normality test for either group is < 0.05 then defaults to nonparametric comparison (Wilcoxon test).  
If p (comparison) < 0.05 then: < Up means data are statistically less than upgradient data; > Up means data are statistically greater than upgradient data.

4. "NC" refers to not calculated (when there is insufficient data to run statistical analysis).

**Alkalinity, total as CaCO3 [mg/l]**

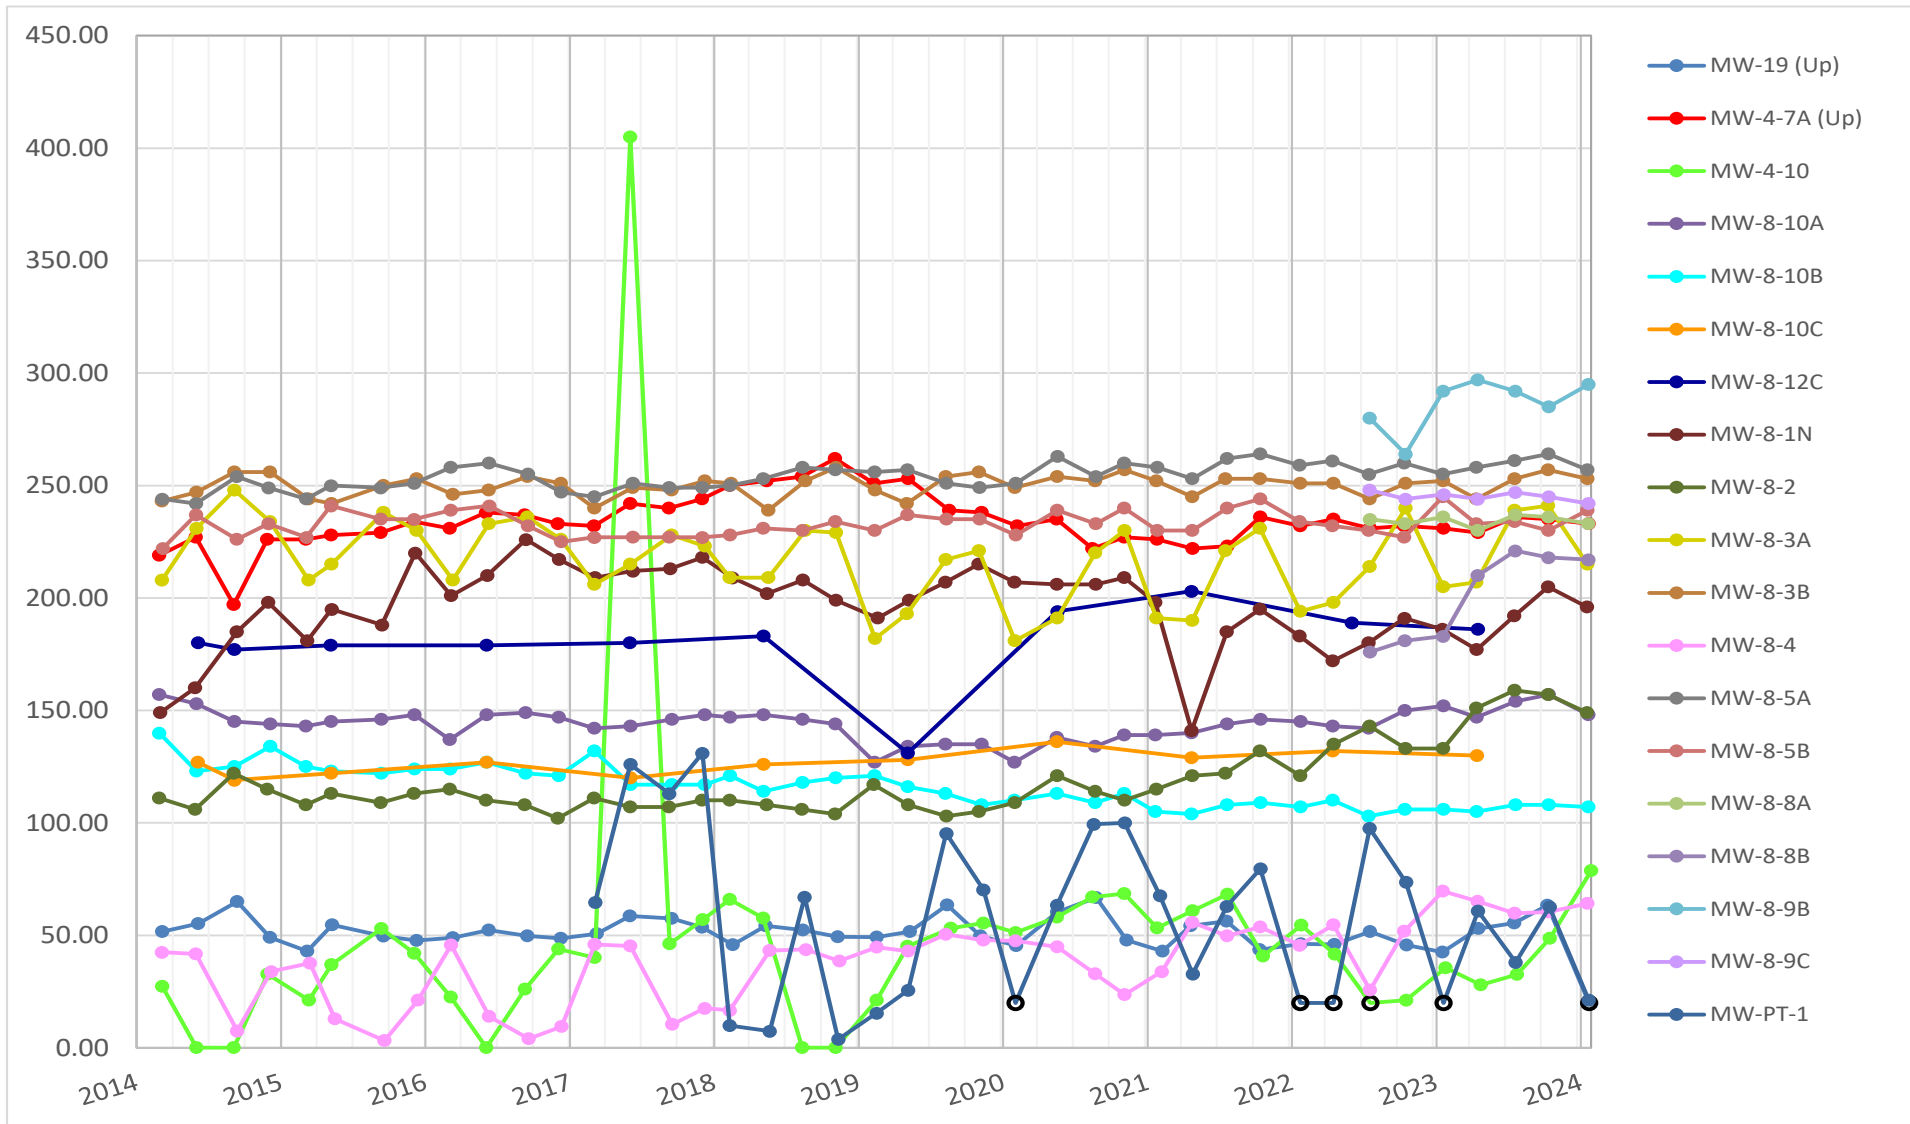



**NOTE: There are no applicable standards for this parameter**

# Talen Energy



Brunner Island - Basin 5

1st Quarter 2024


## Aluminum, dissolved [ $\mu\text{g/l}$ ]

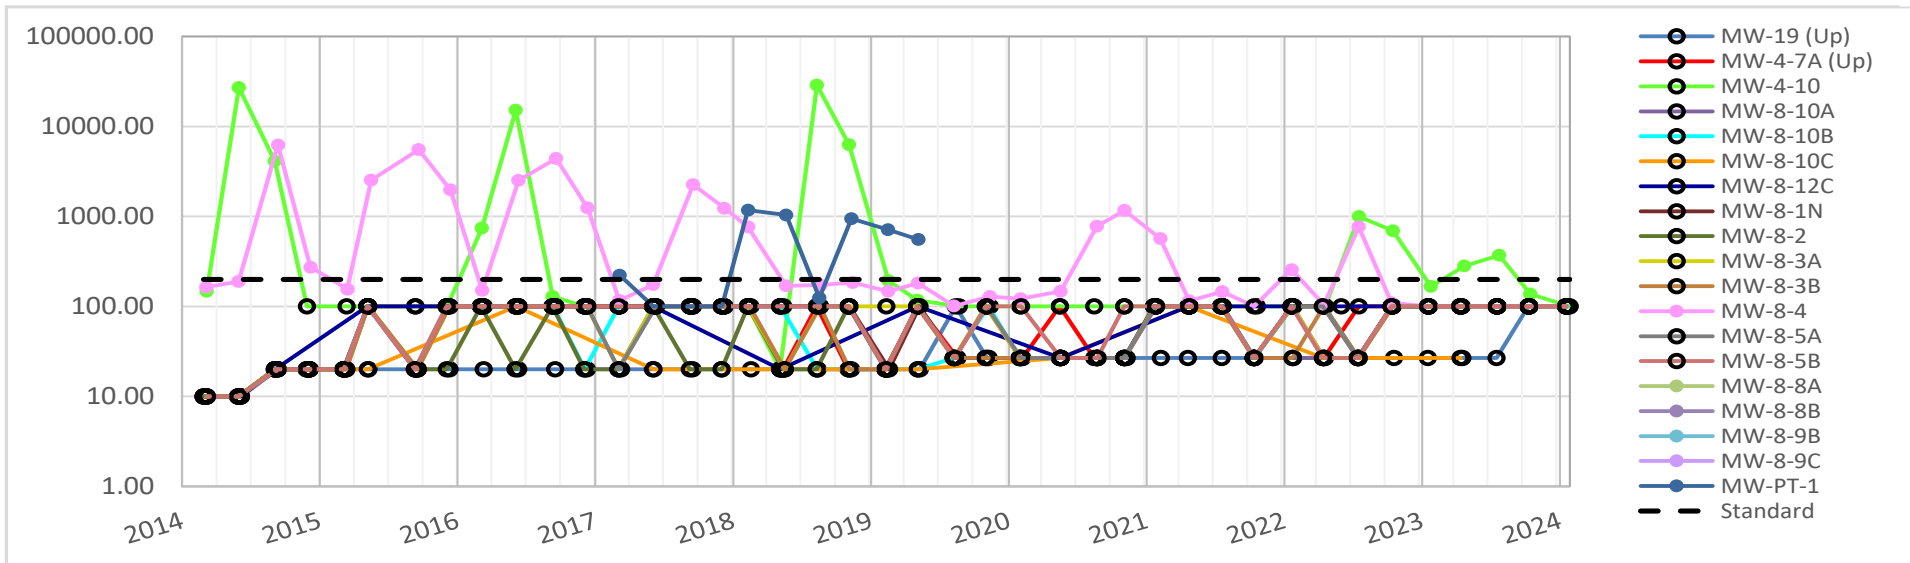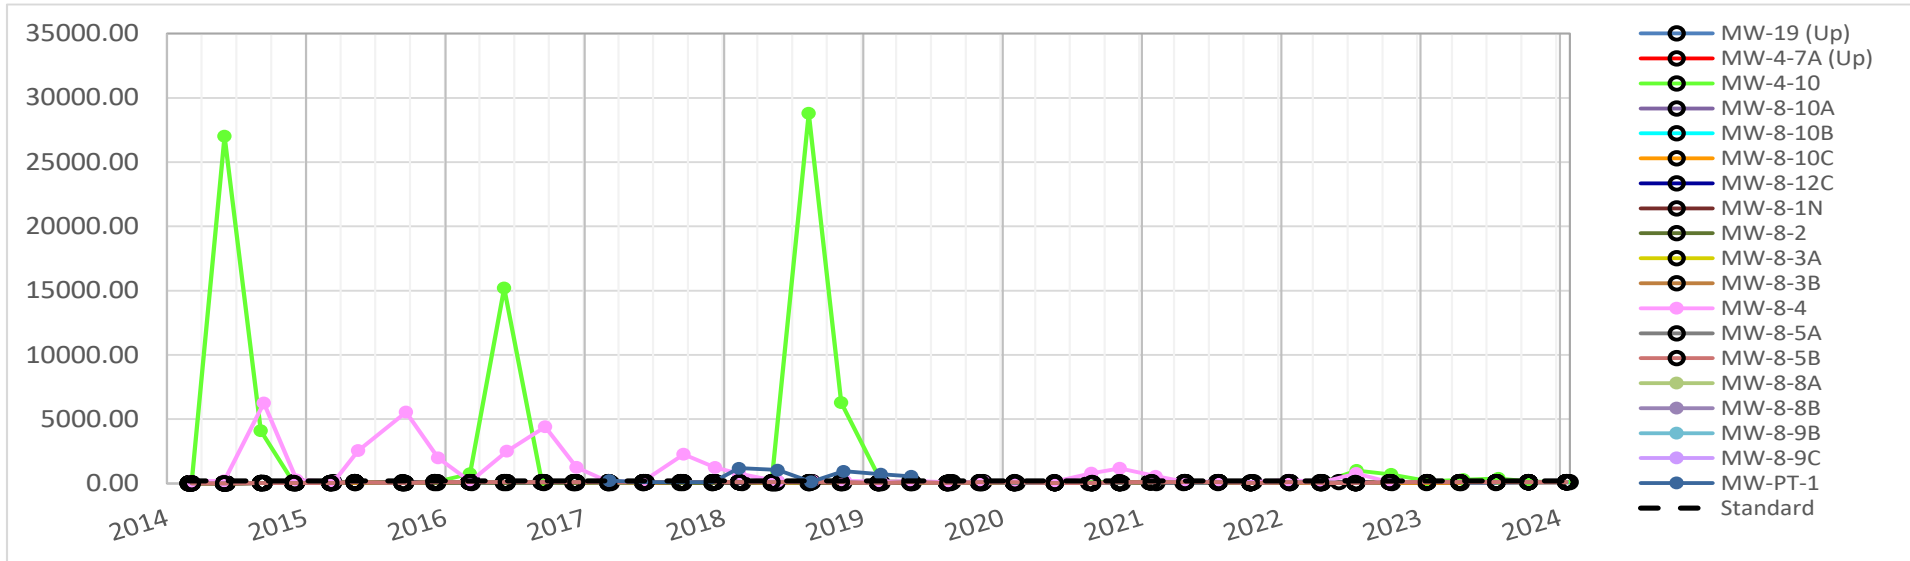

**Aluminum, total [ $\mu\text{g/l}$ ]**

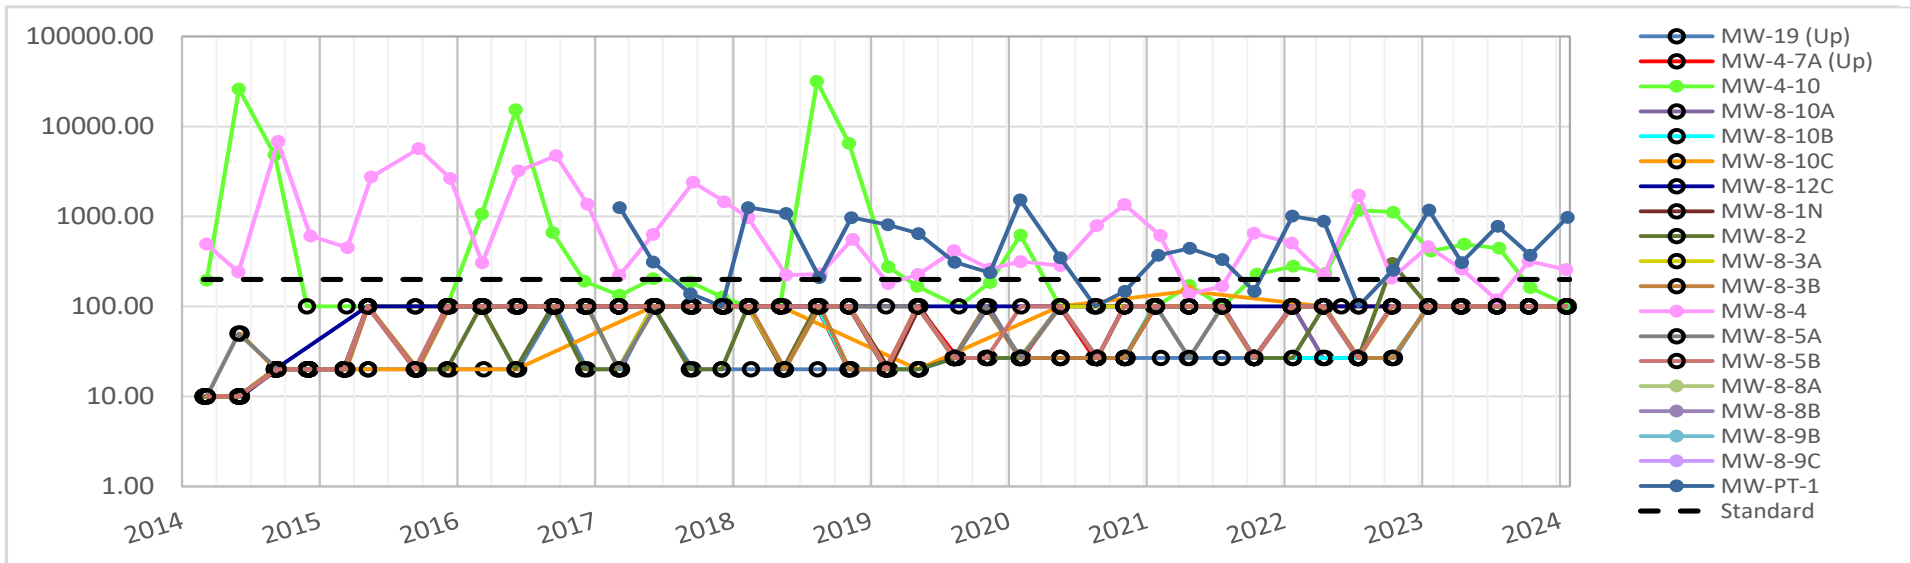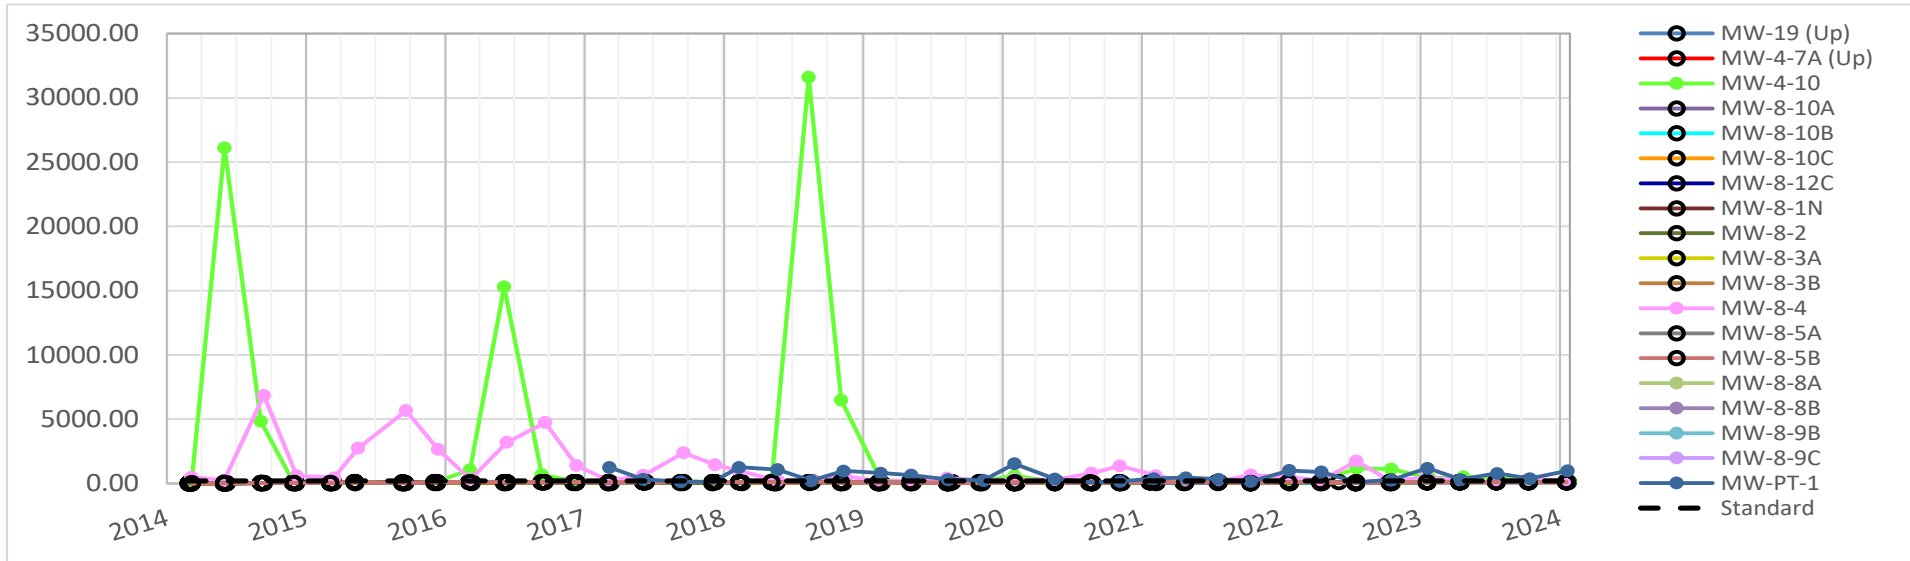


**Ammonia, as N [mg/l]**

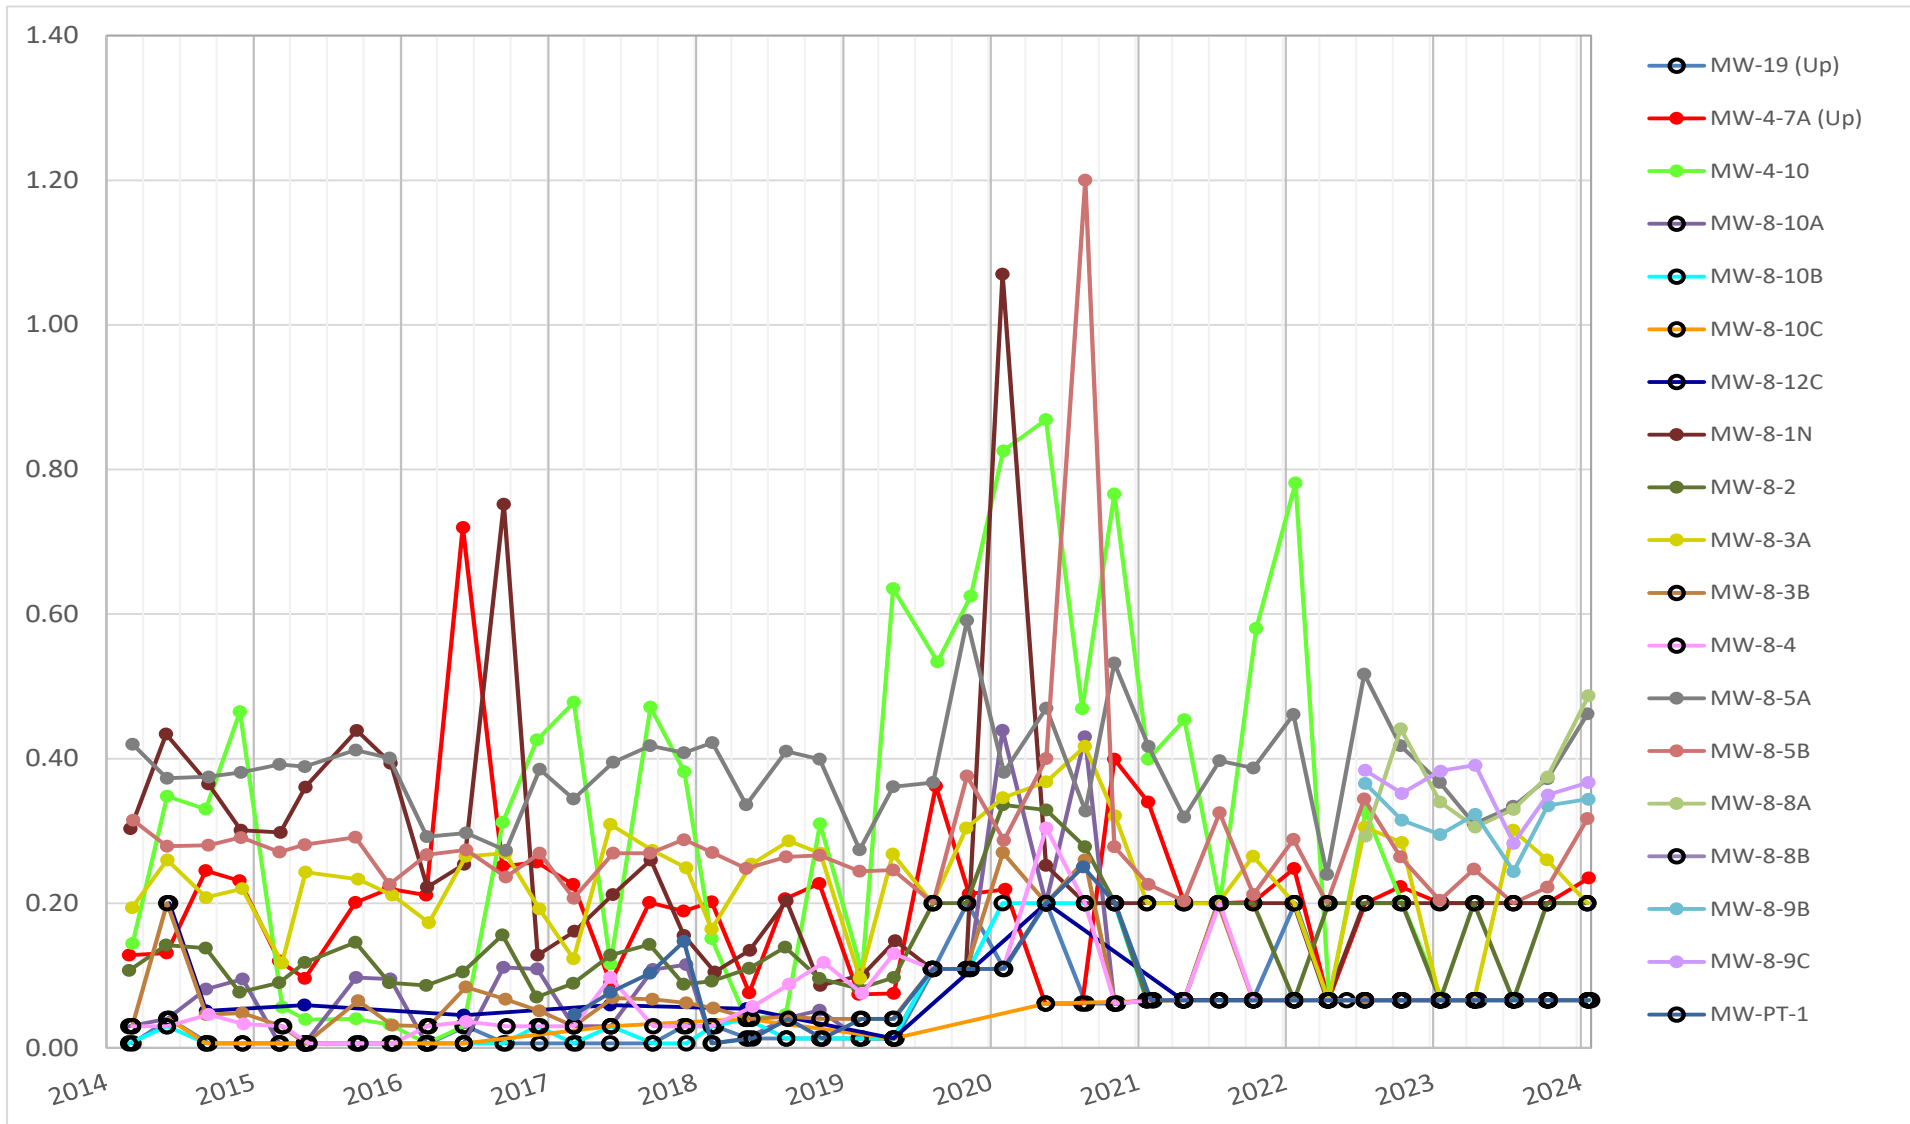


**NOTE: There are no applicable standards for this parameter**

**Antimony, dissolved [ $\mu\text{g/l}$ ]**

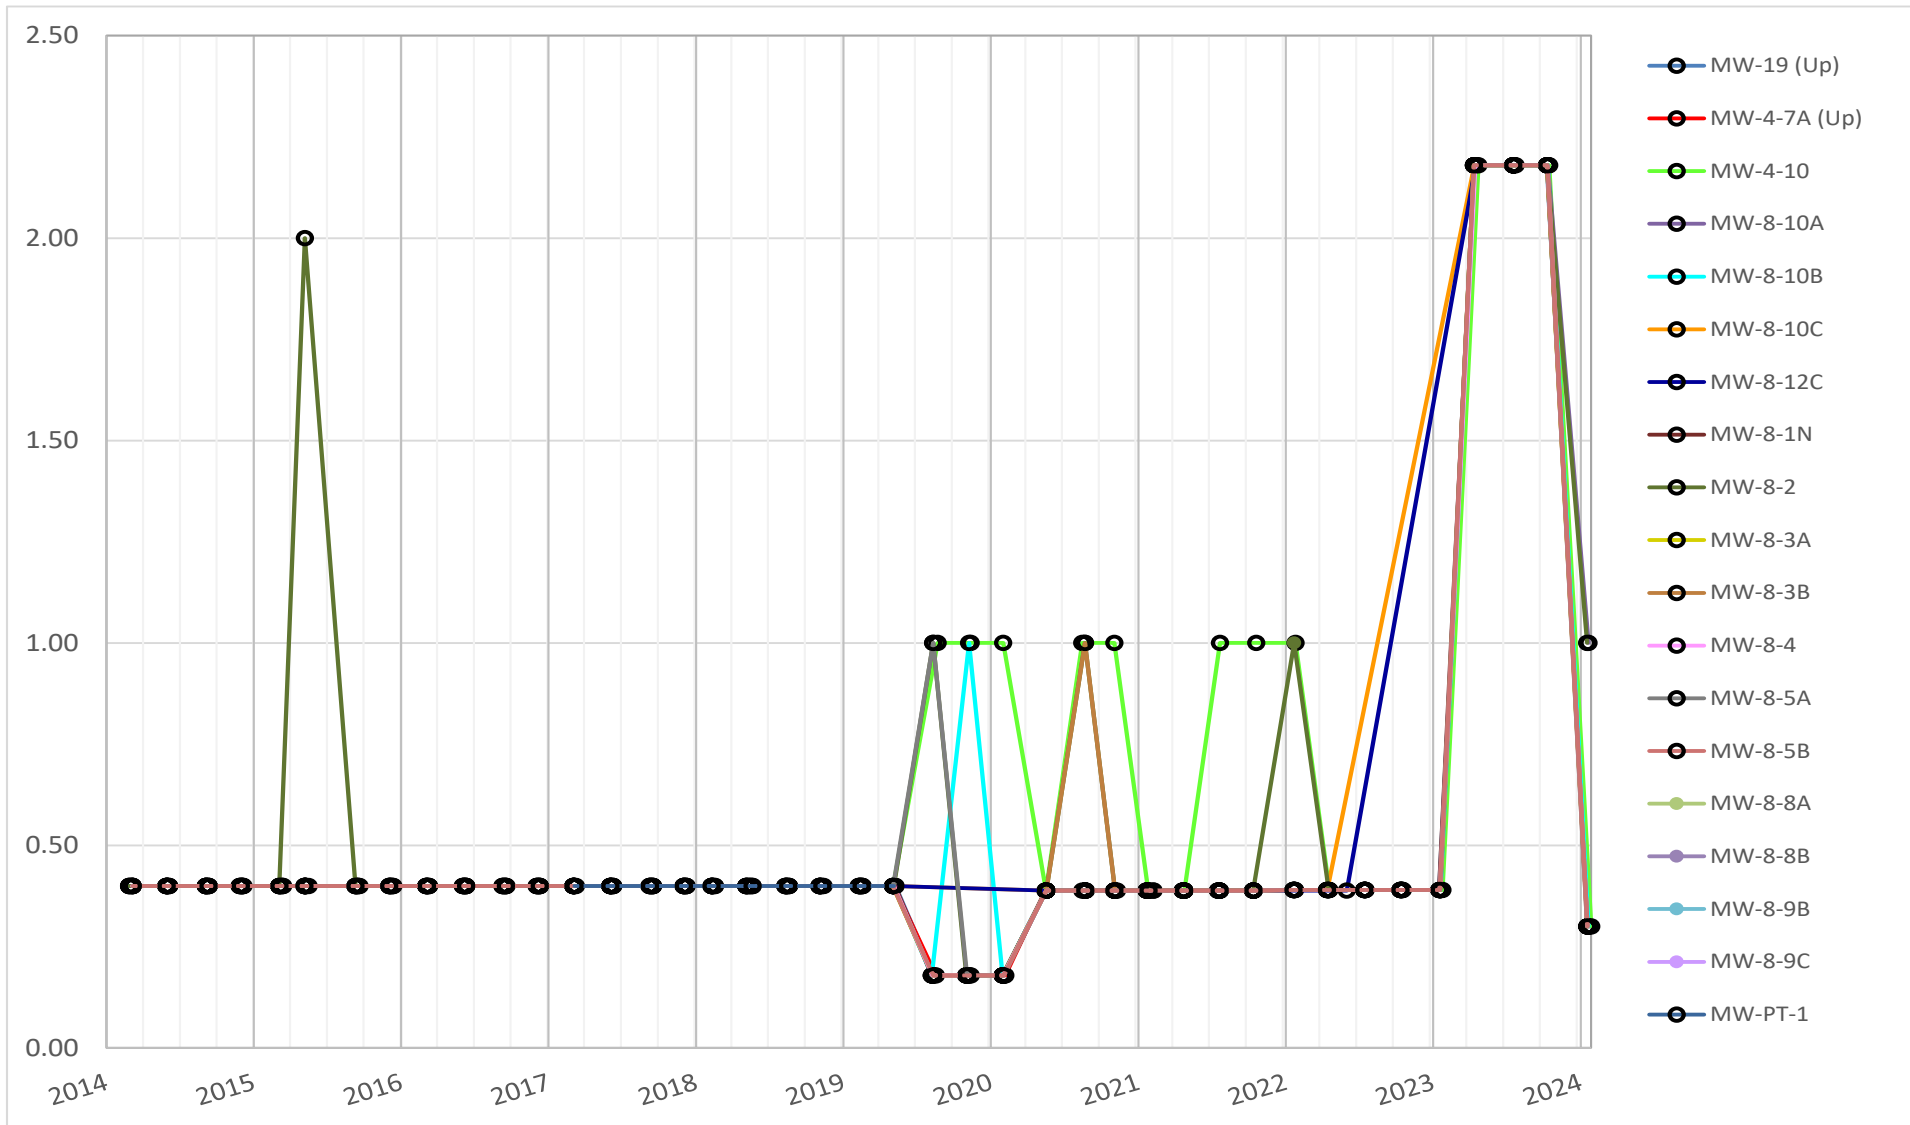



**NOTE: Data does not exceed standard of 6  $\mu\text{g/l}$  during this time frame**

**Antimony, total [ $\mu\text{g}/\text{l}$ ]**

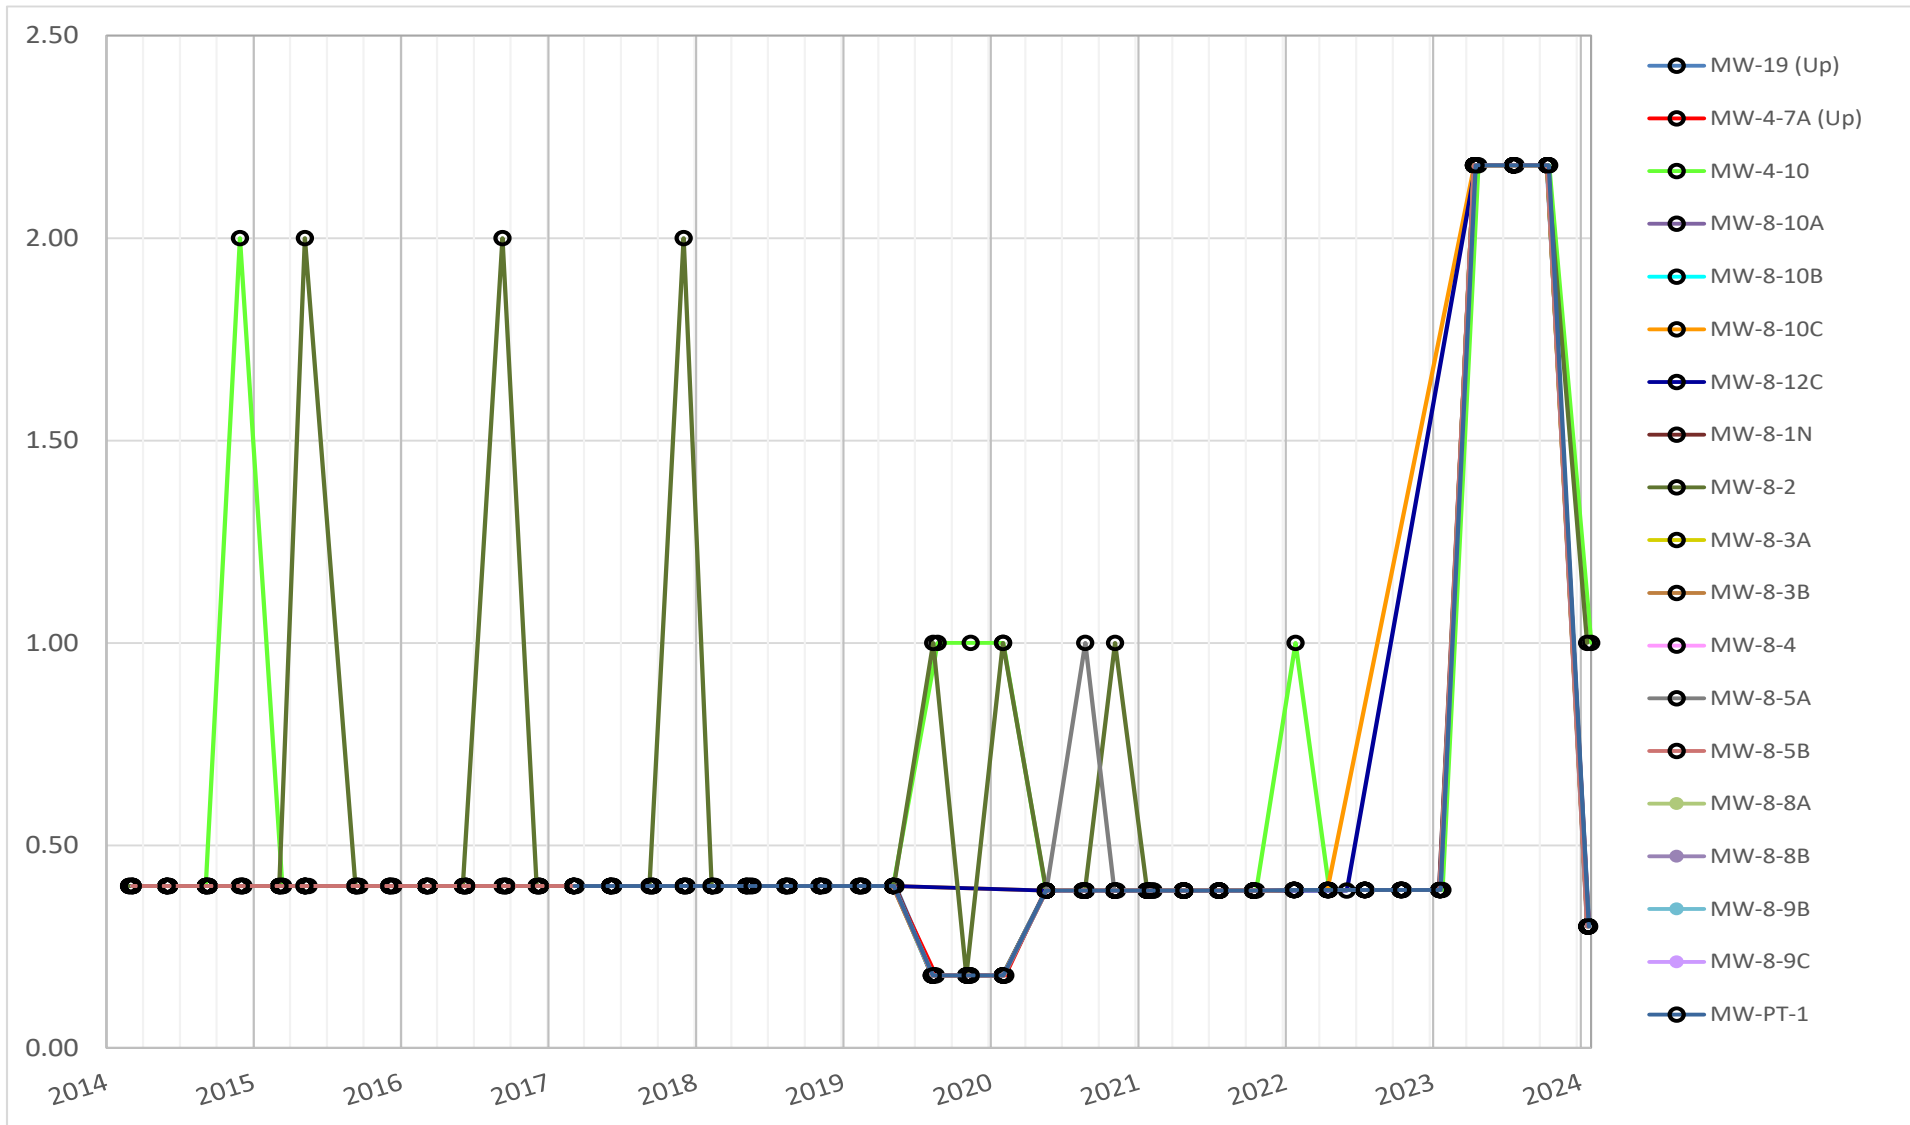


**NOTE: Data does not exceed standard of 6  $\mu\text{g}/\text{l}$  during this time frame**

**Arsenic, dissolved [ $\mu\text{g/l}$ ]**

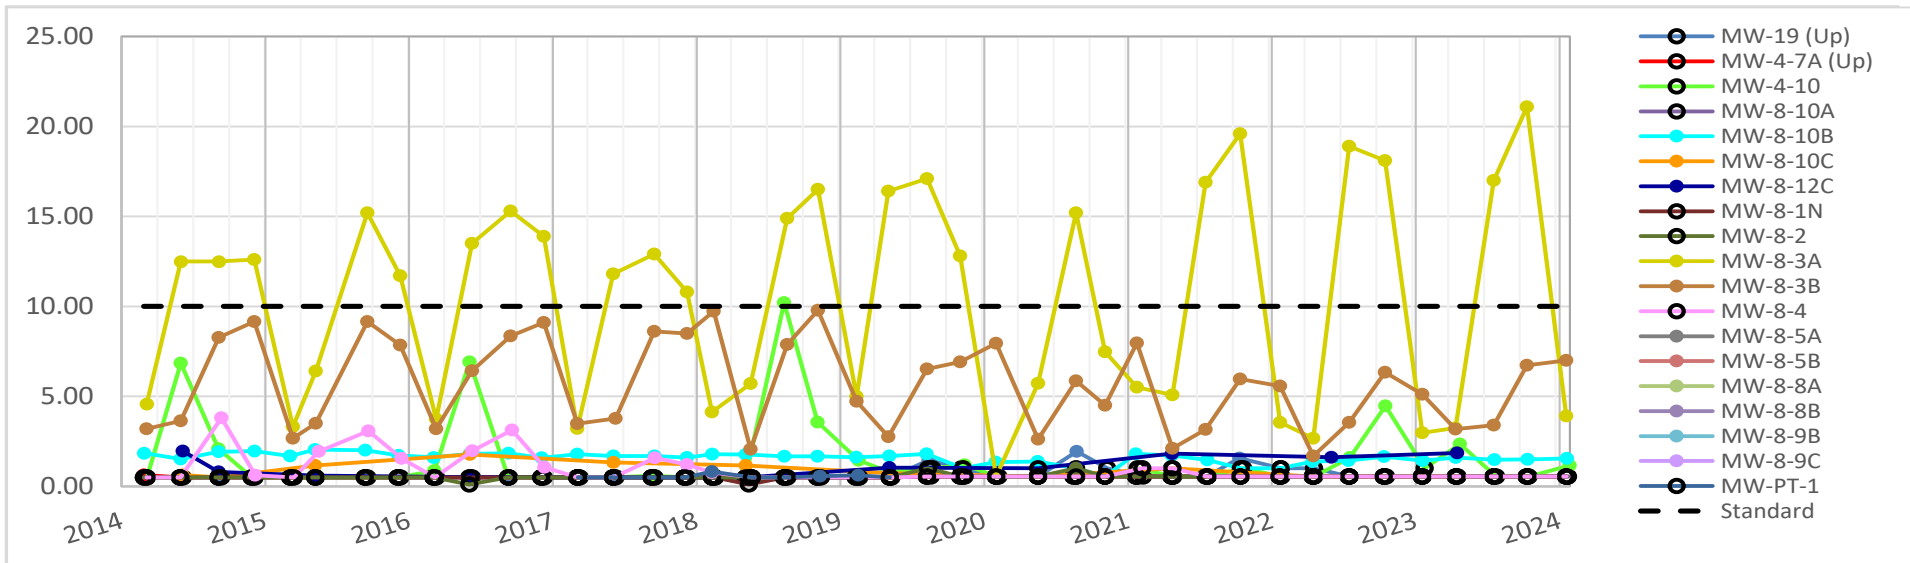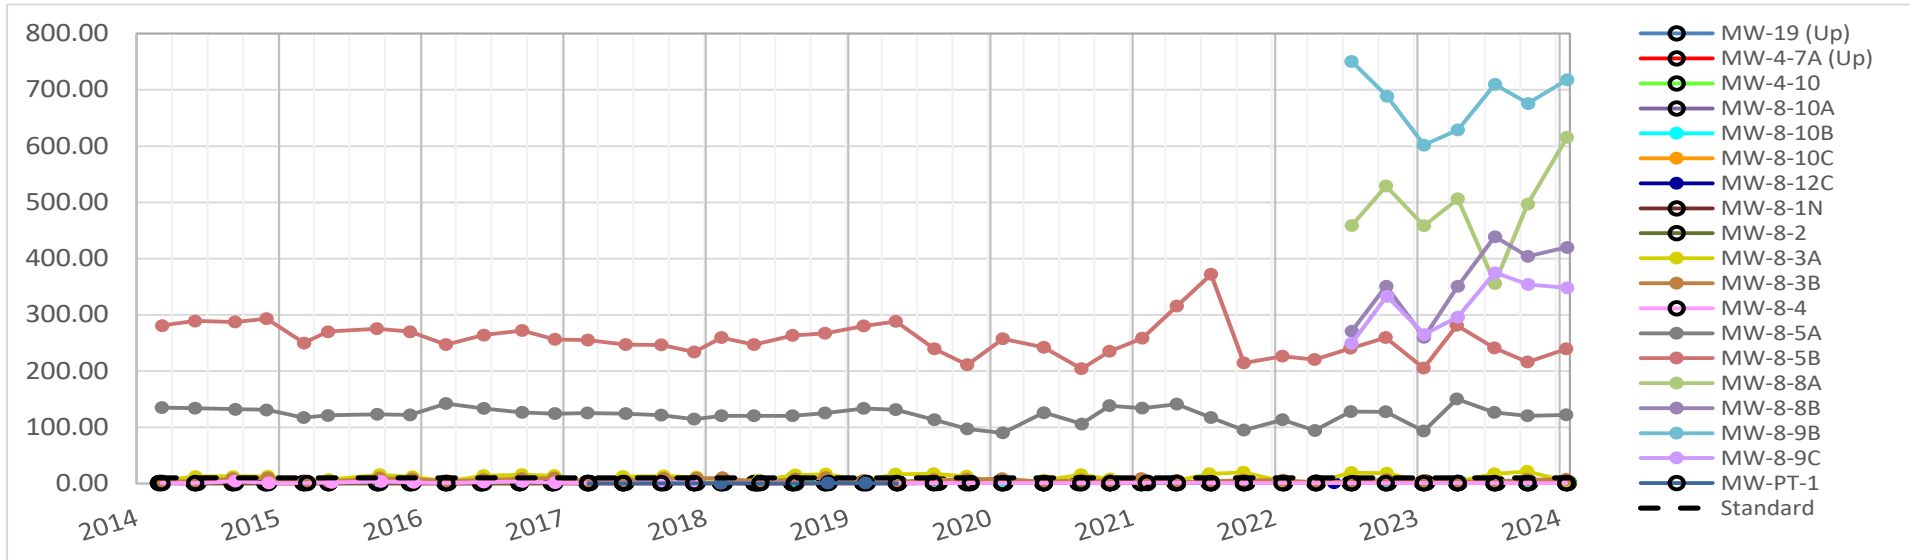




**Barium, dissolved [ $\mu\text{g}/\text{l}$ ]**

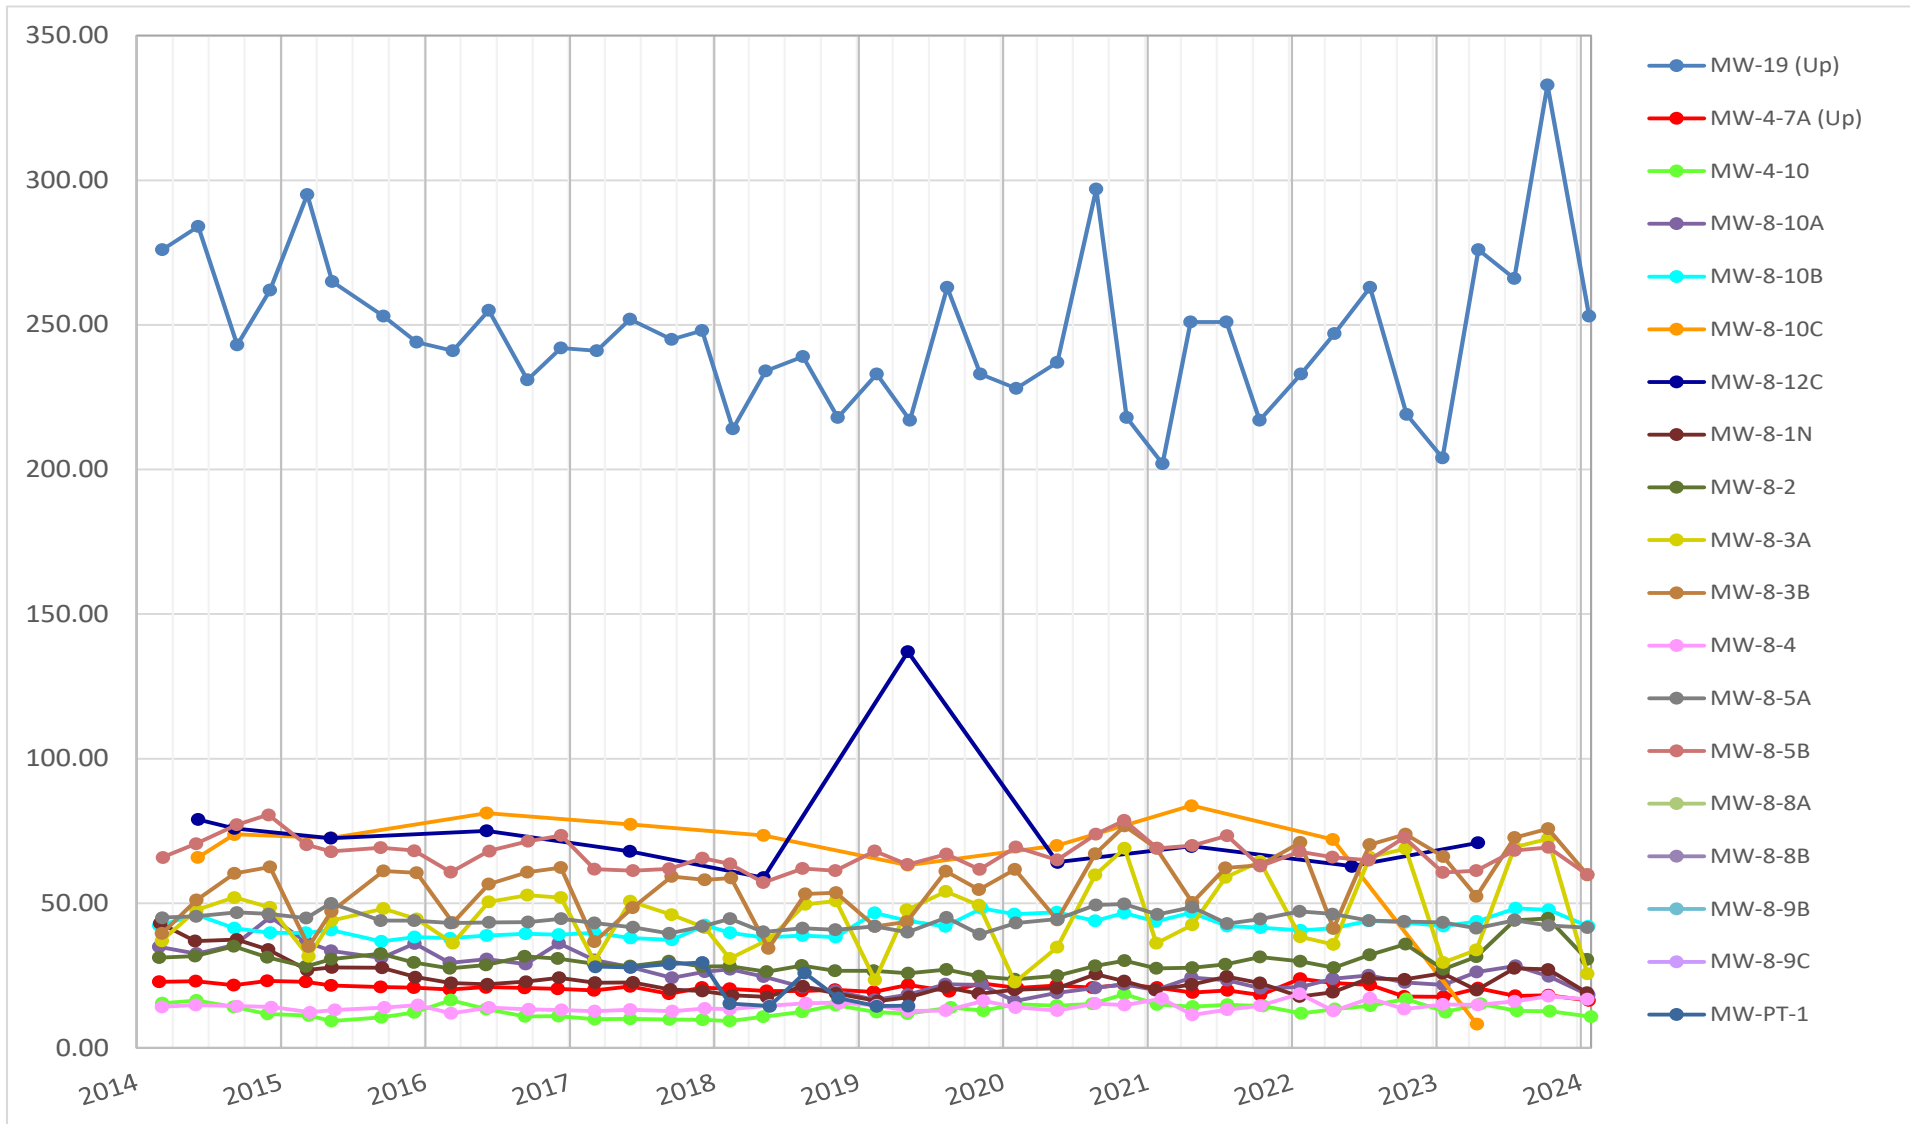

**NOTE: Data does not exceed standard of 2000  $\mu\text{g}/\text{l}$  during this time frame**

**Barium, total [ $\mu\text{g/l}$ ]**

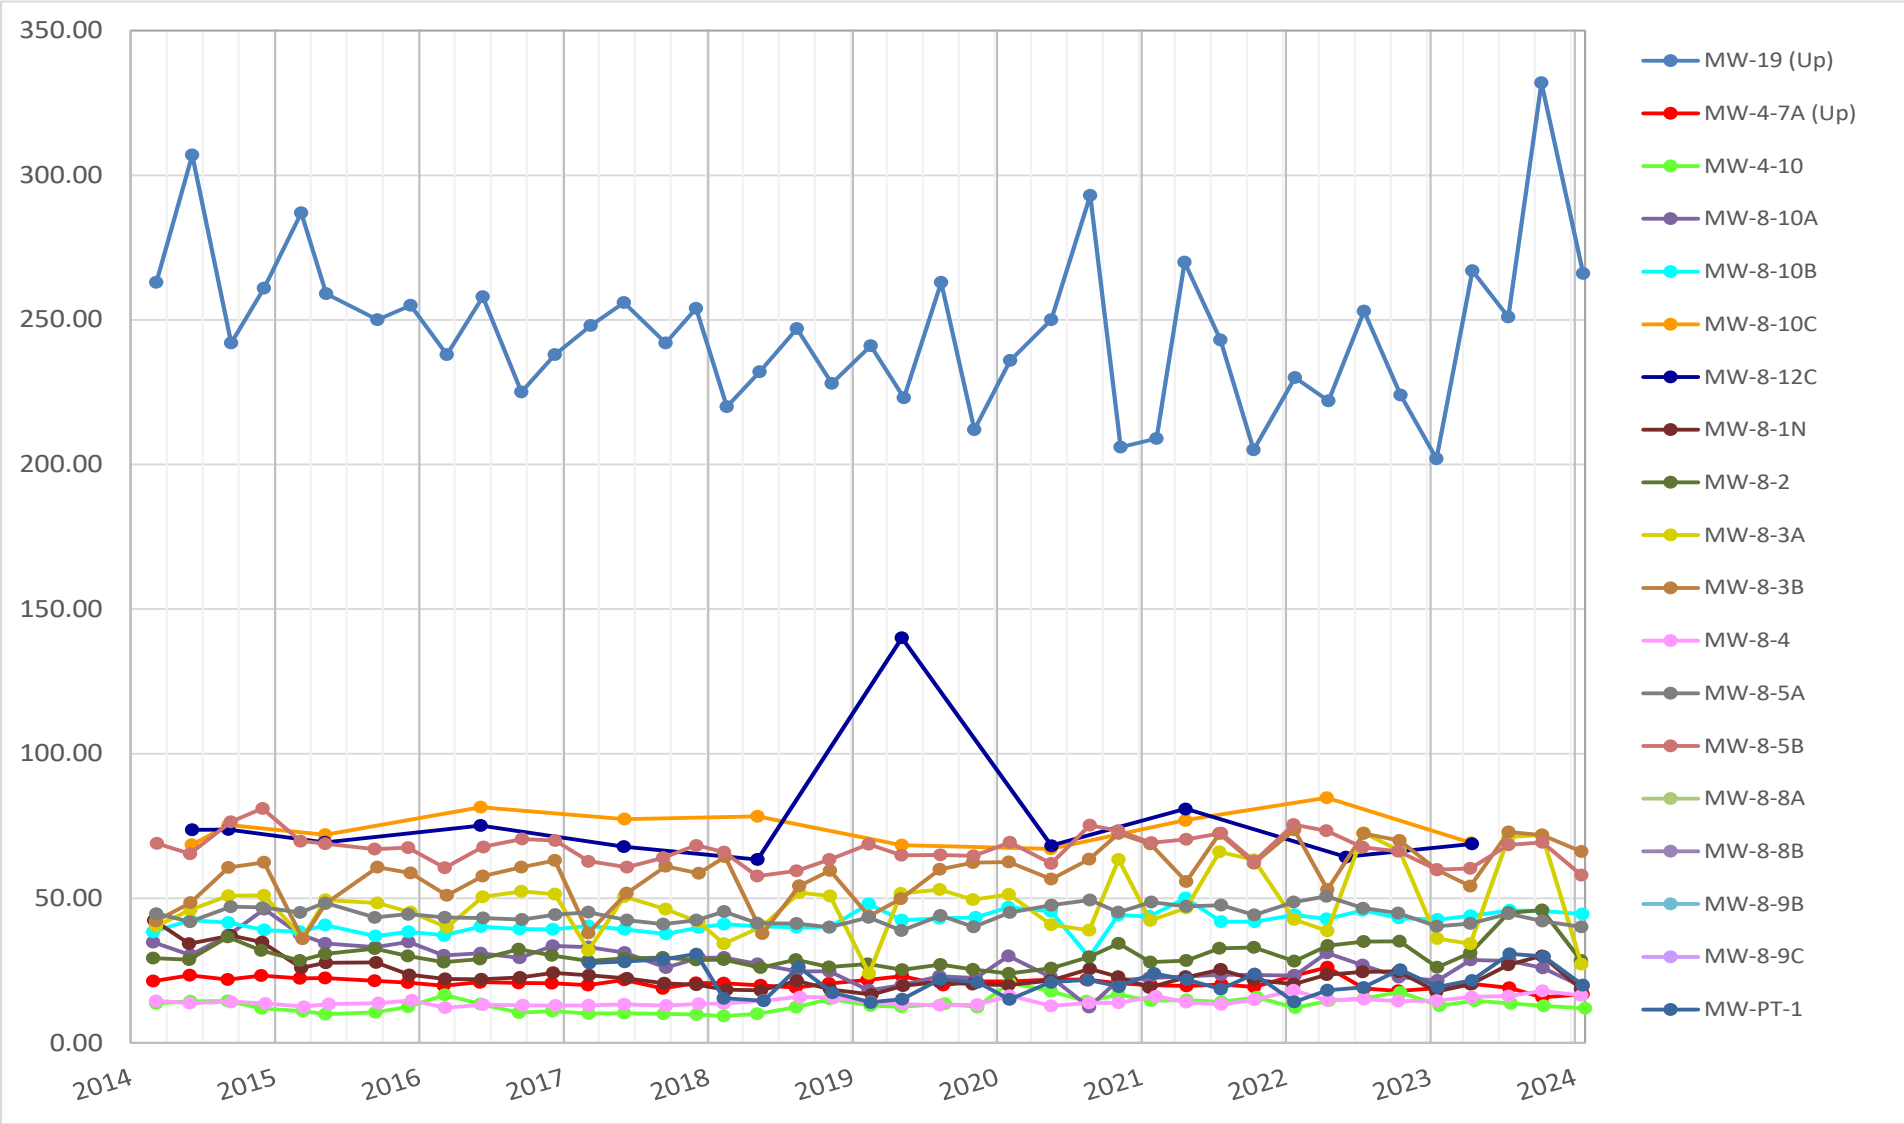


**NOTE: Data does not exceed standard of 2000  $\mu\text{g/l}$  during this time frame**






**Bicarbonate [mg/l]**

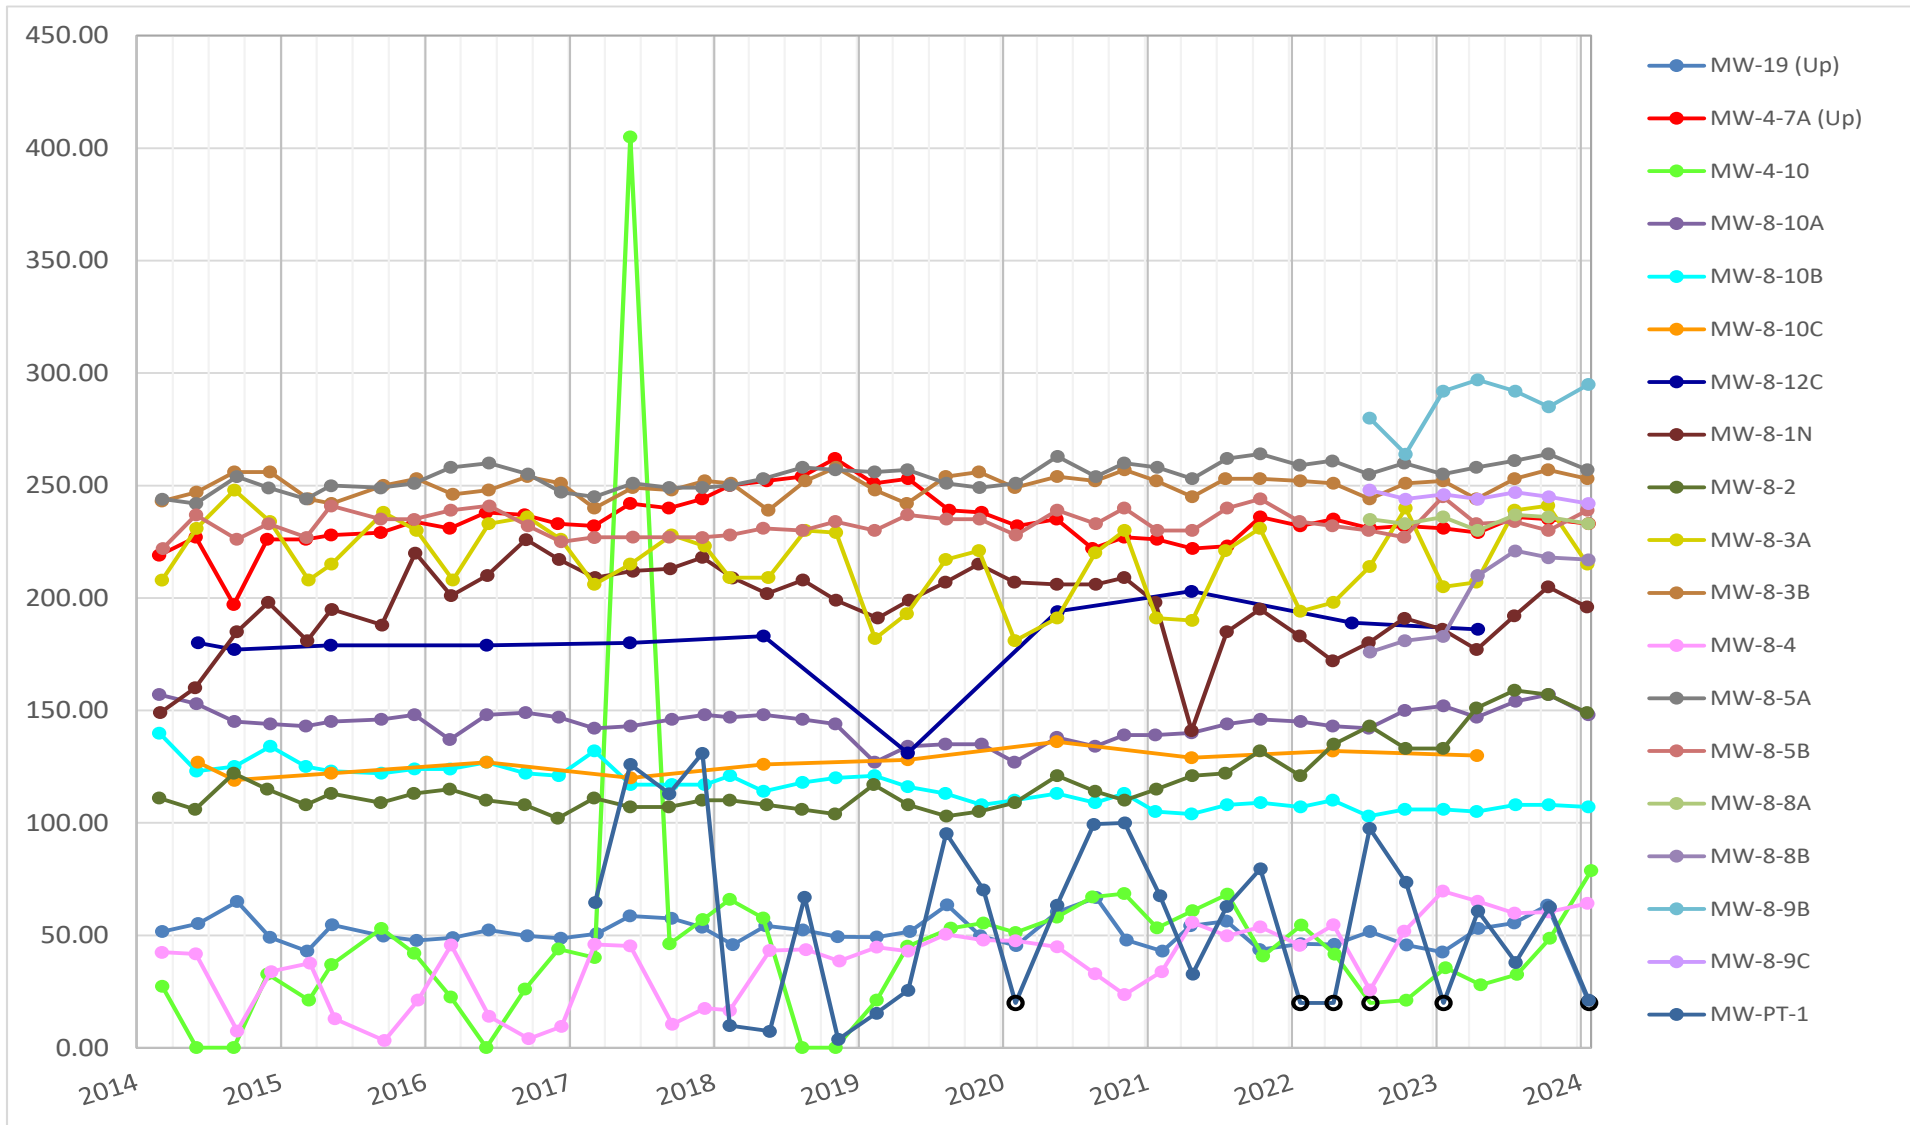


**NOTE: There are no applicable standards for this parameter**

**Boron, dissolved [ $\mu\text{g/l}$ ]**

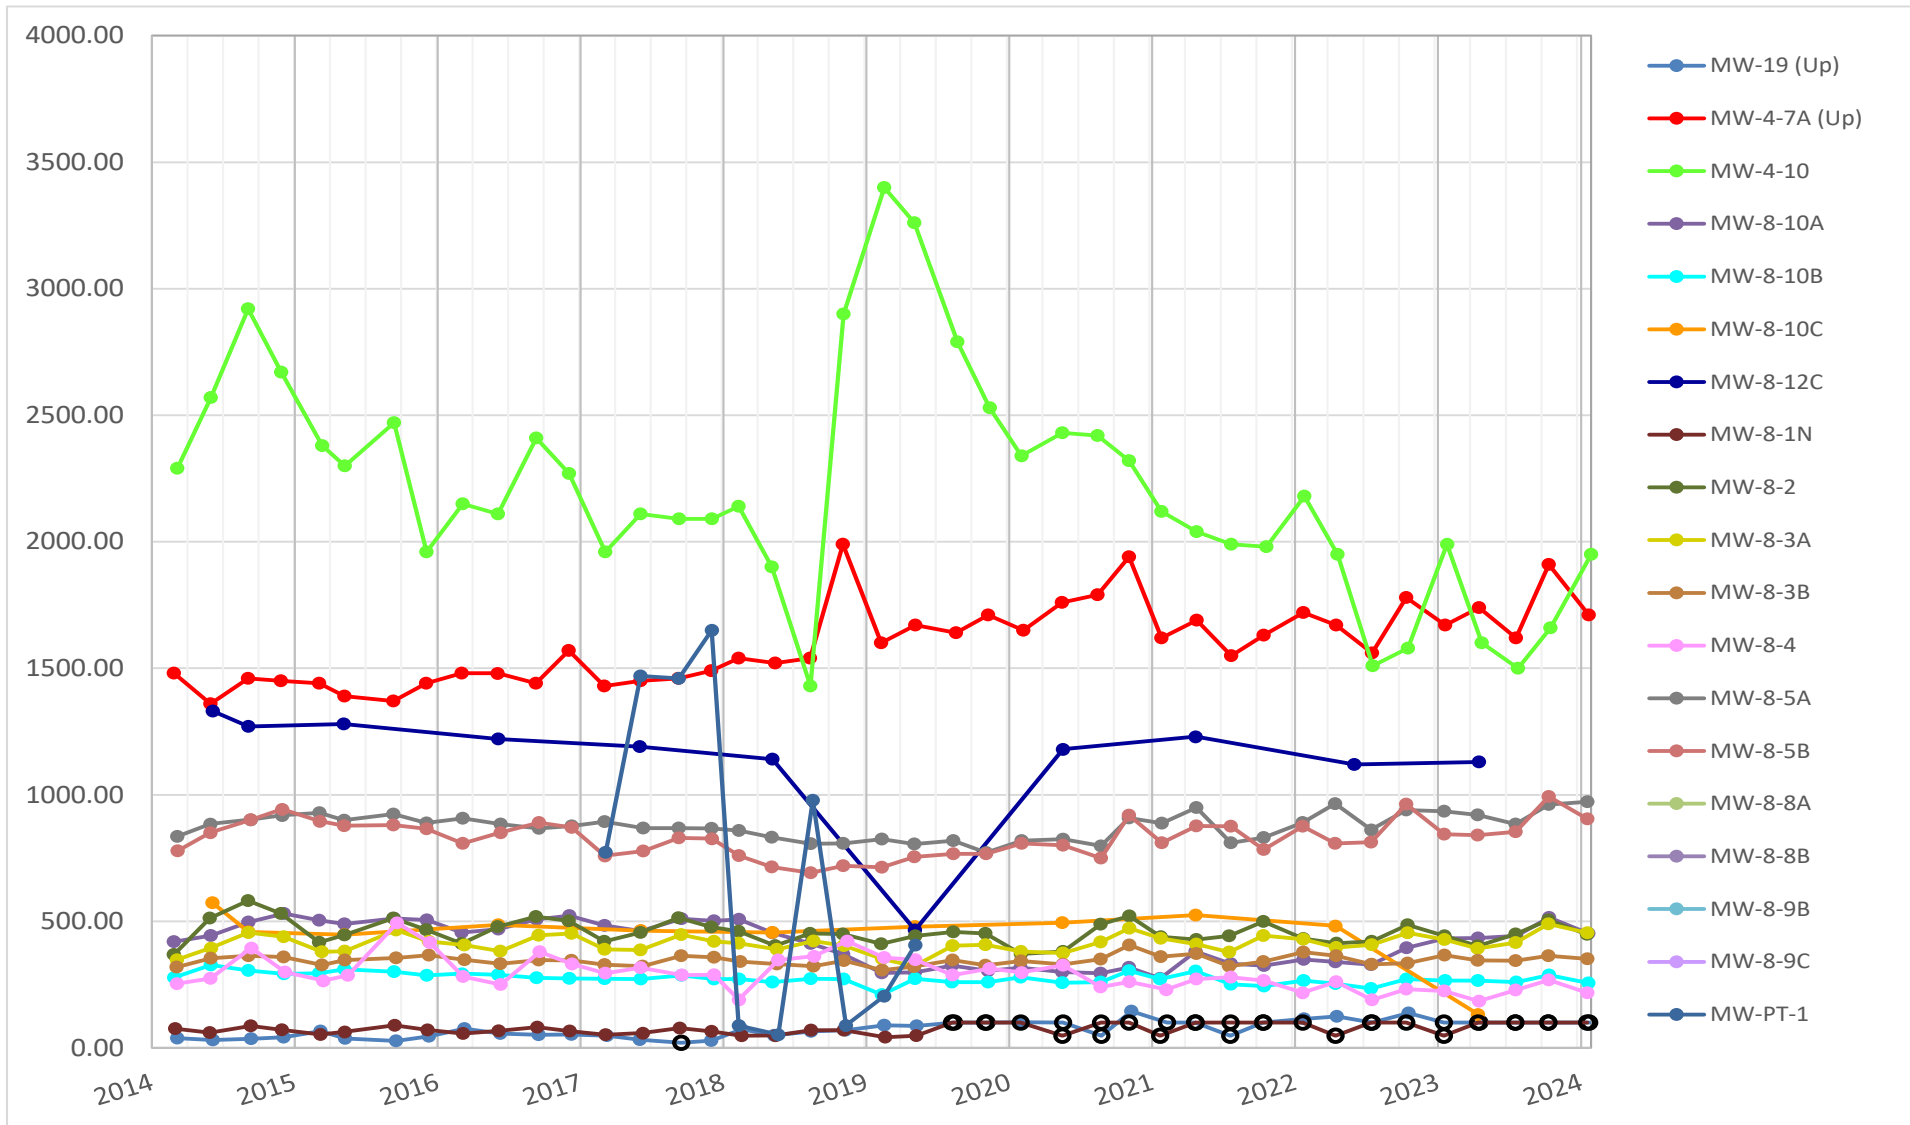

**NOTE: Data does not exceed standard of 6000  $\mu\text{g/l}$  during this time frame**

**Boron, total [ $\mu\text{g/l}$ ]**

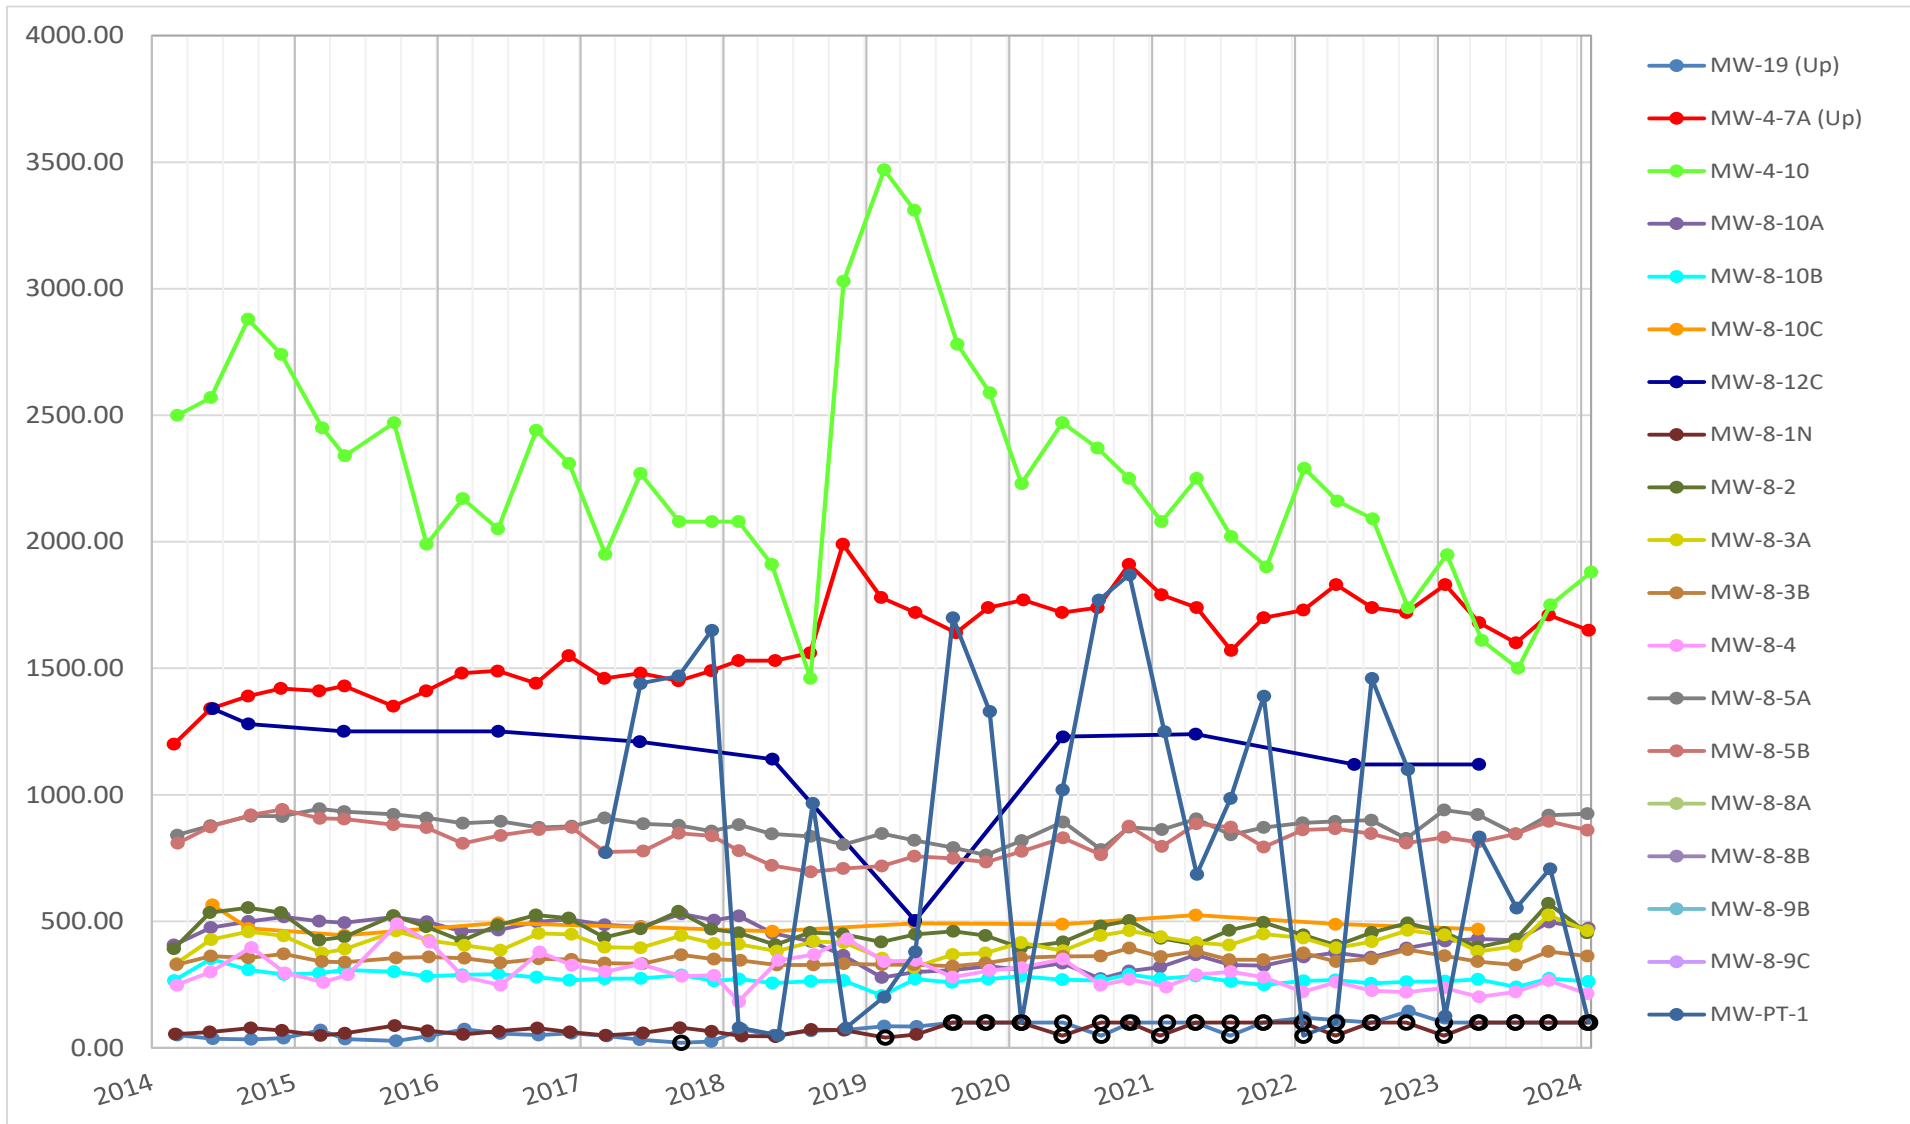


**NOTE: Data does not exceed standard of 6000  $\mu\text{g/l}$  during this time frame**






**Calcium, dissolved [mg/l]**

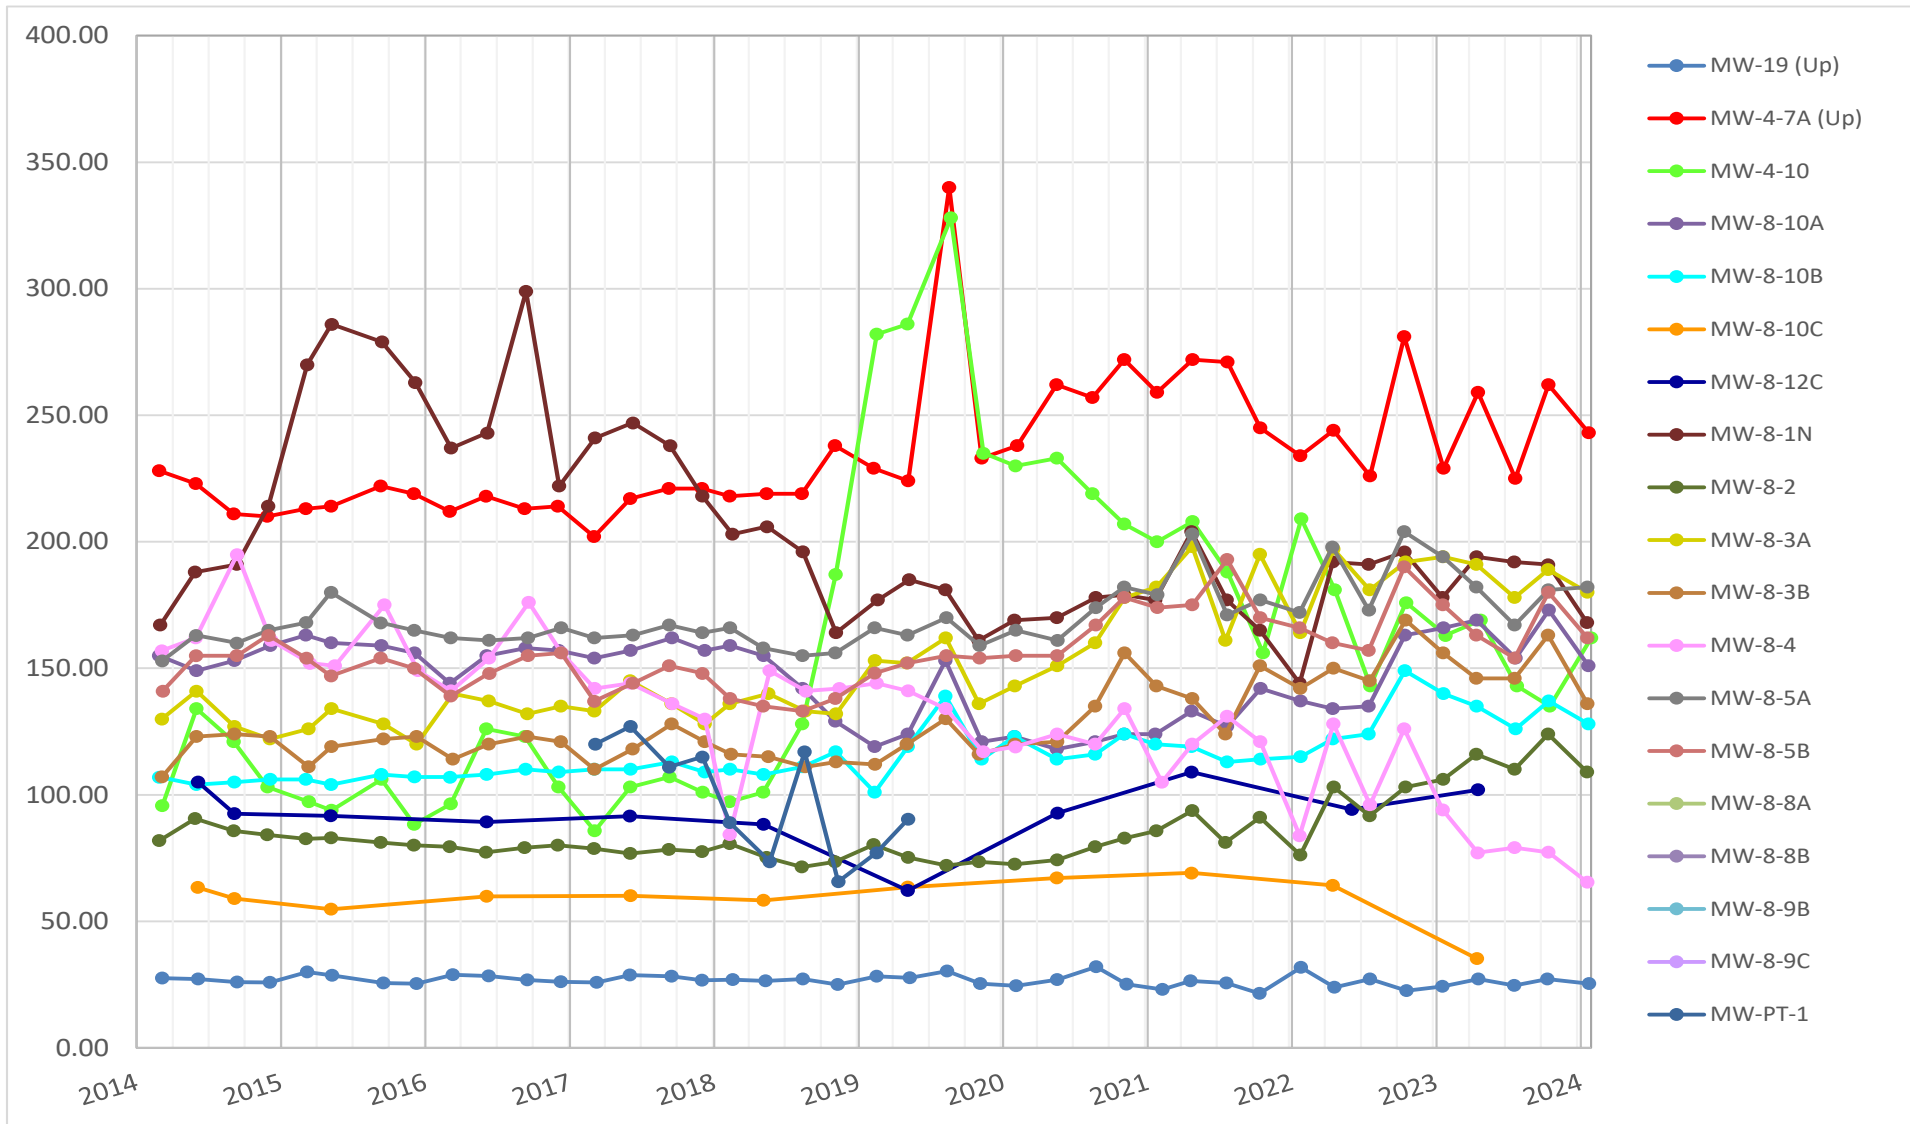


**NOTE: There are no applicable standards for this parameter**

**Calcium, total [mg/l]**

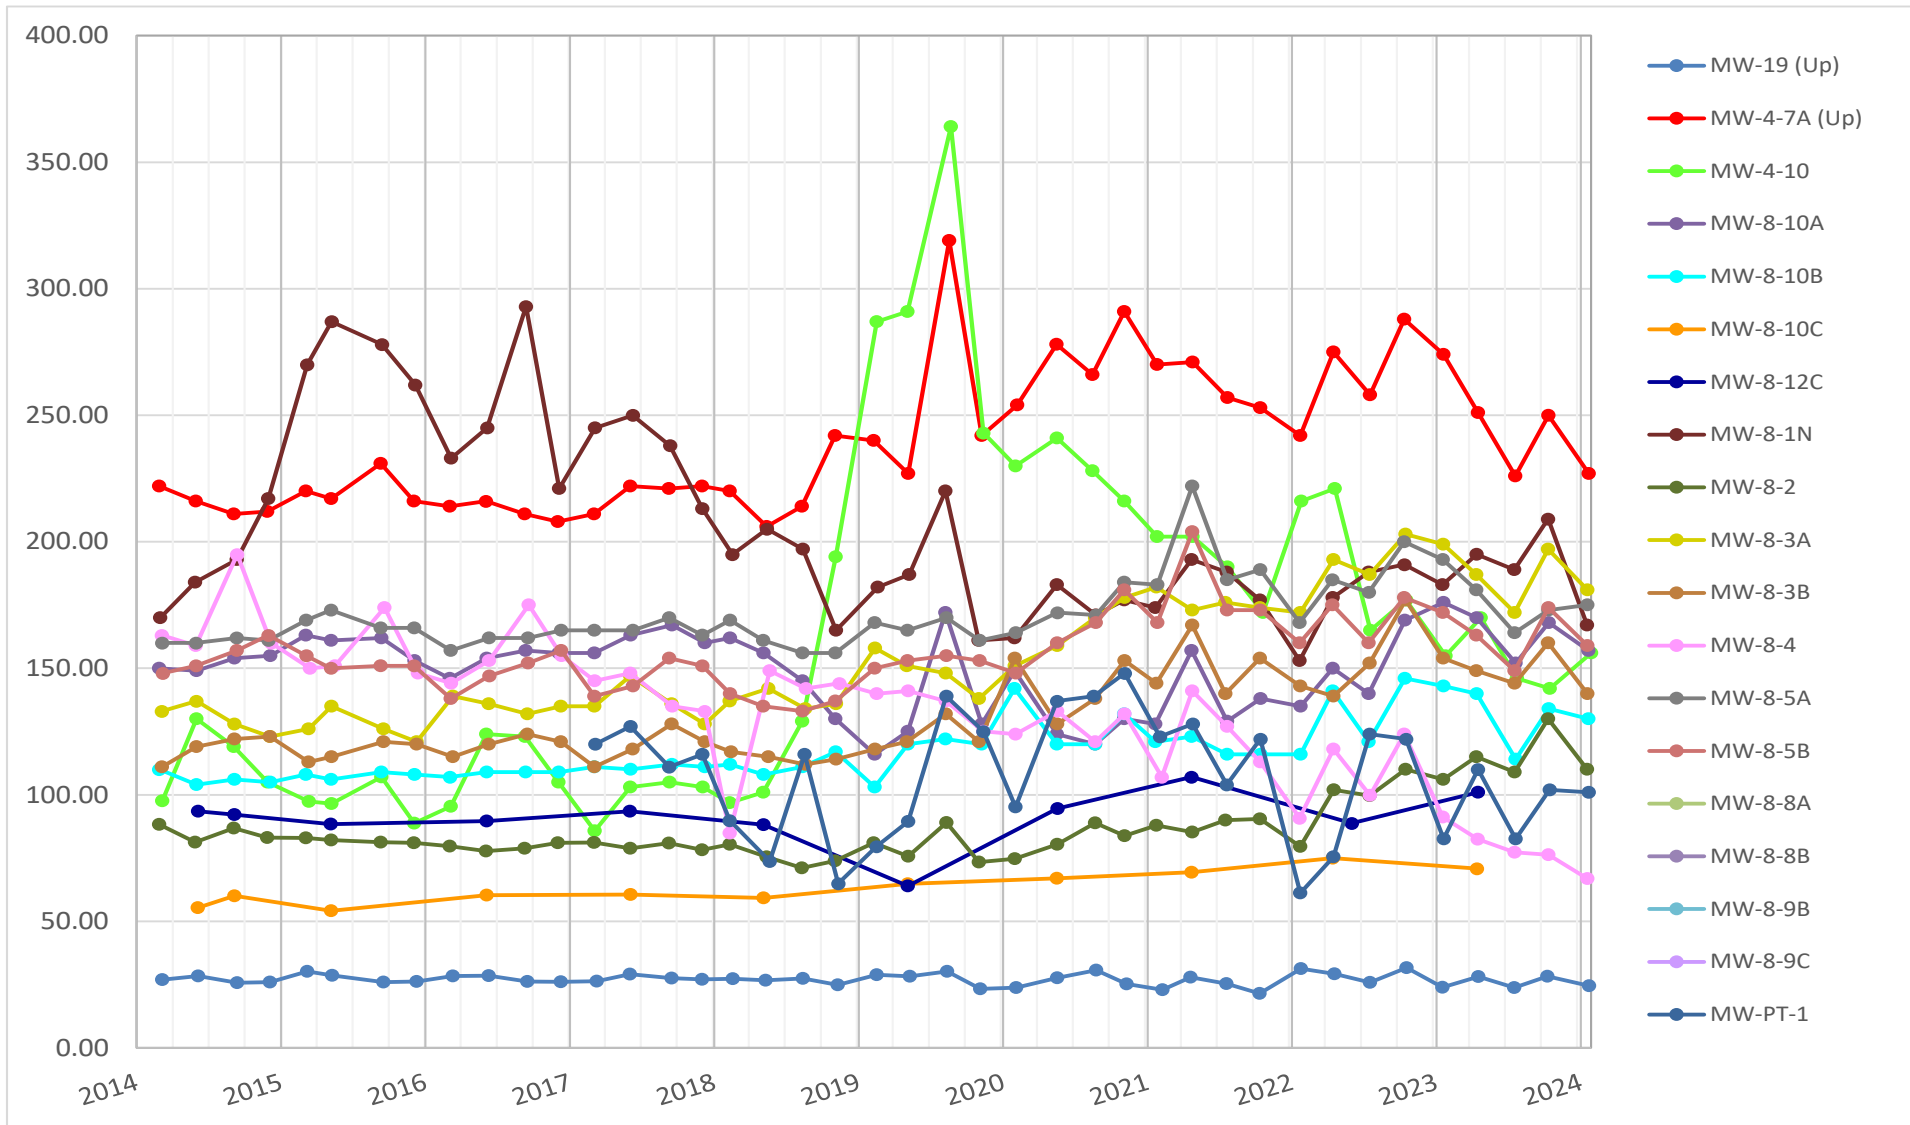



**NOTE: There are no applicable standards for this parameter**

**Chemical Oxygen Demand [mg/l]**

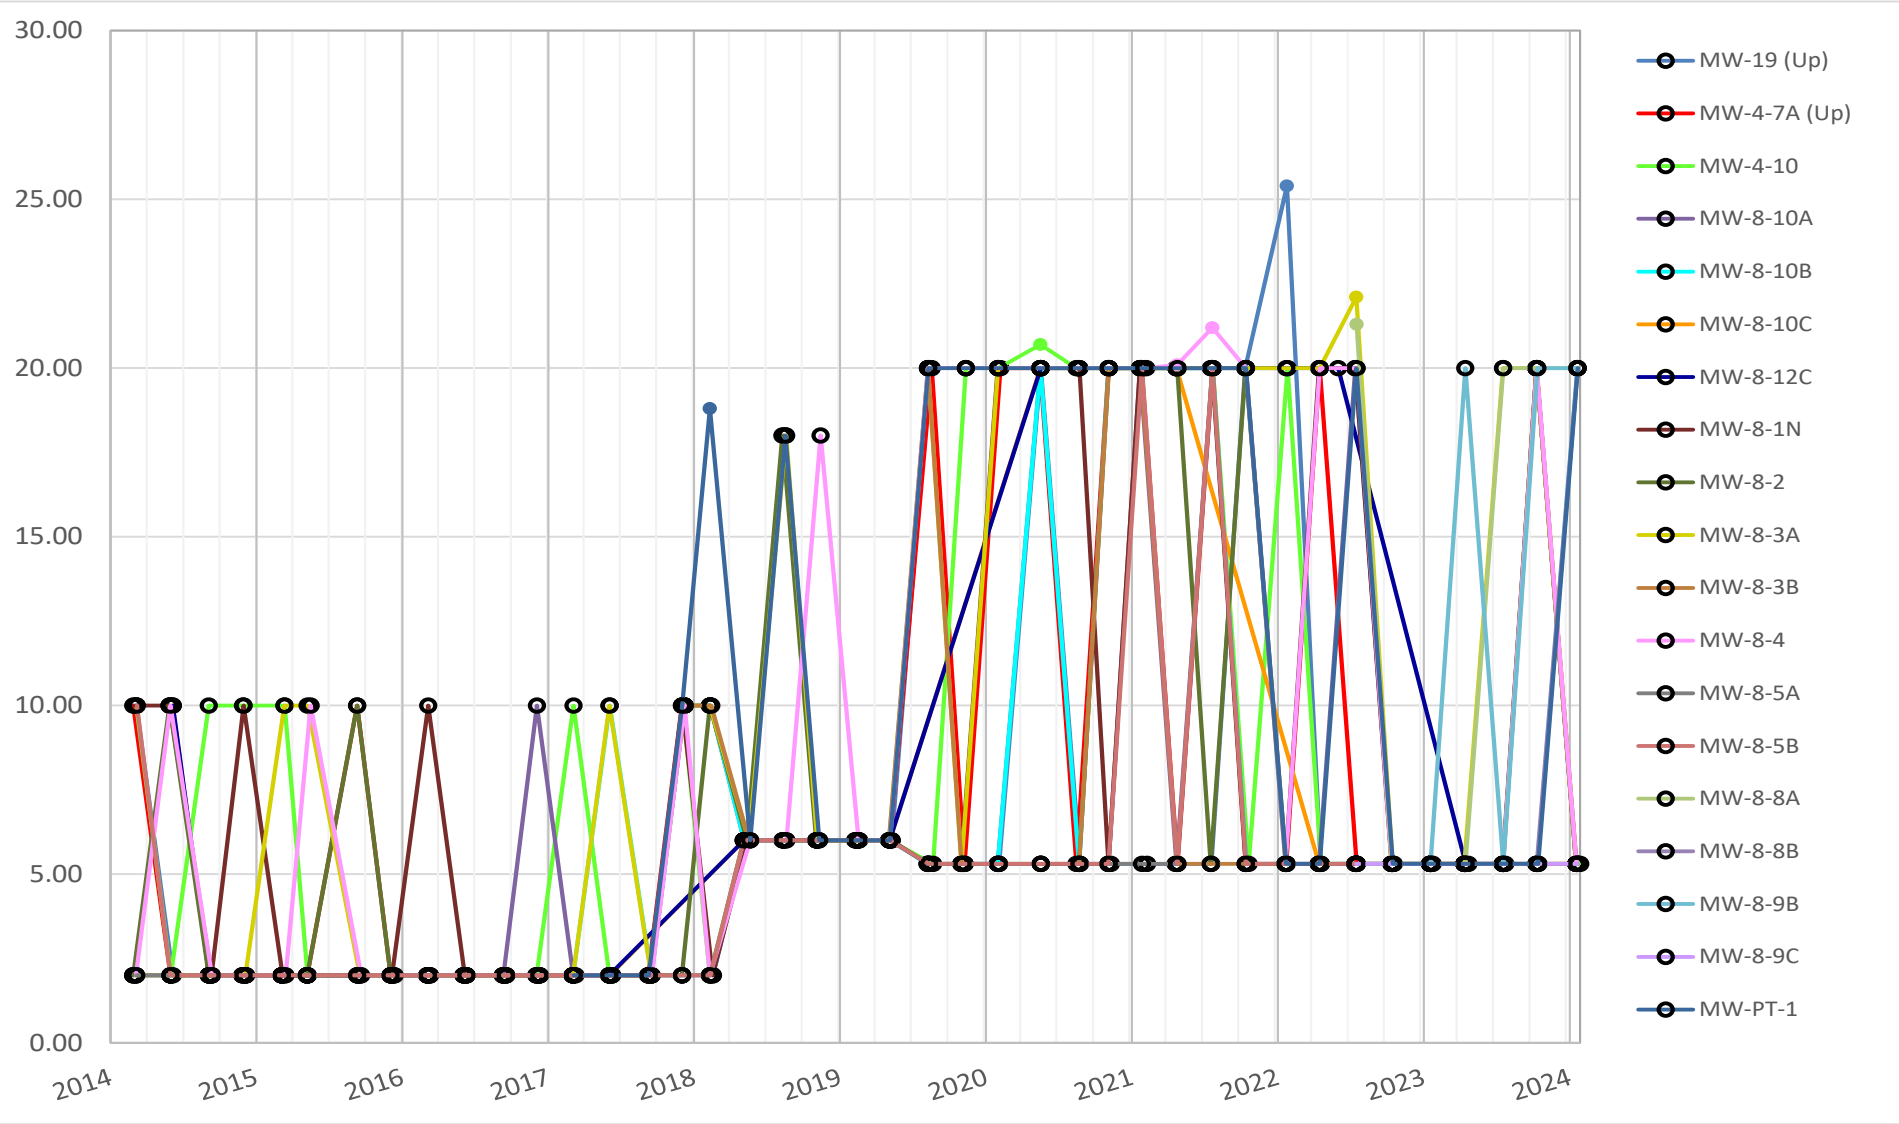


**NOTE: There are no applicable standards for this parameter**

Chloride, total as Cl [mg/l]

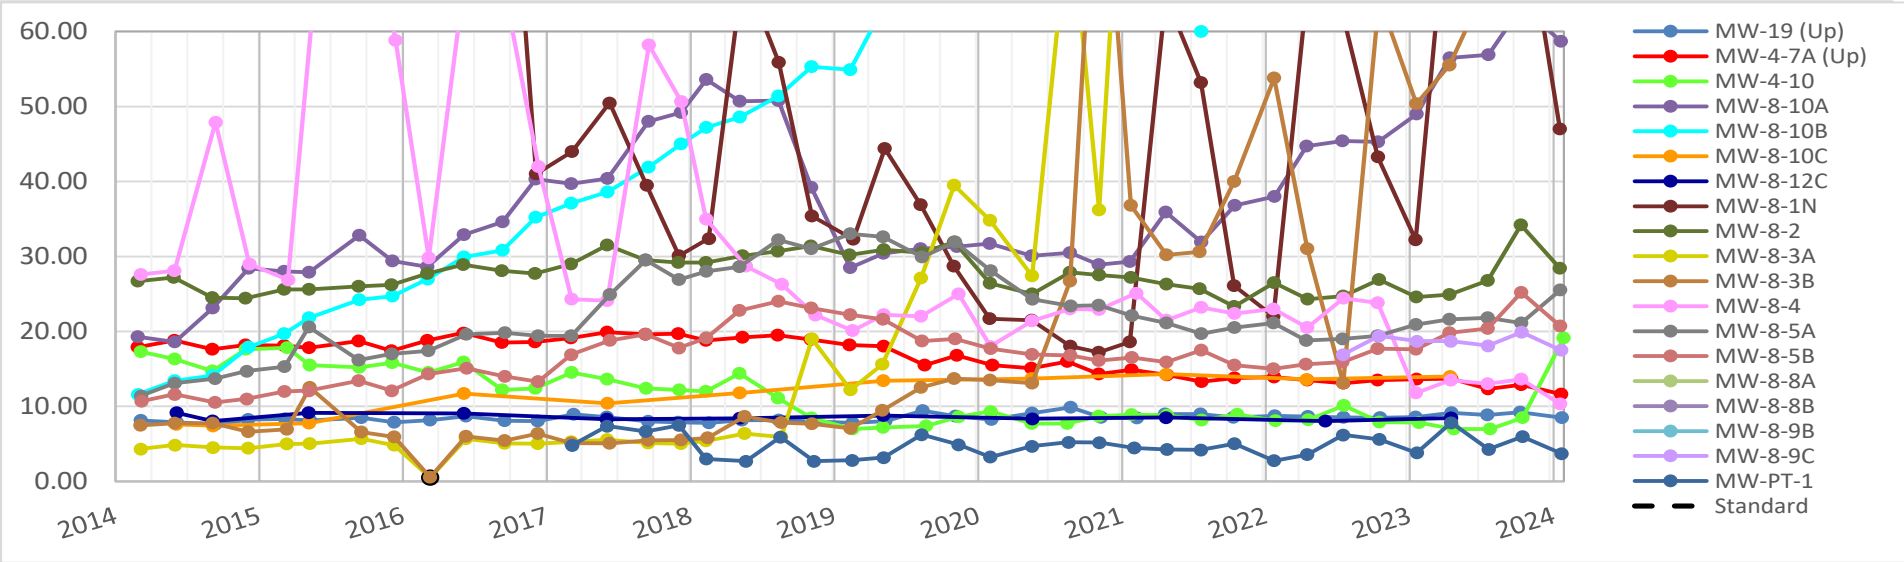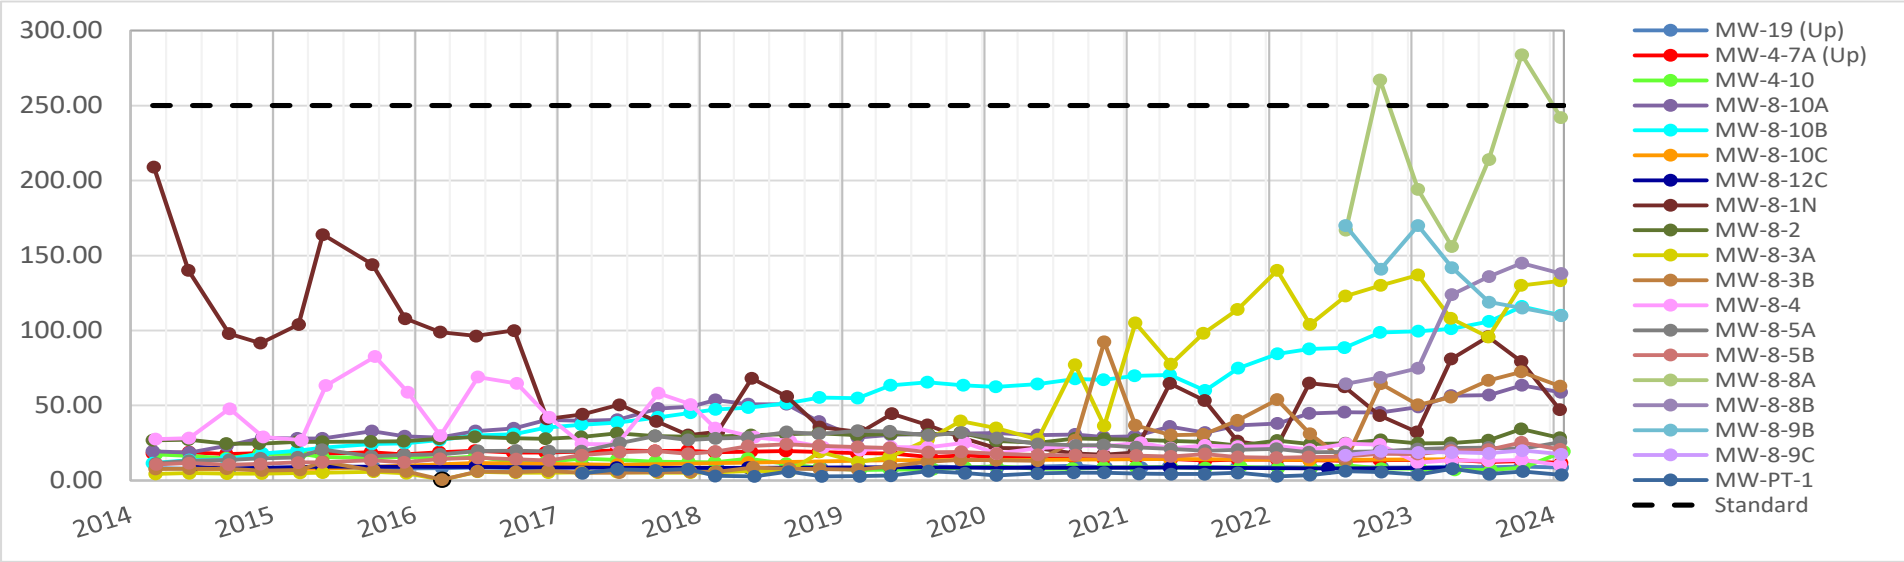


**Chromium, dissolved [ $\mu\text{g/l}$ ]**

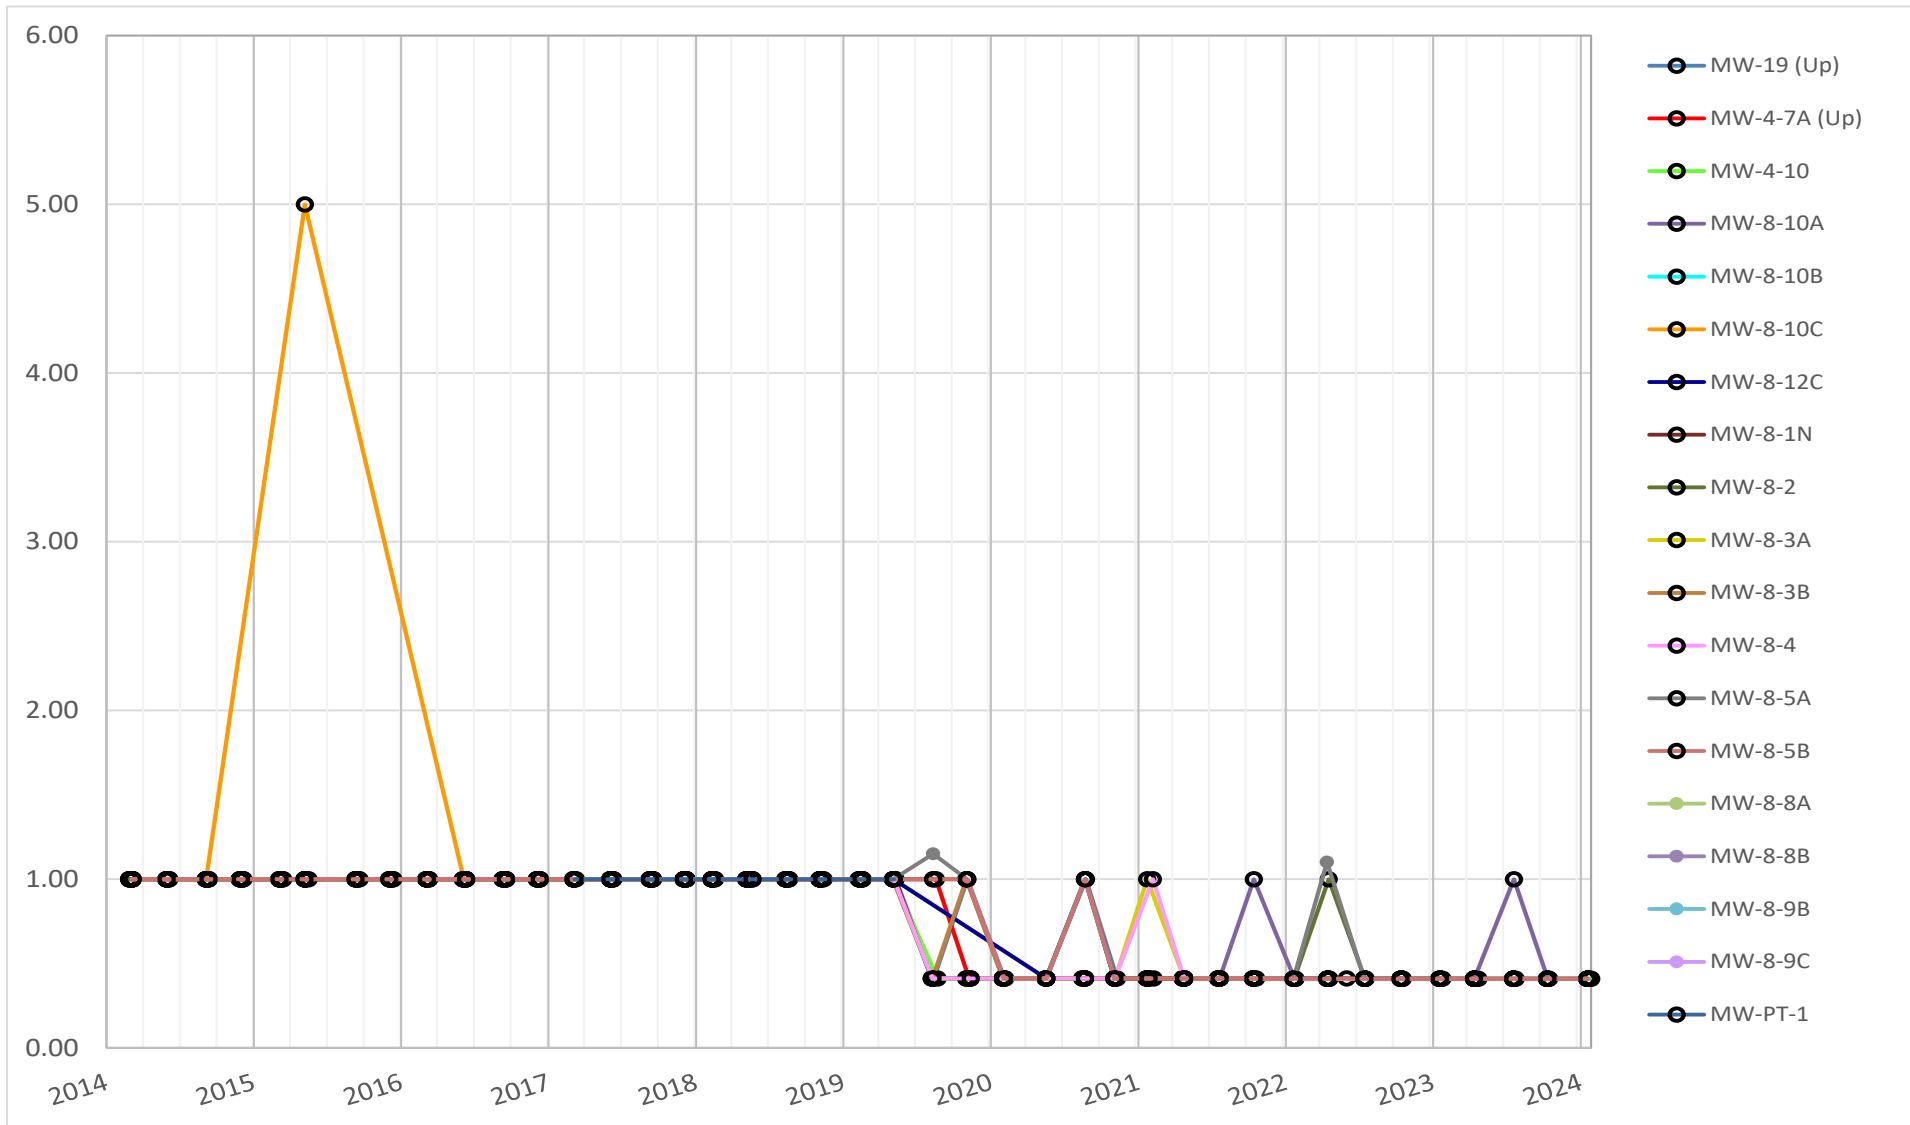


**NOTE: Data does not exceed standard of 100  $\mu\text{g/l}$  during this time frame**

**Chromium, total [ $\mu\text{g/l}$ ]**

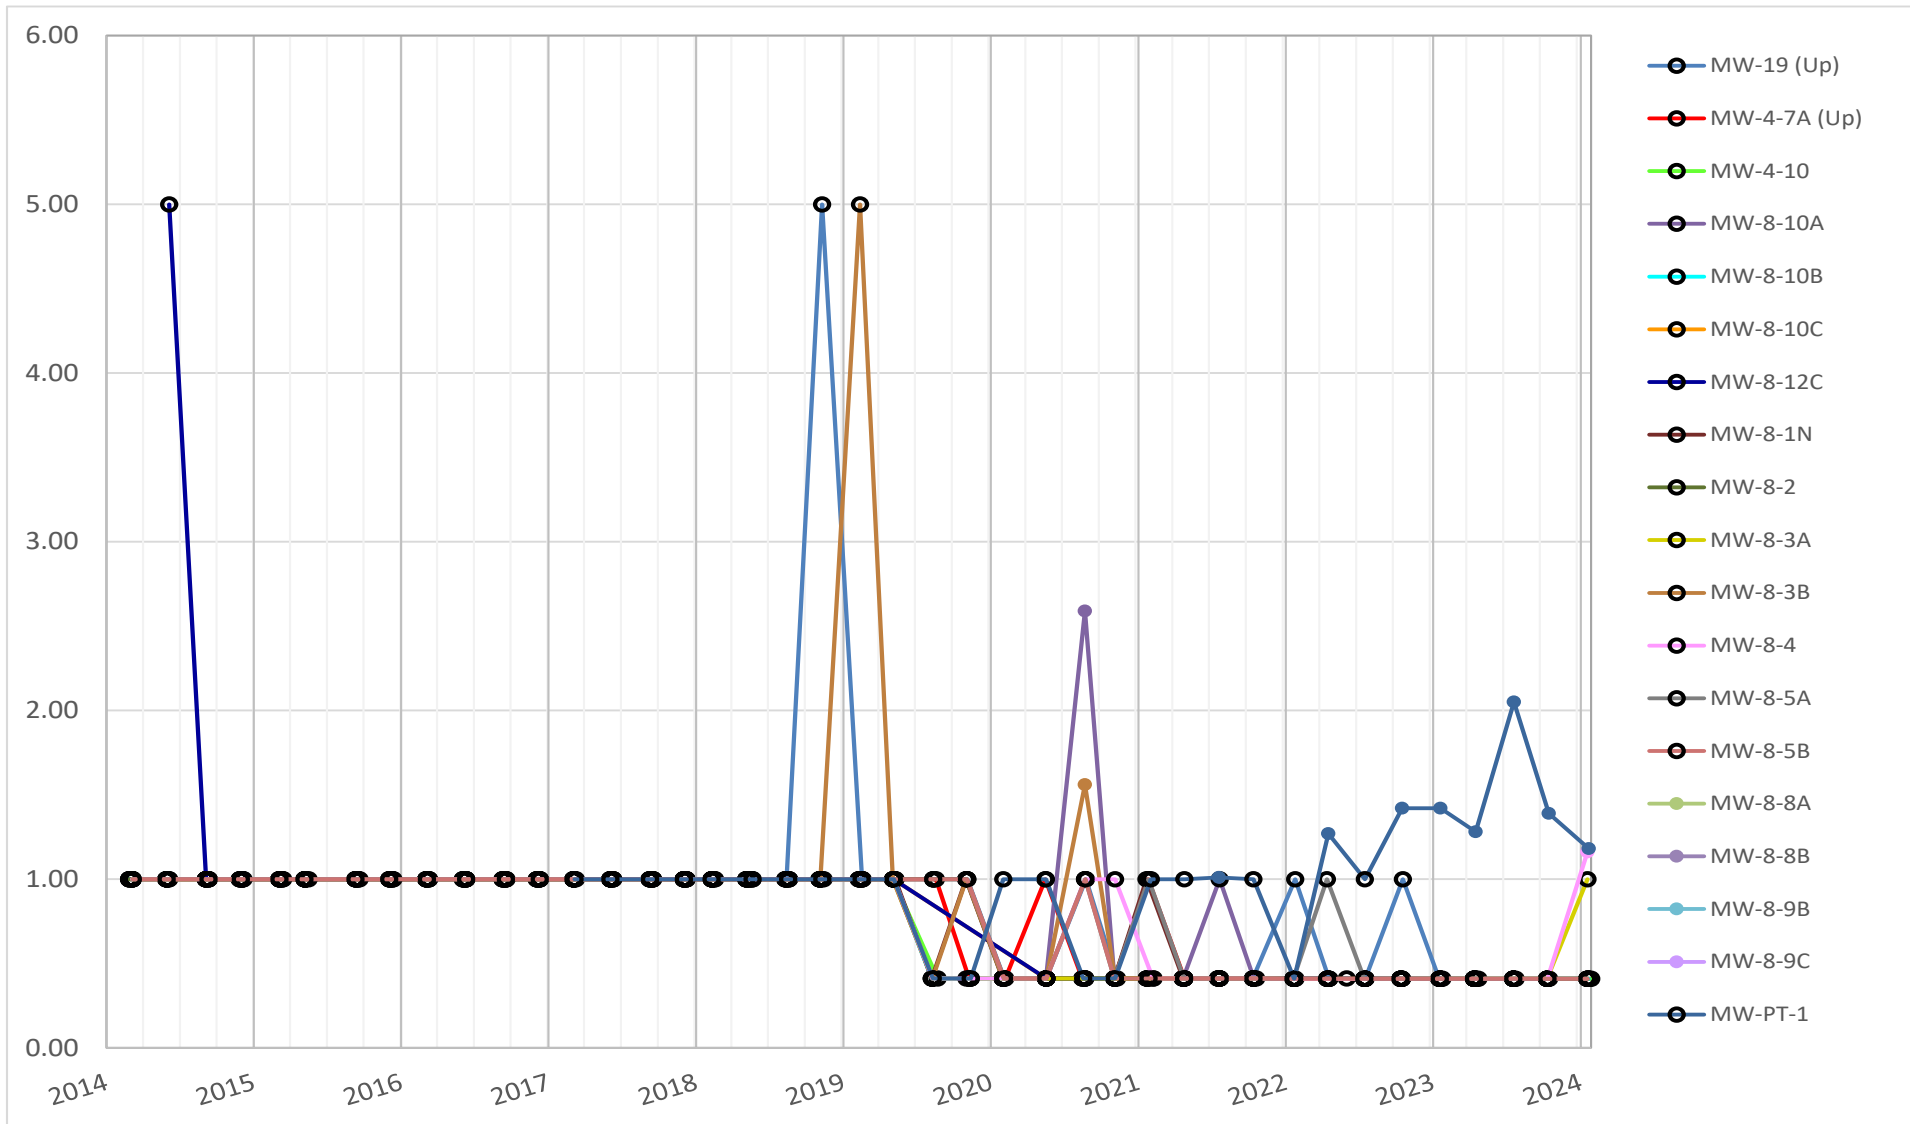


**NOTE: Data does not exceed standard of 100  $\mu\text{g/l}$  during this time frame**

**Copper, dissolved [ $\mu\text{g/l}$ ]**

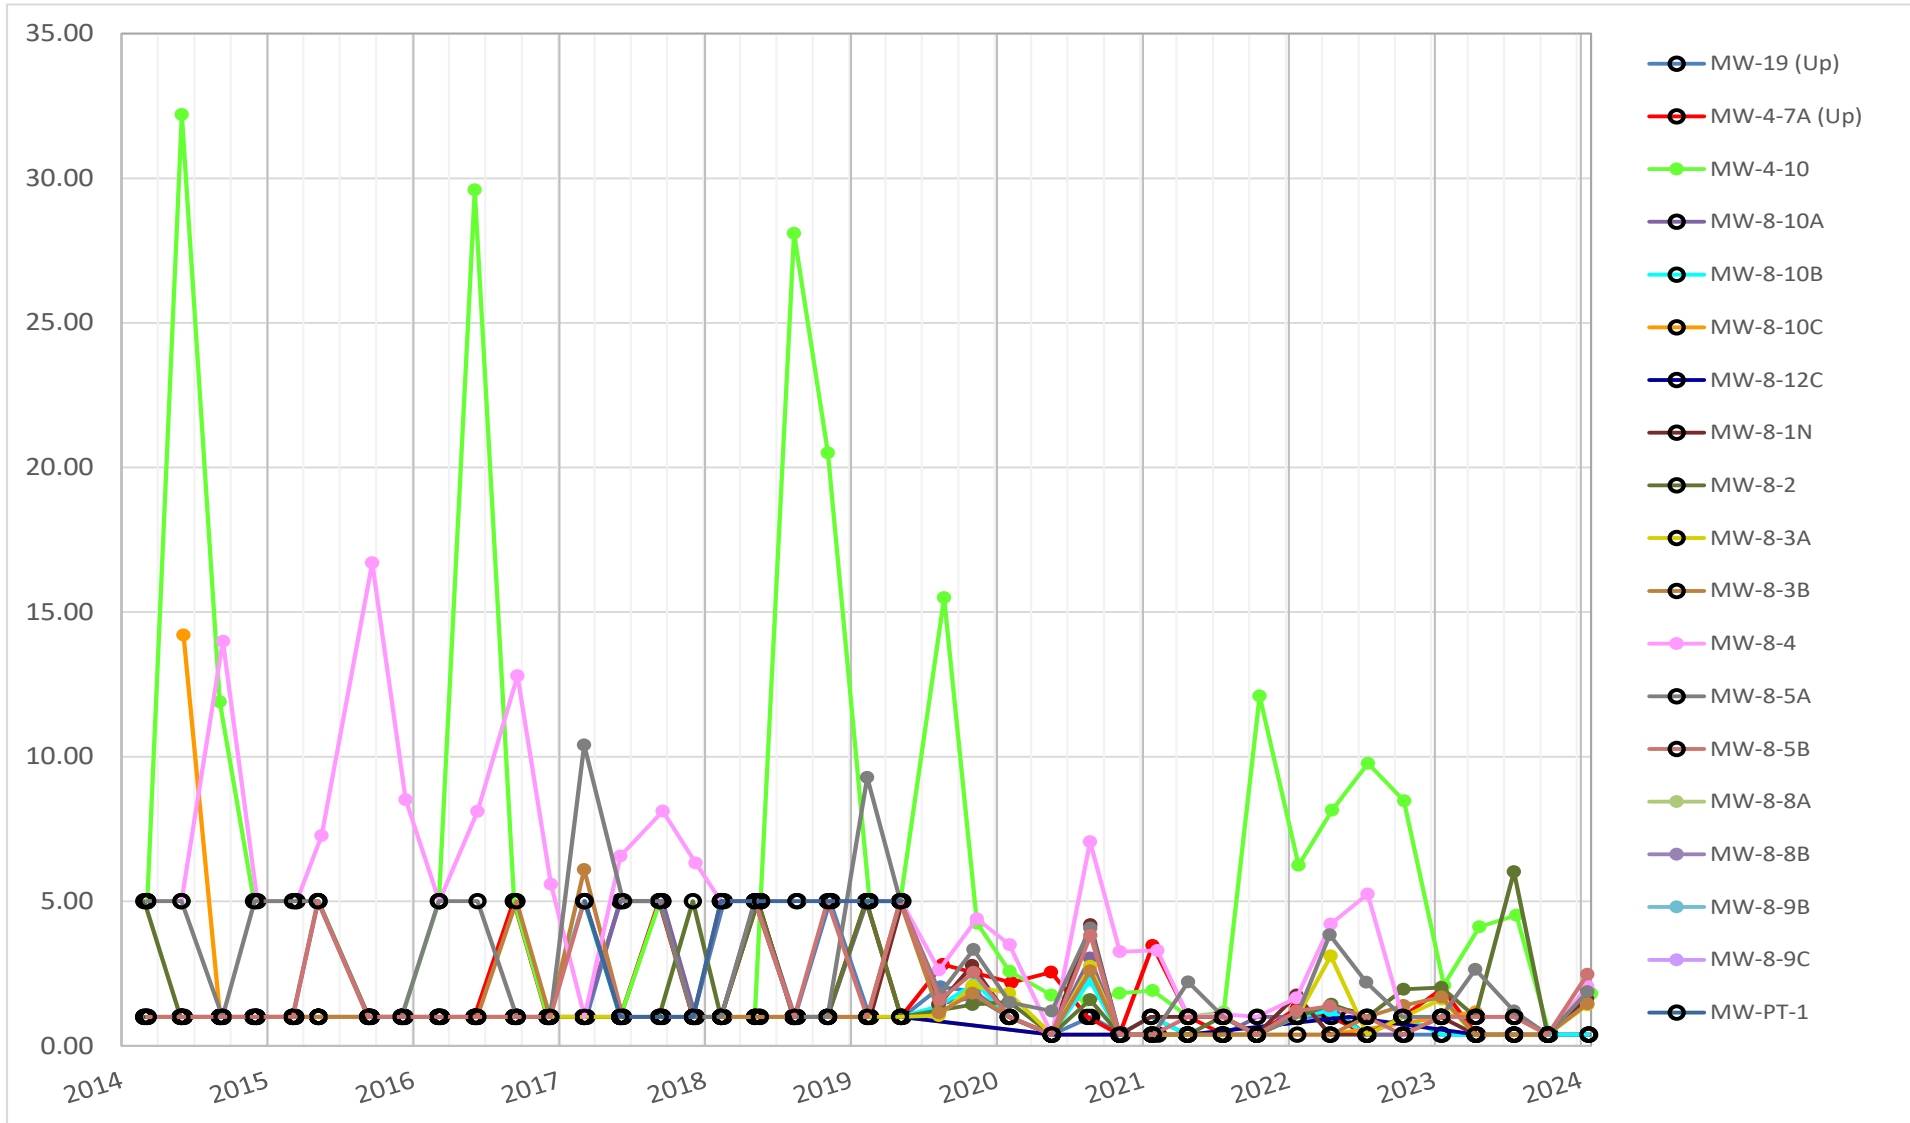


**NOTE: Data does not exceed standard of 1000  $\mu\text{g/l}$  during this time frame**

**Copper, total [ $\mu\text{g/l}$ ]**

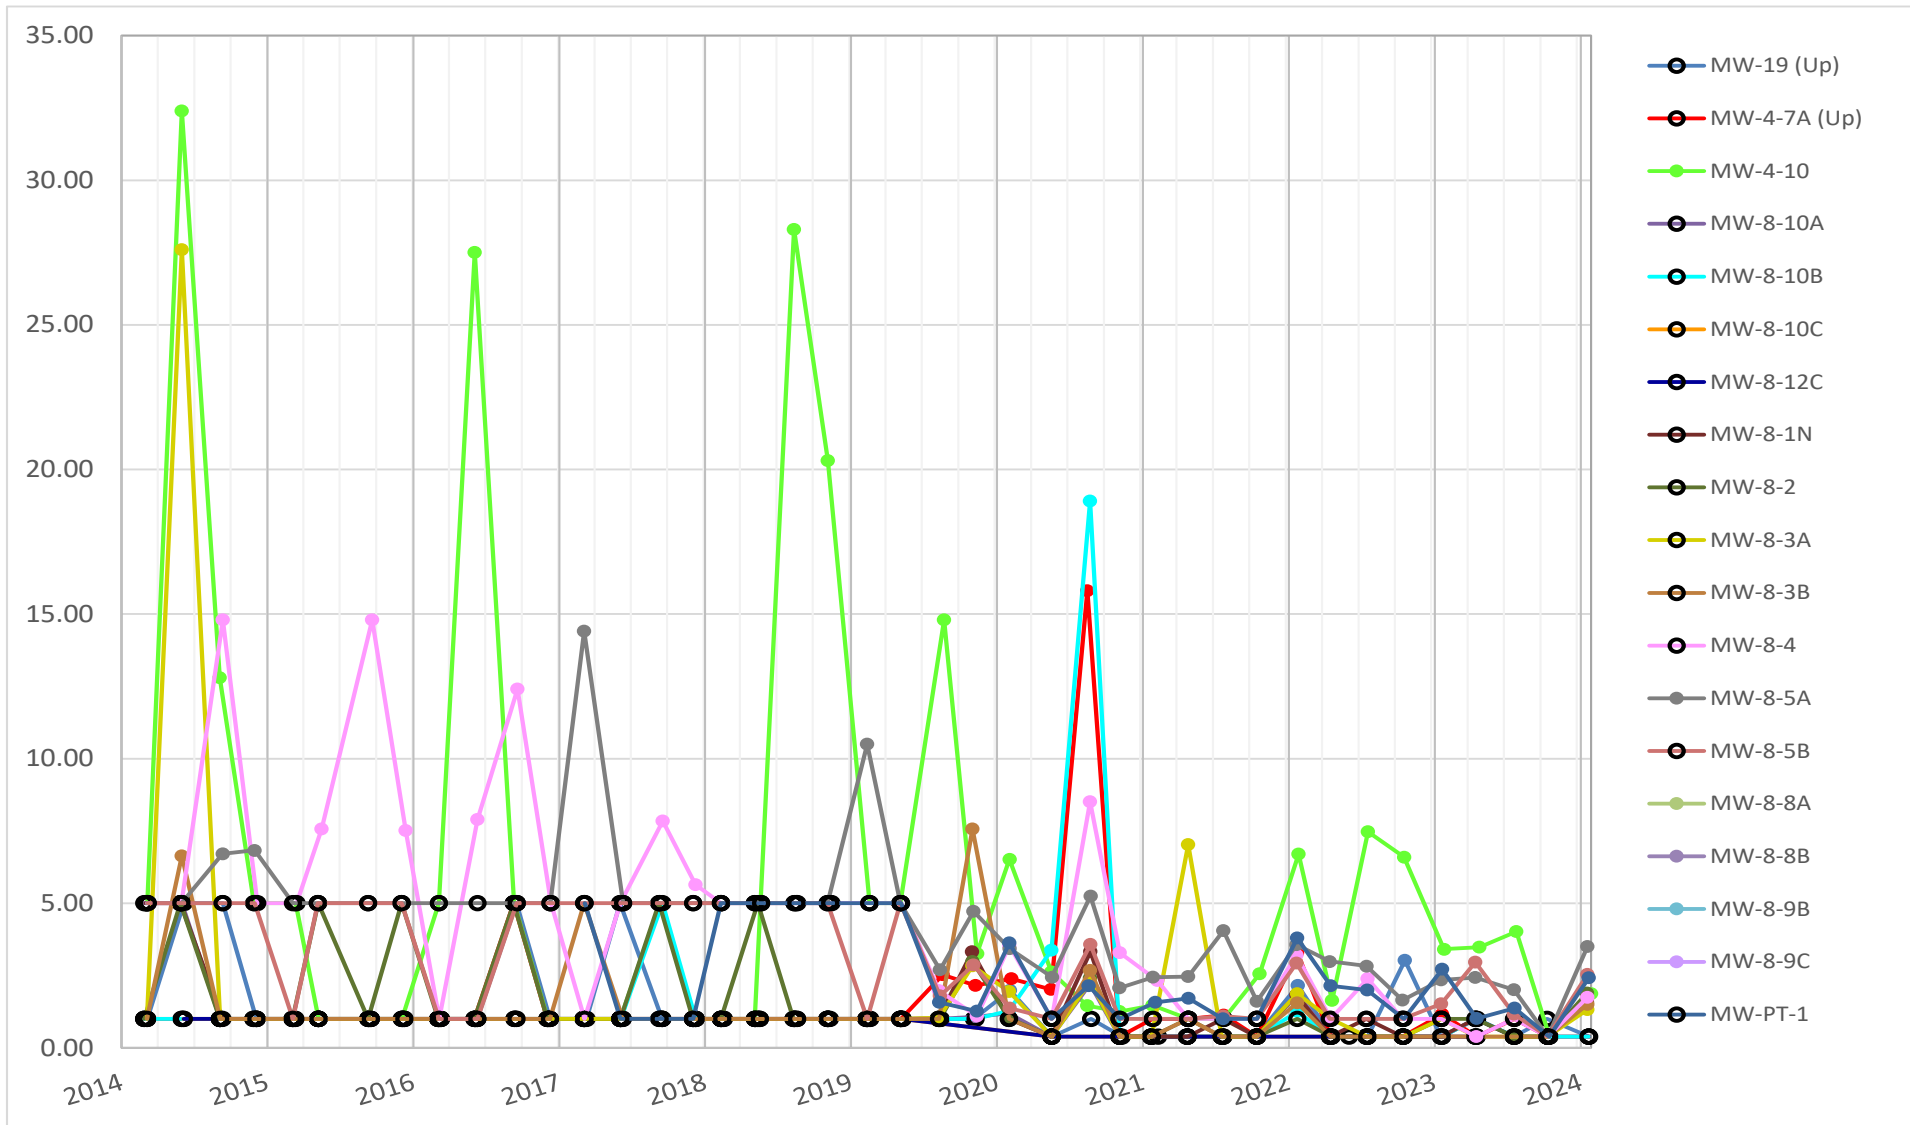


**NOTE: Data does not exceed standard of 1000  $\mu\text{g/l}$  during this time frame**

**Depth to Water [ft]**

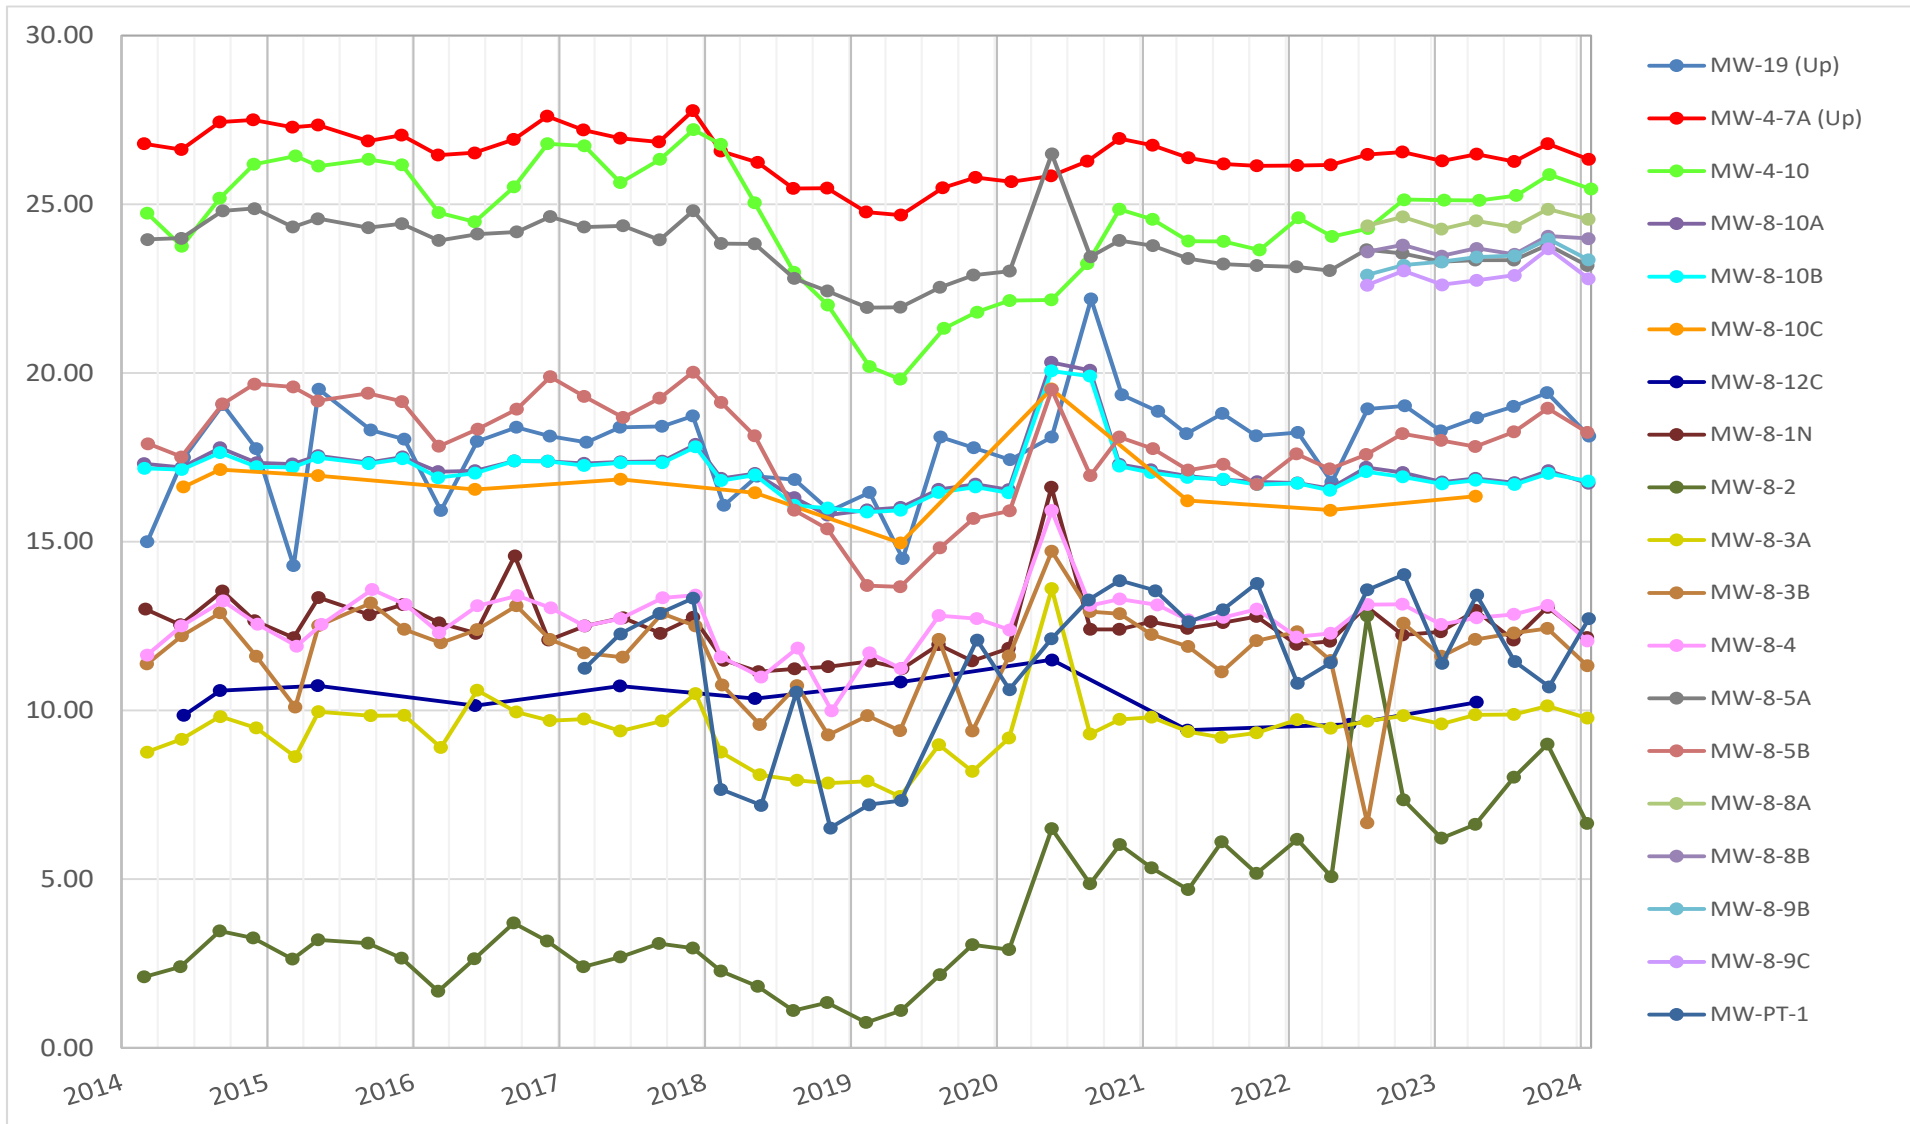


**NOTE: There are no applicable standards for this parameter**

***Dissolved Oxygen, field [mg/l]***

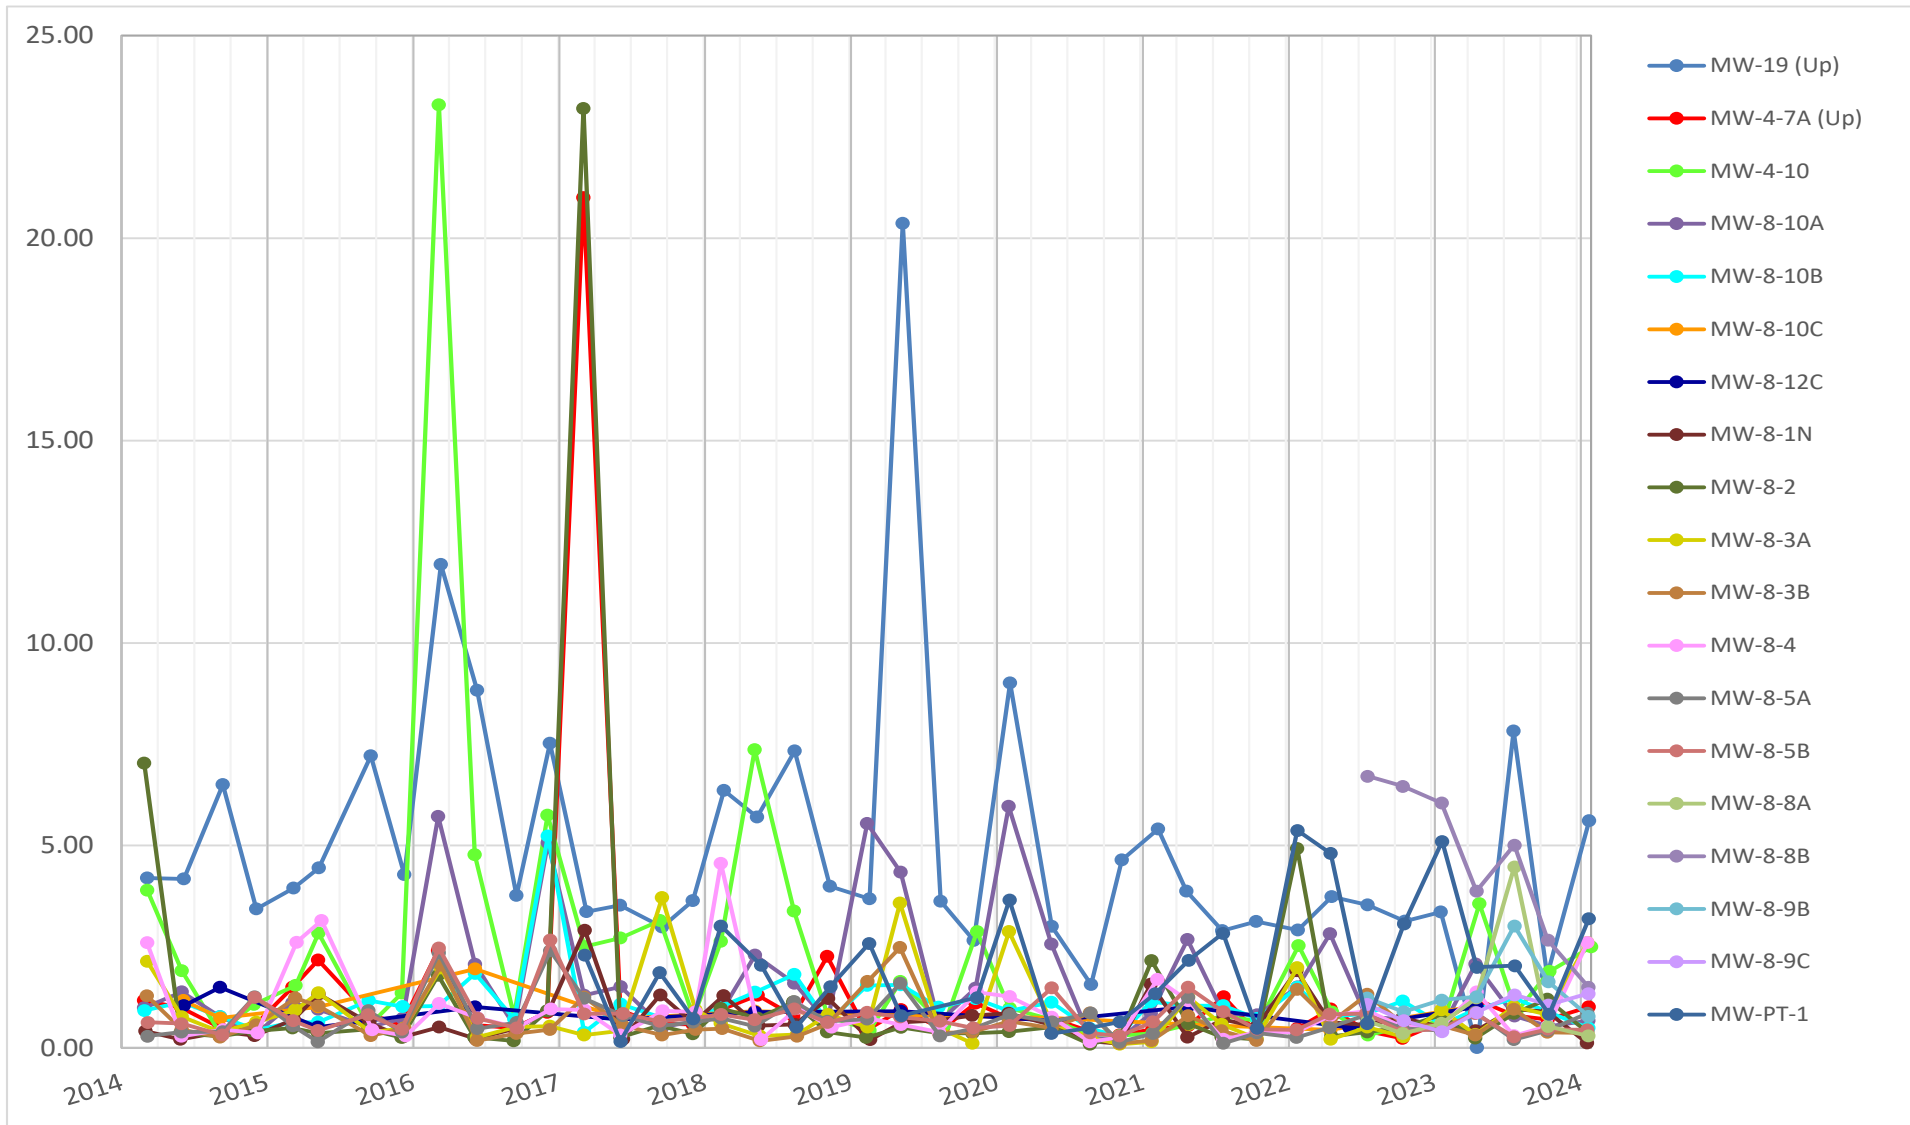



***NOTE: There are no applicable standards for this parameter***

**Fluoride, total as F [mg/l]**

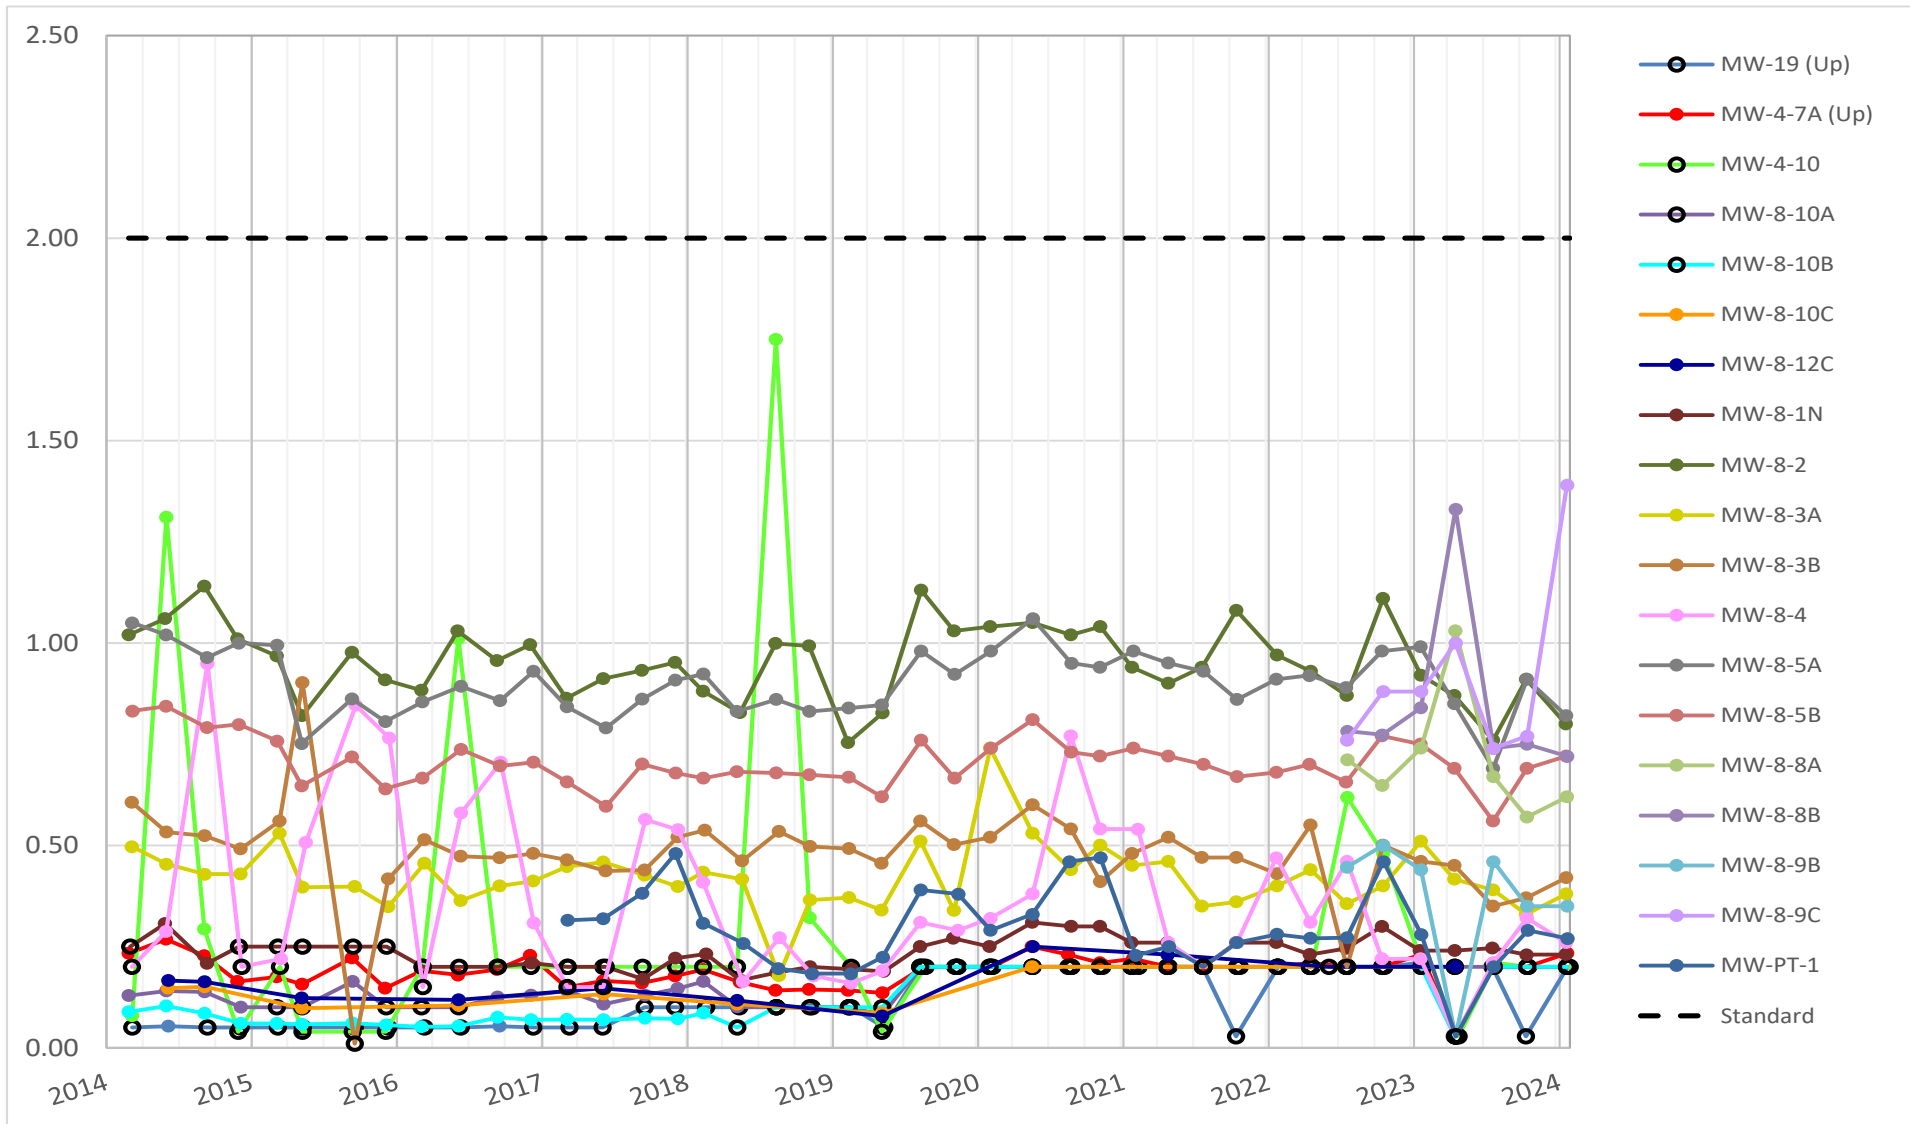


**NOTE: Data does not exceed standard of 2 mg/l during this time frame**

**Iron, dissolved [mg/l]**

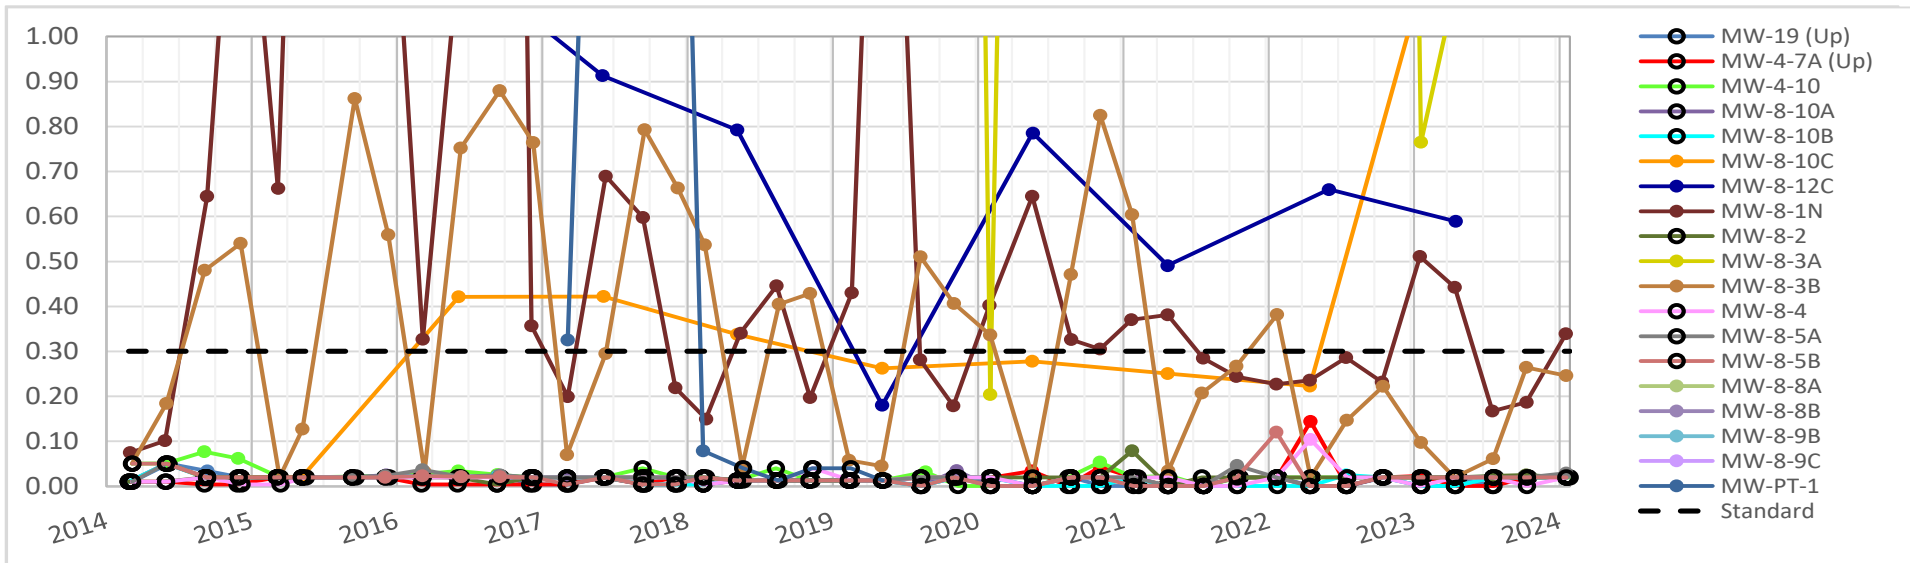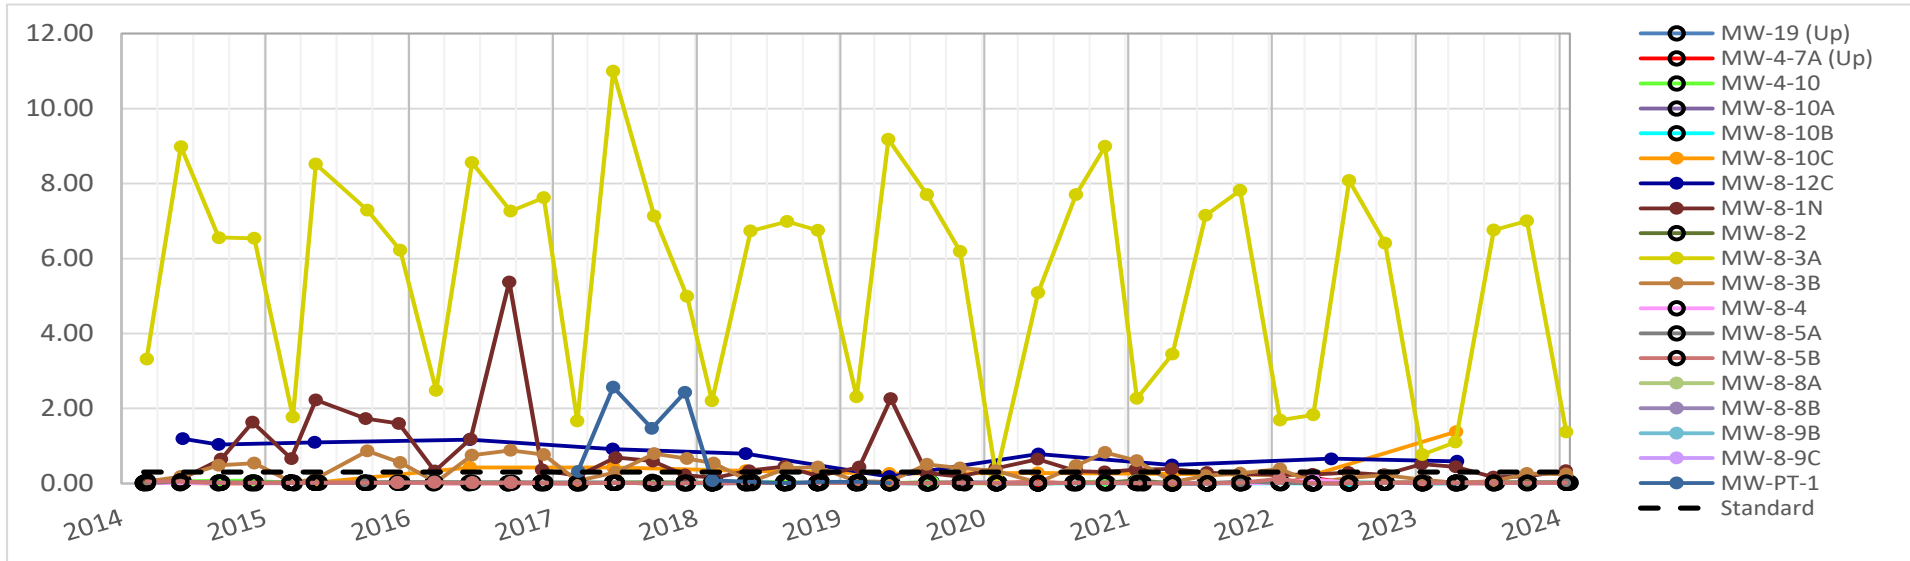




**Lead, dissolved [ $\mu\text{g}/\text{l}$ ]**

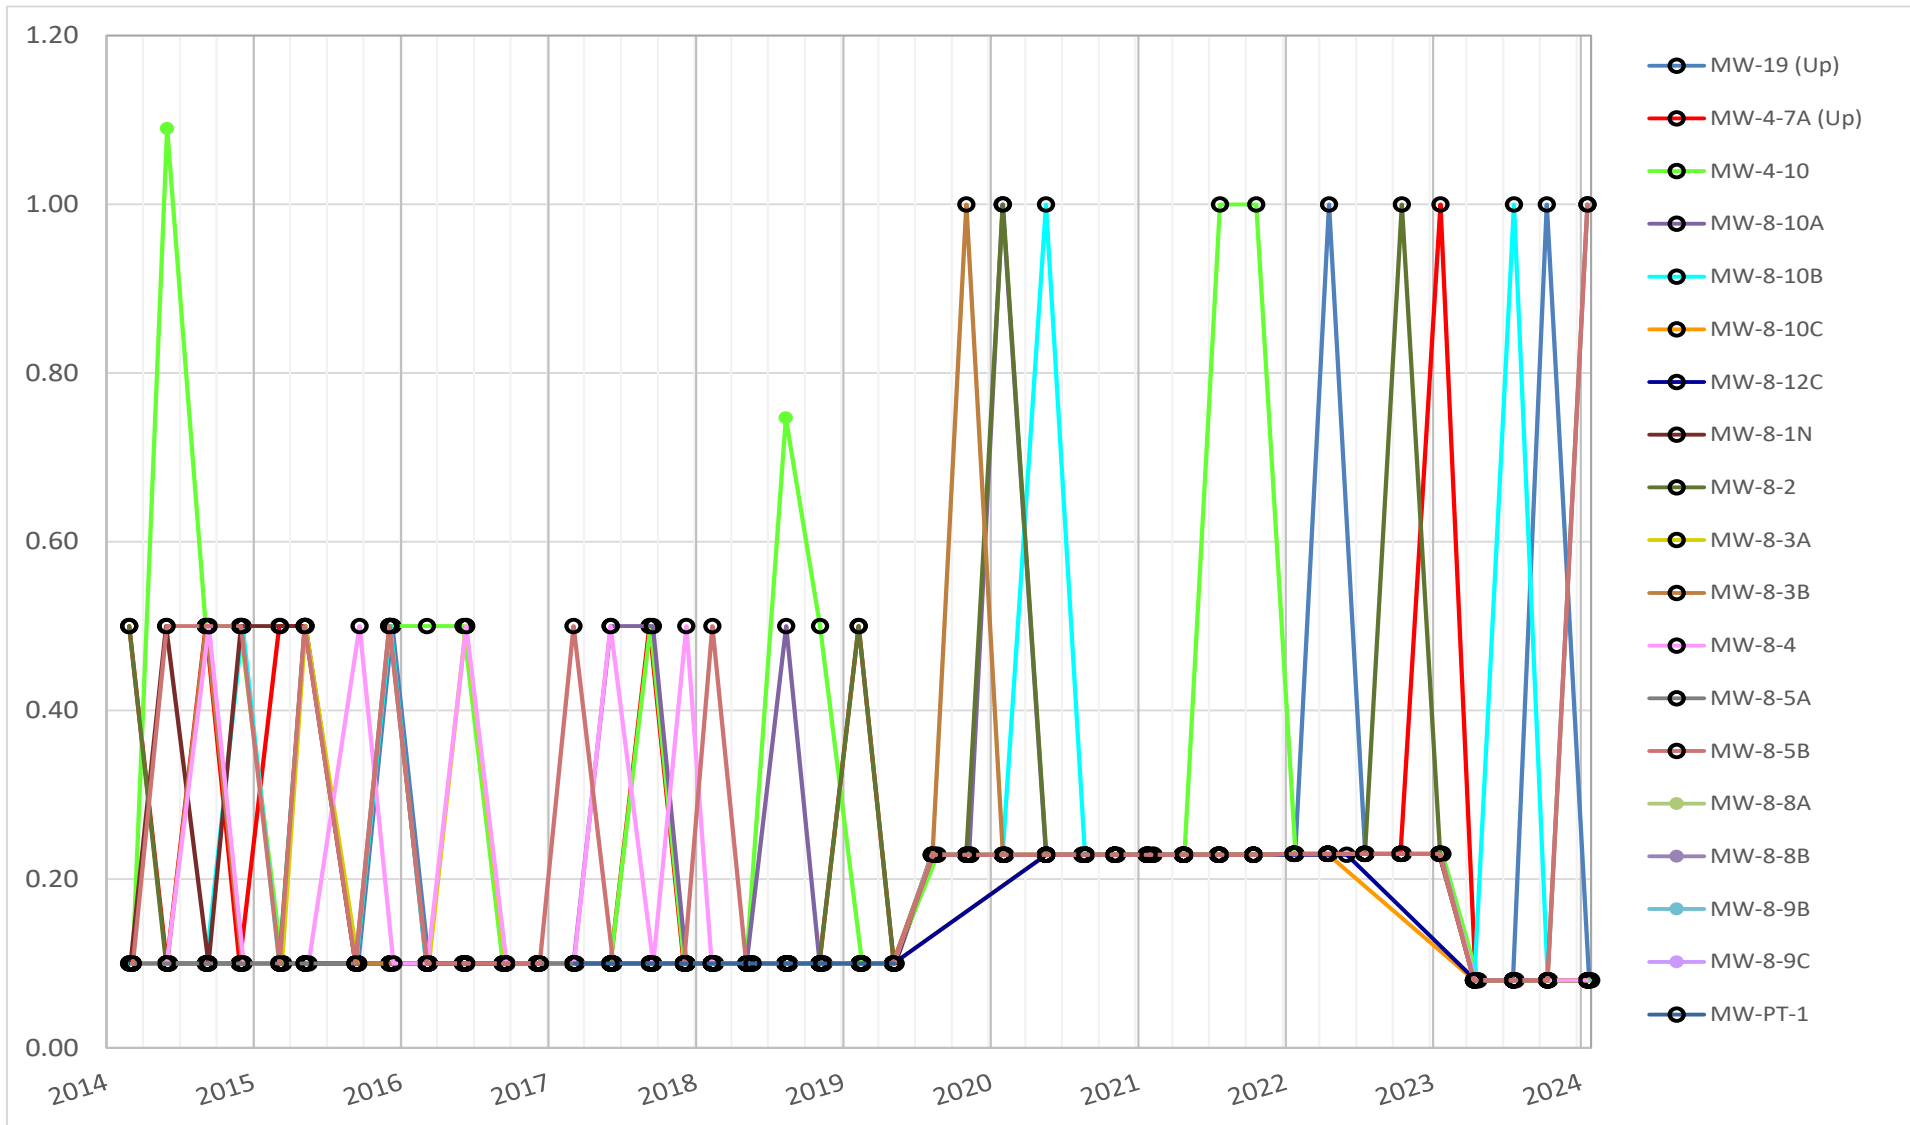



**NOTE: Data does not exceed standard of 5  $\mu\text{g}/\text{l}$  during this time frame**

**Lead, total [ $\mu\text{g}/\text{l}$ ]**

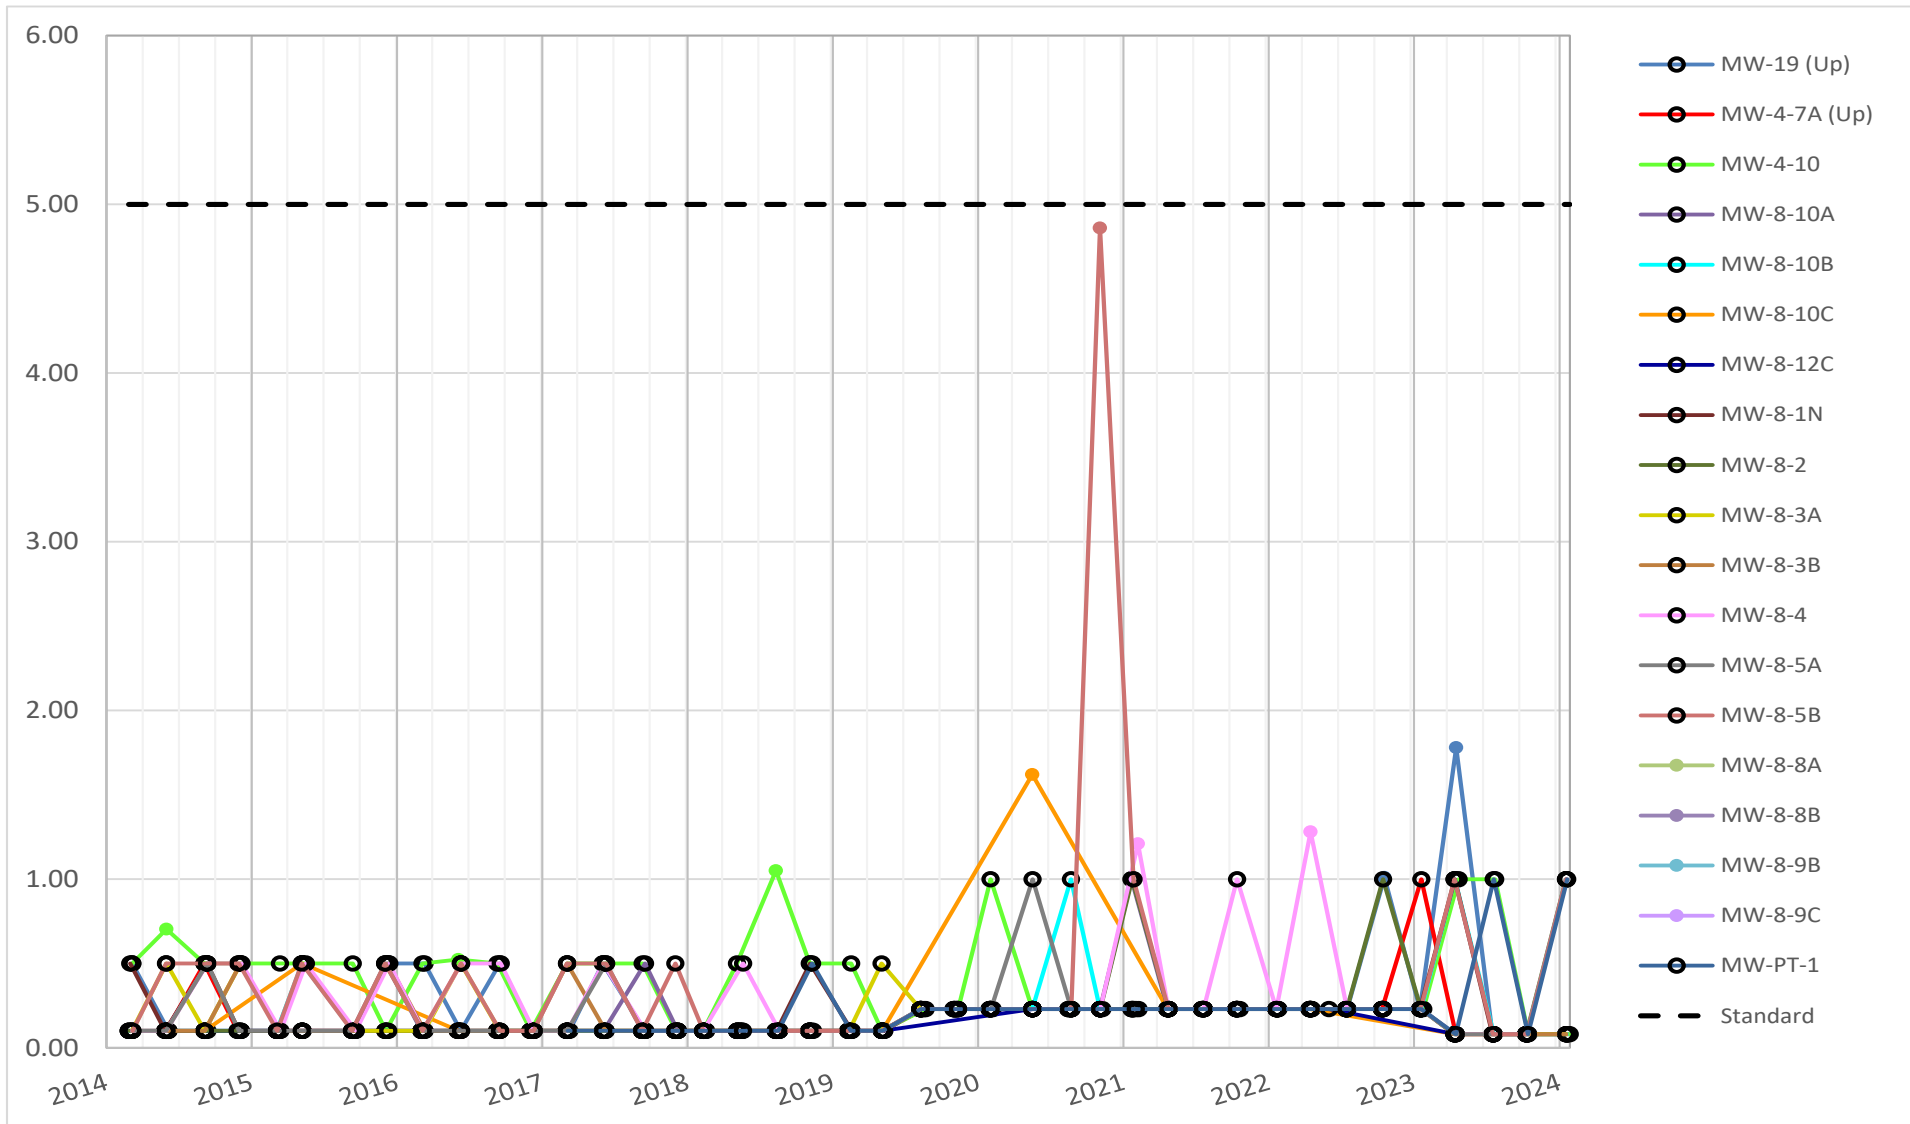


**NOTE: Data does not exceed standard of 5  $\mu\text{g}/\text{l}$  during this time frame**


**Lithium, dissolved [ $\mu\text{g/l}$ ]**

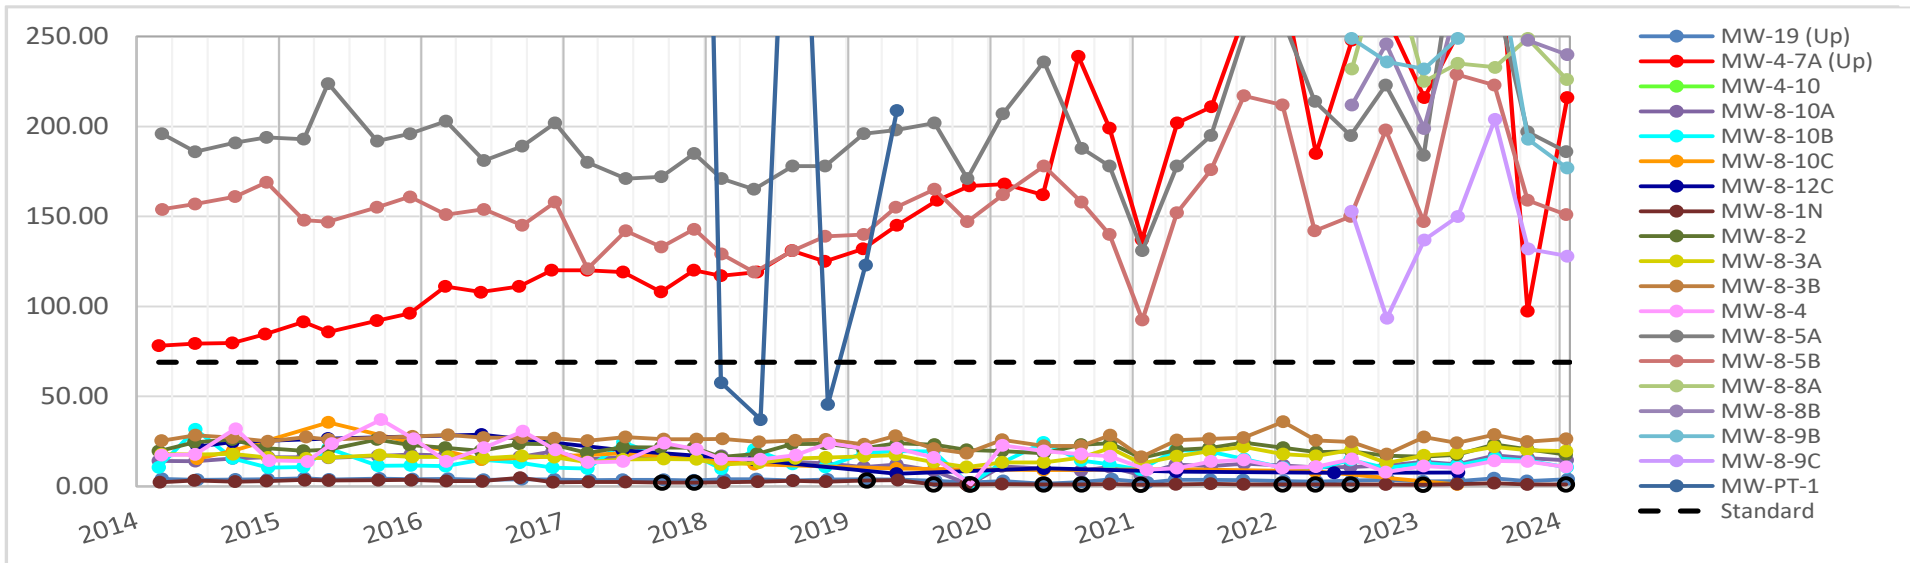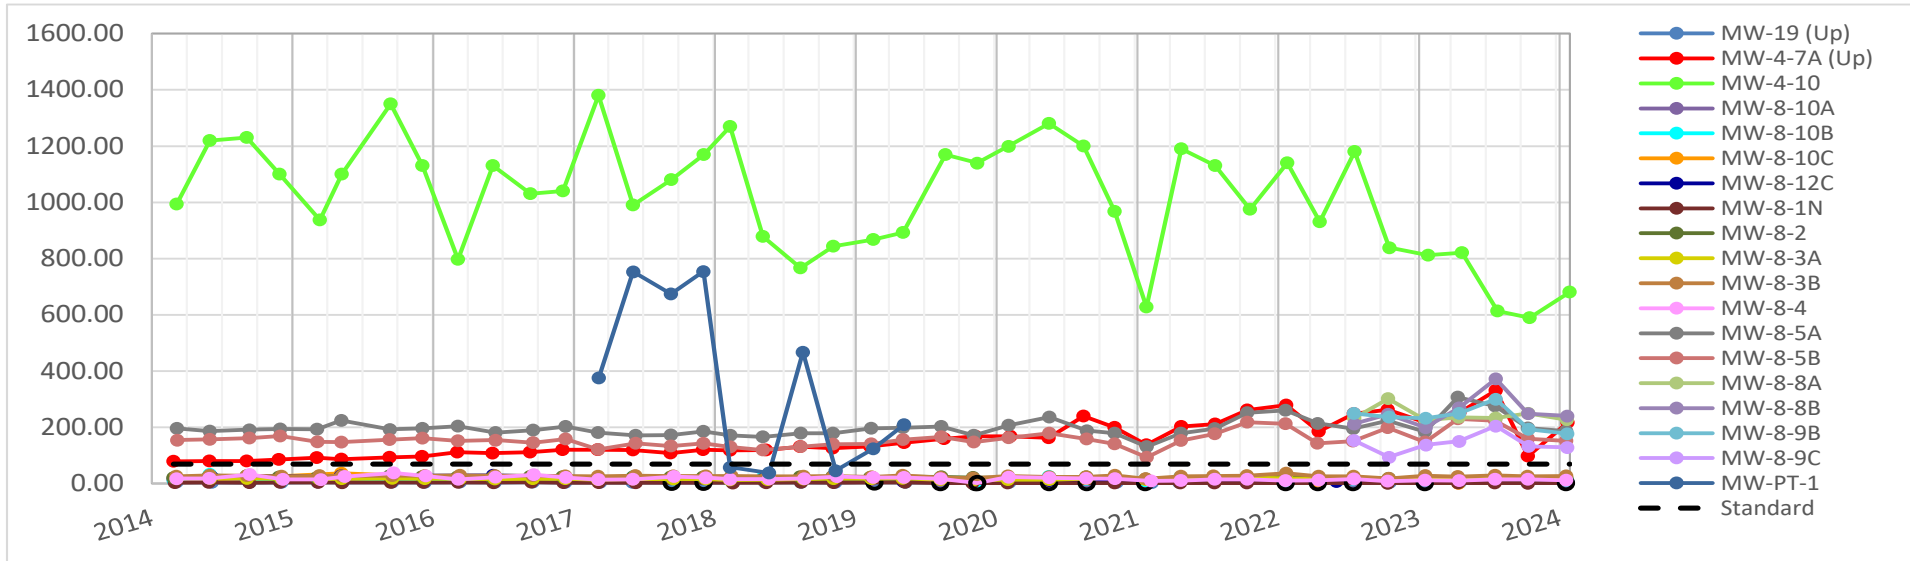

**Lithium, total [ $\mu\text{g/l}$ ]**

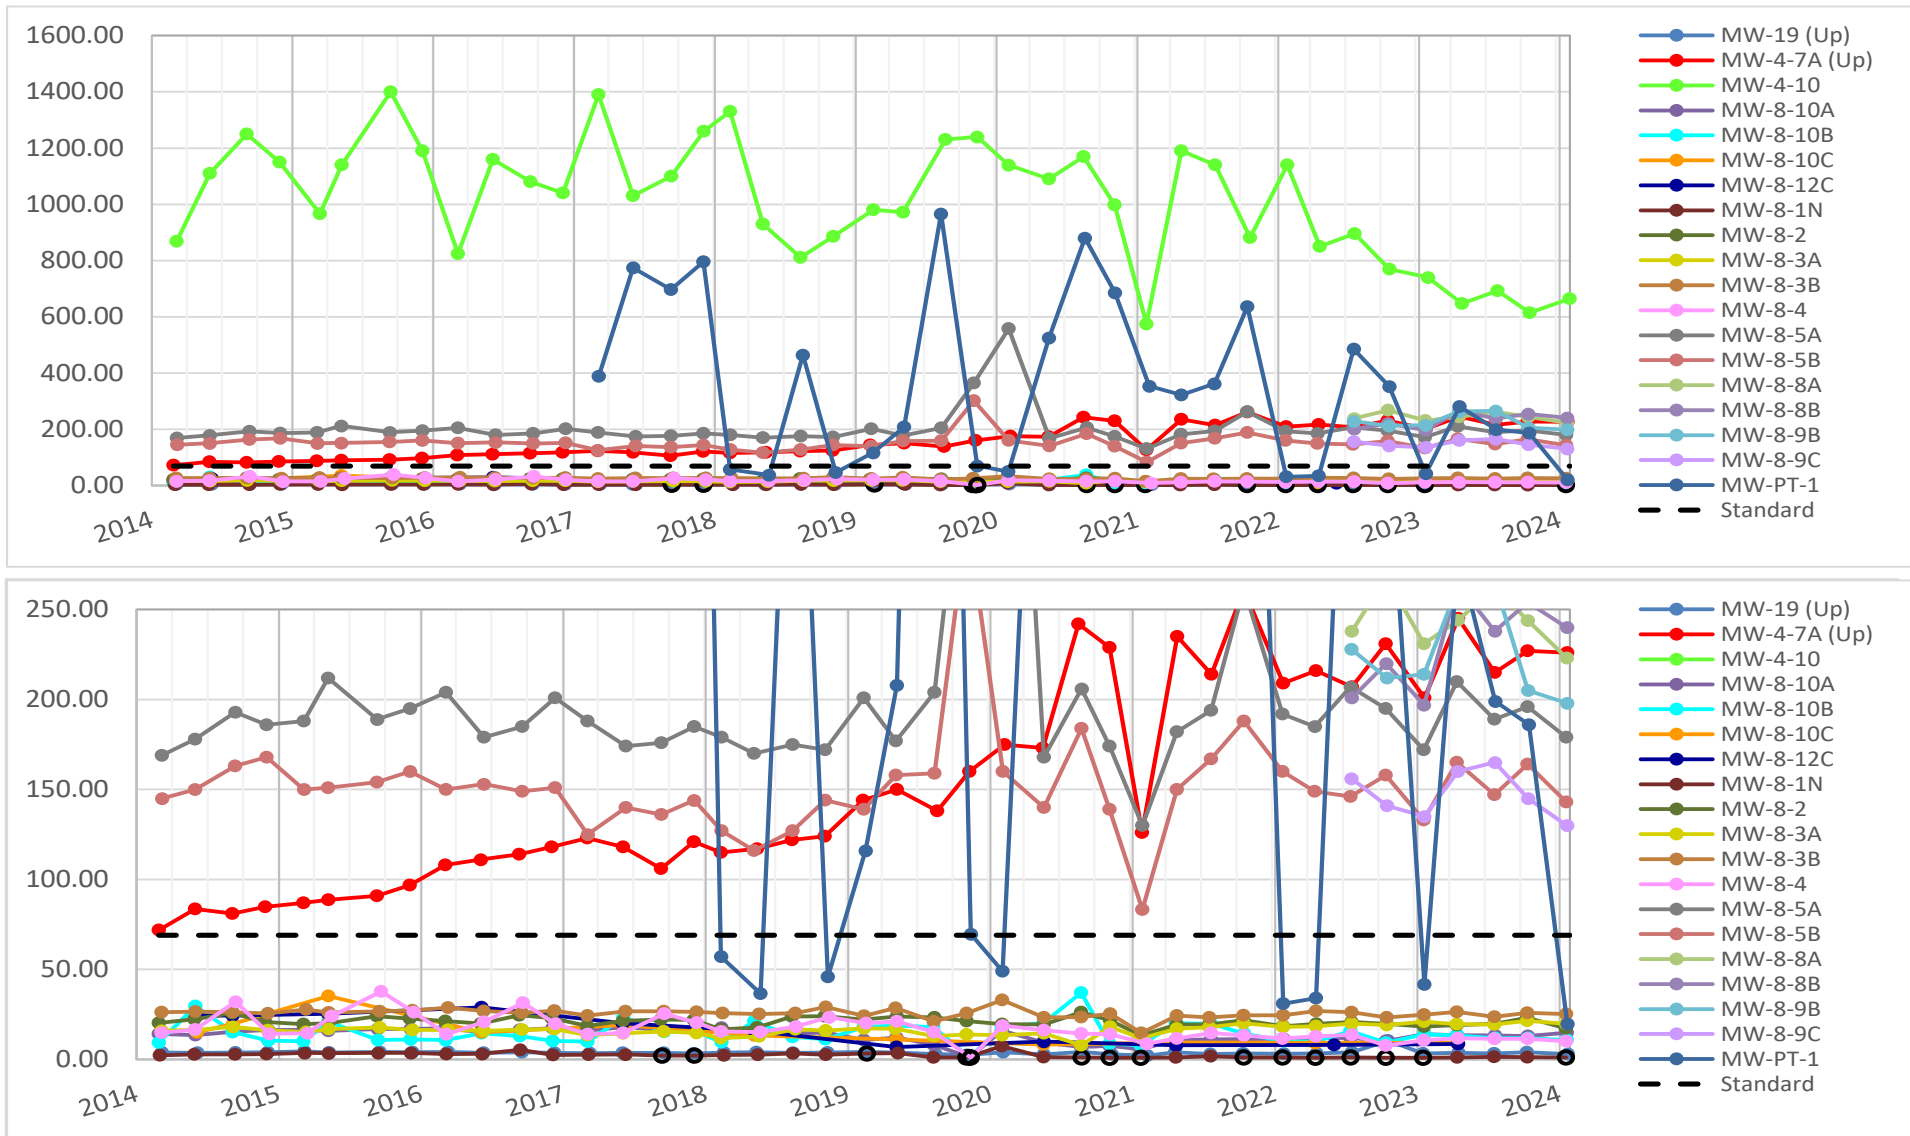


**Magnesium, dissolved [mg/l]**

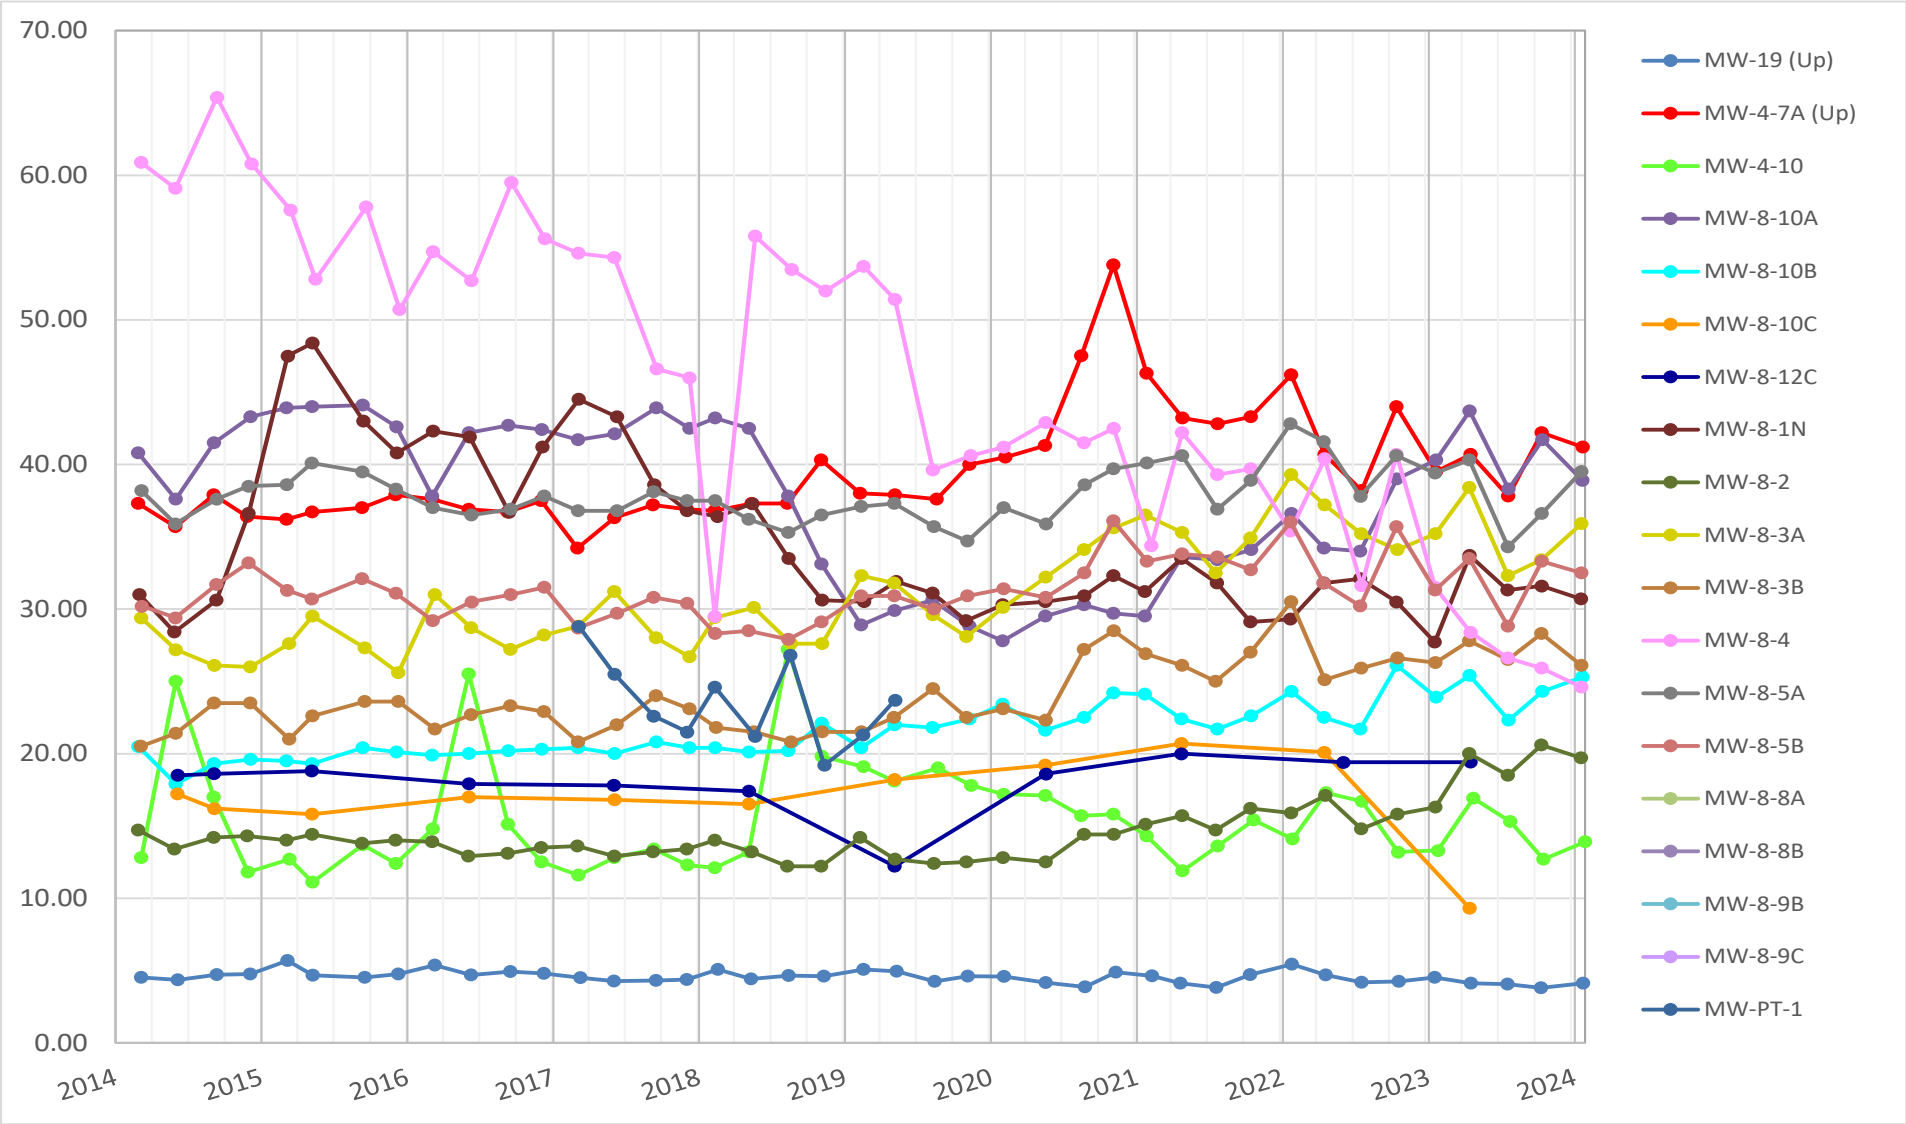


**NOTE: There are no applicable standards for this parameter**

**Magnesium, total [mg/l]**

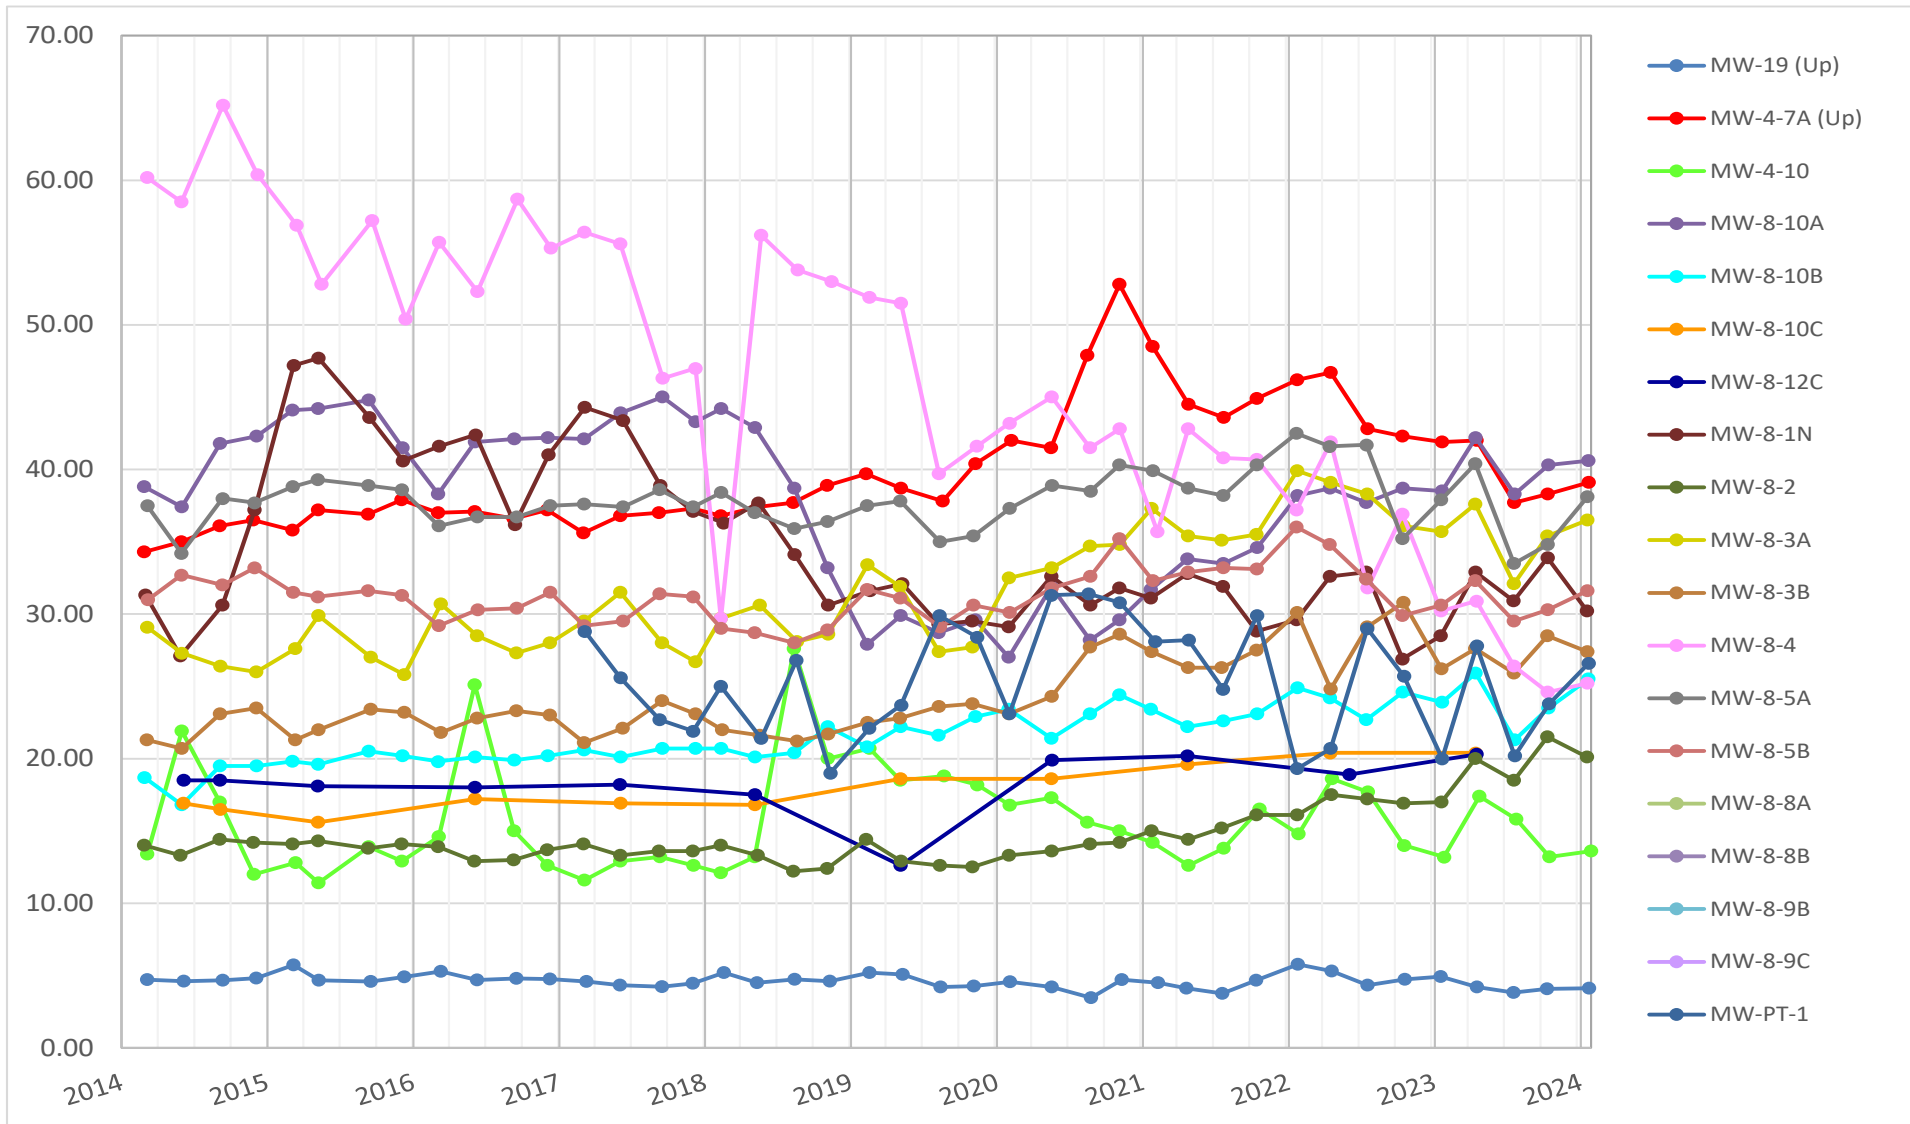


**NOTE: There are no applicable standards for this parameter**


**Manganese, dissolved [ $\mu\text{g/l}$ ]**

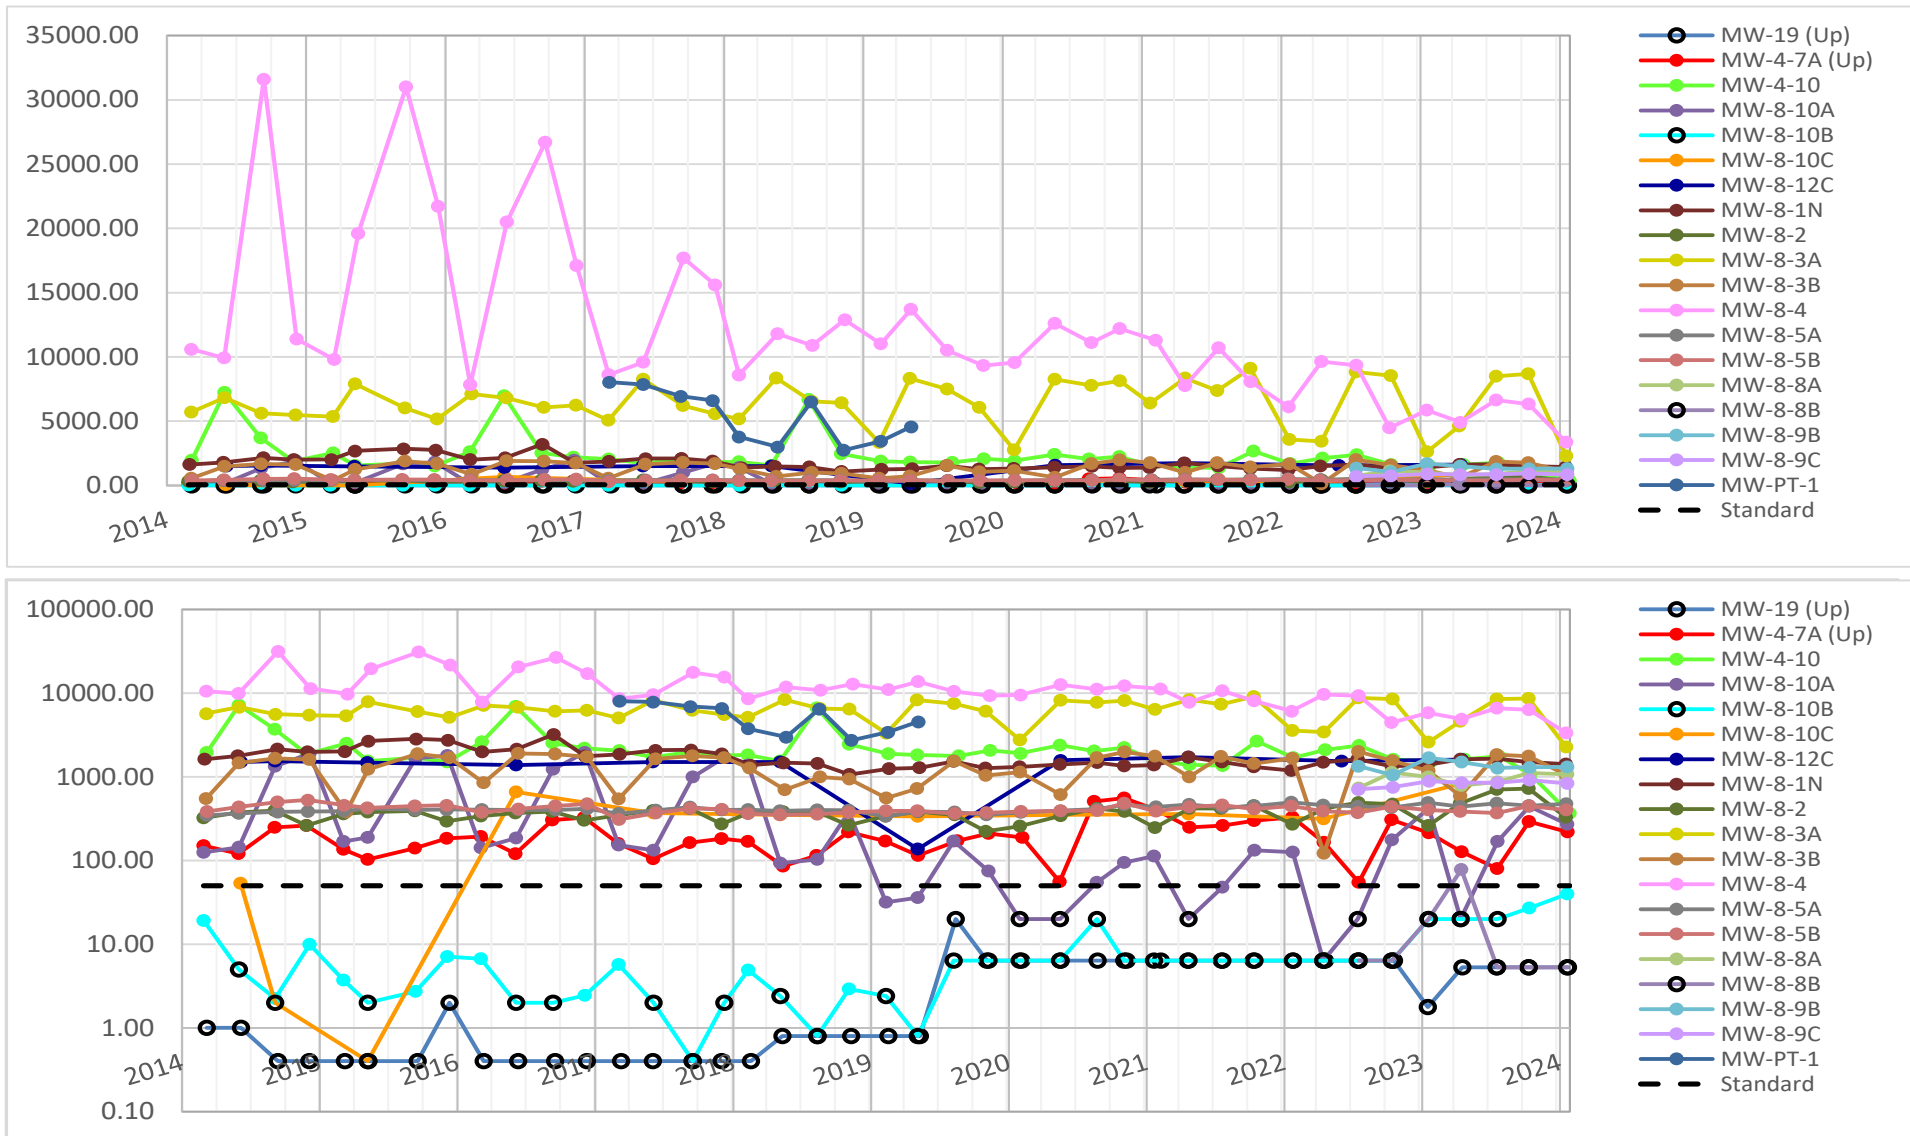

**Manganese, total [ $\mu\text{g/l}$ ]**

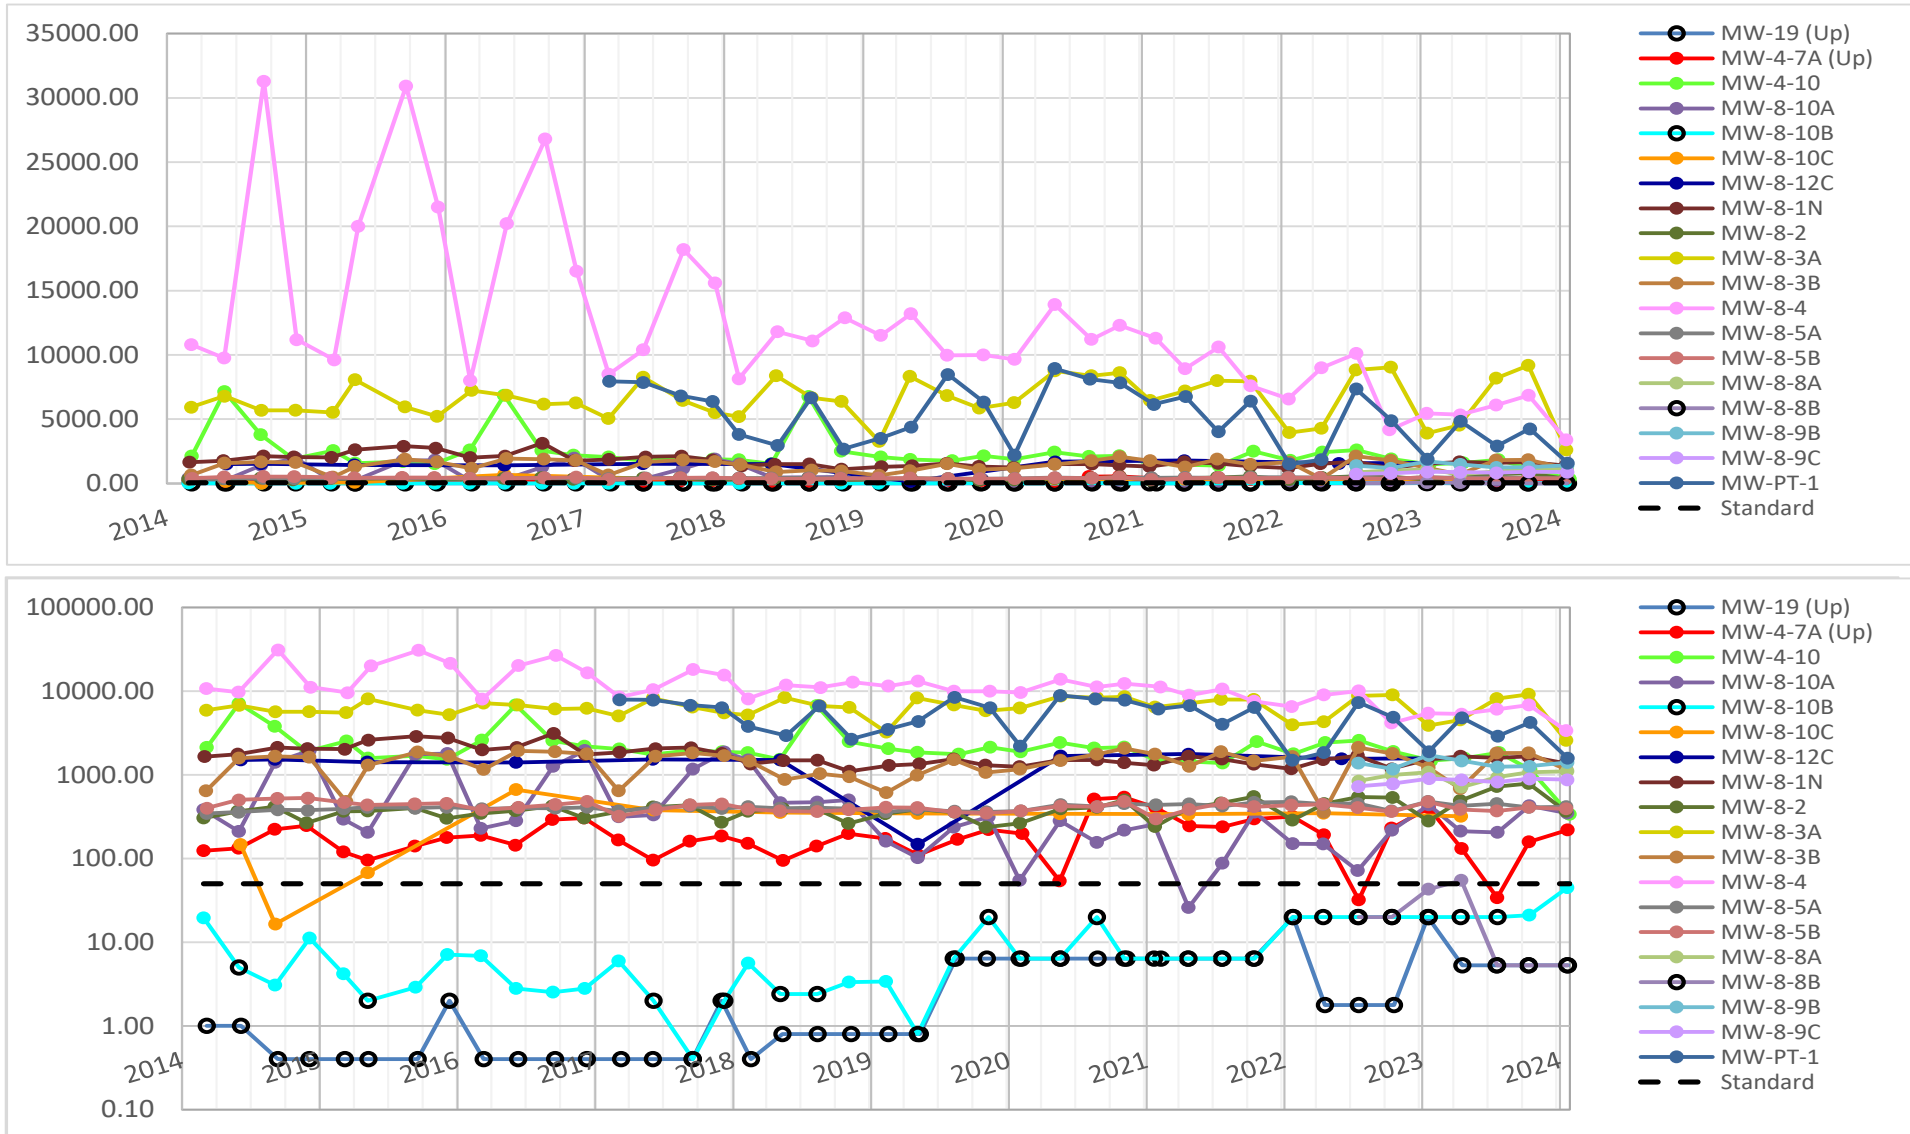


**Mercury, dissolved [ $\mu\text{g/l}$ ]**

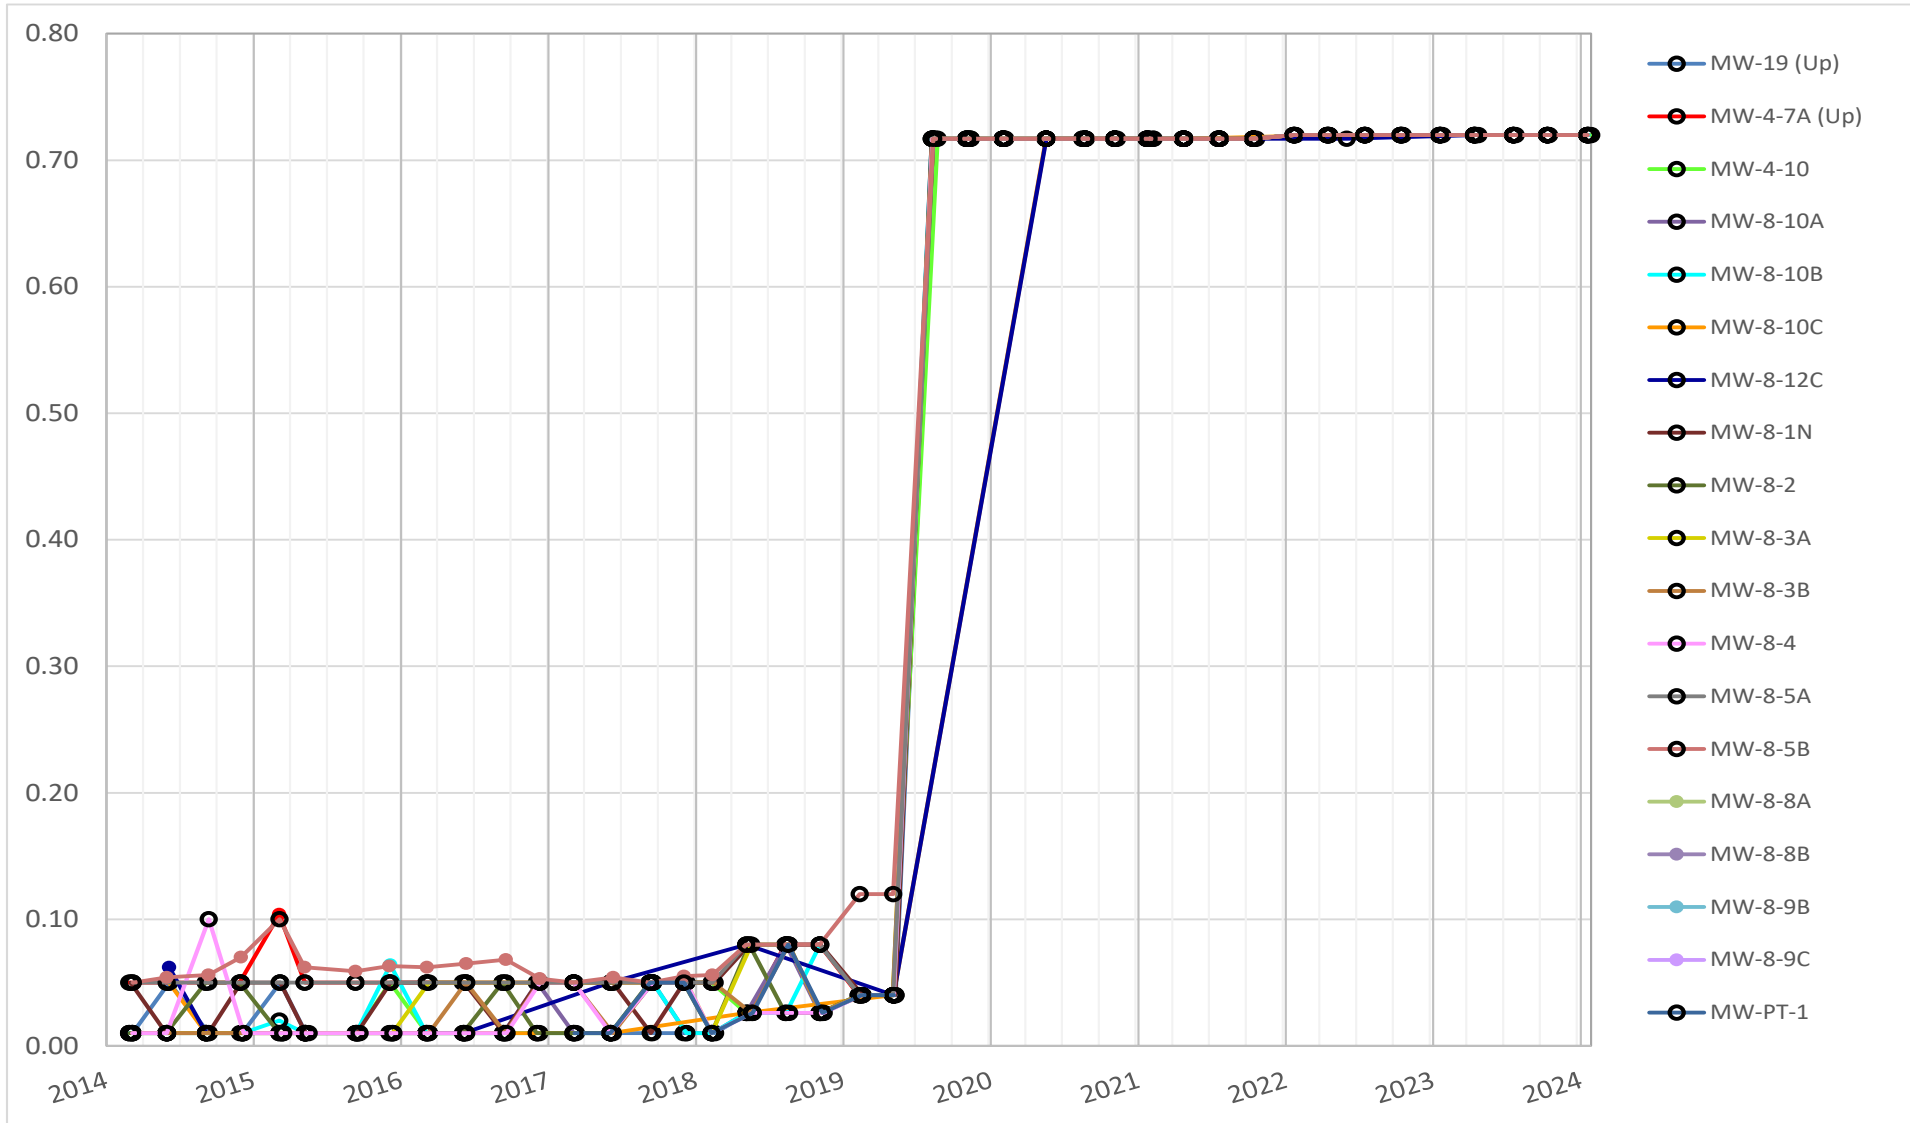



**NOTE: Data does not exceed standard of 2  $\mu\text{g/l}$  during this time frame**

**Mercury, total [ $\mu\text{g}/\text{l}$ ]**

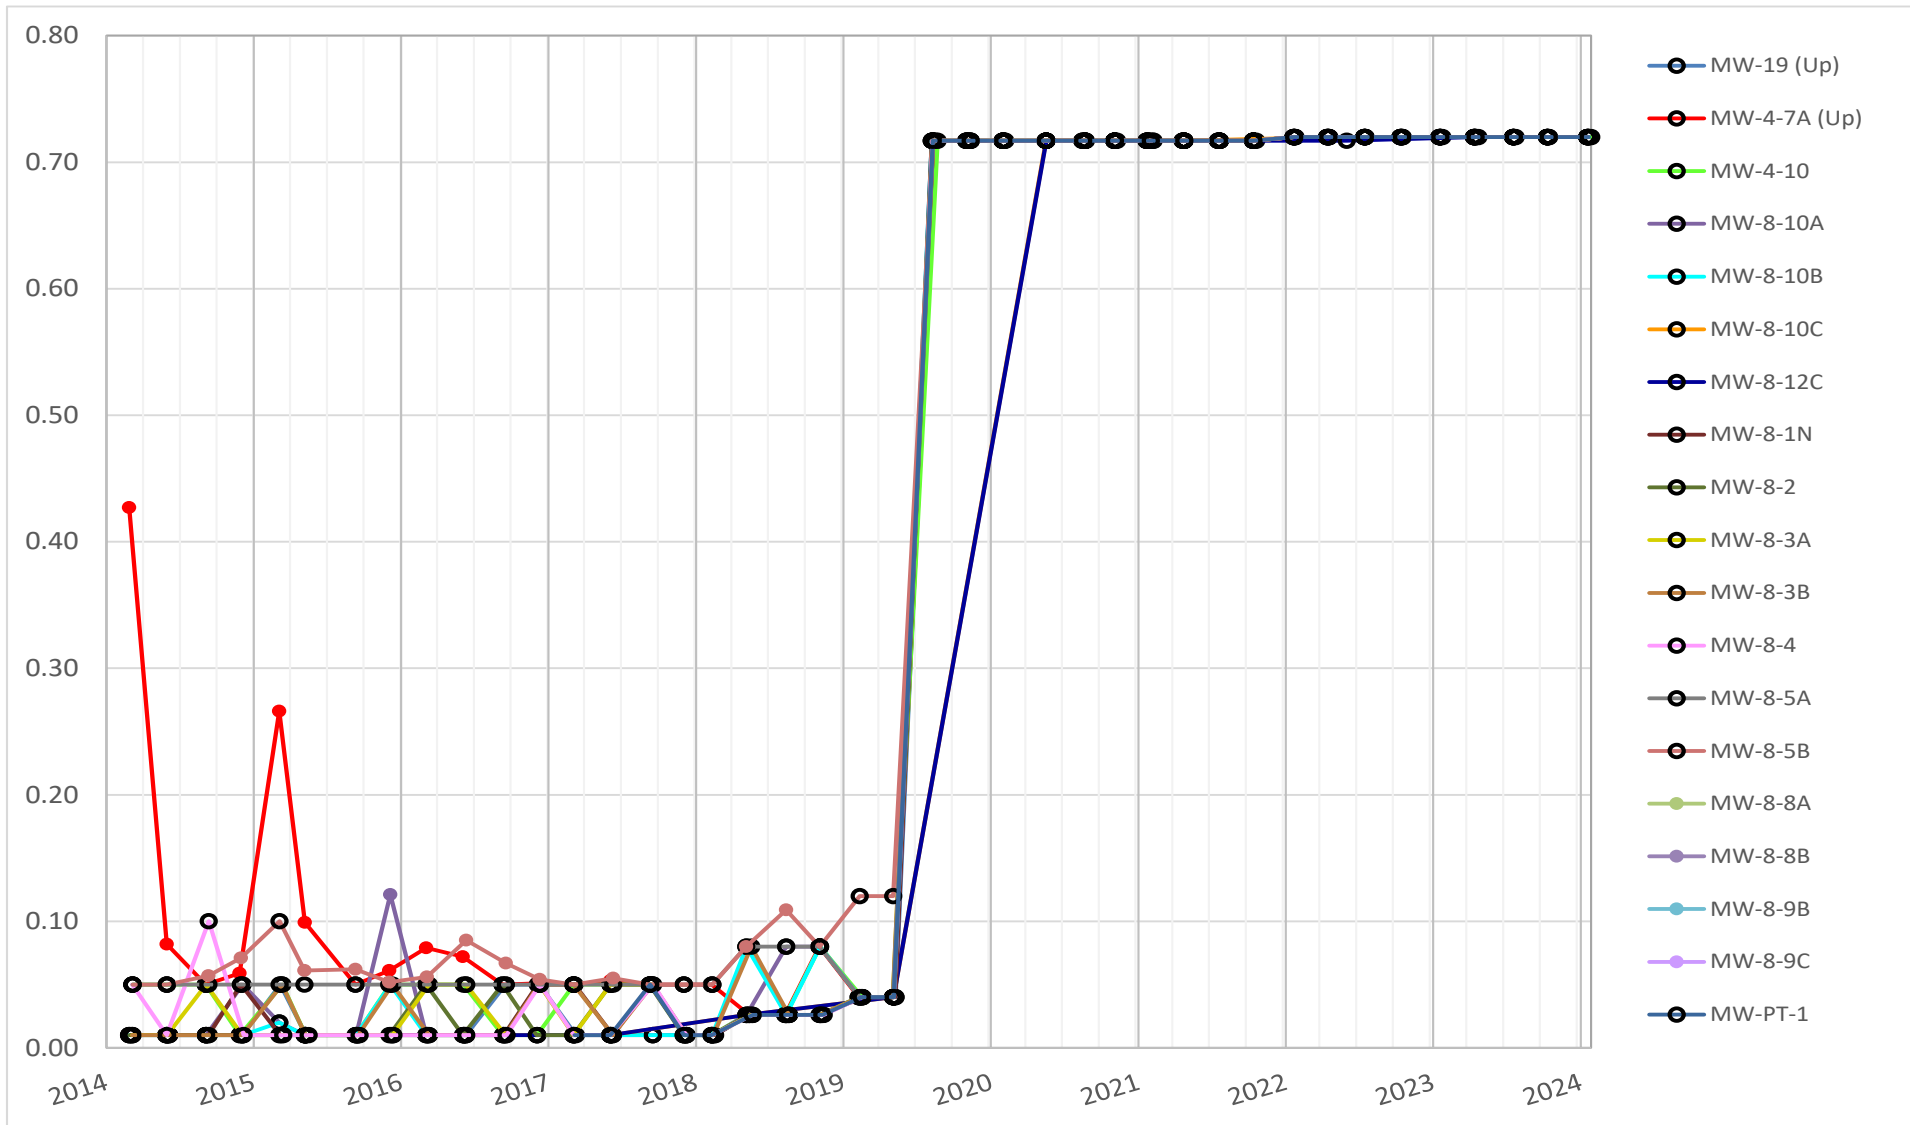

**NOTE: Data does not exceed standard of 2  $\mu\text{g}/\text{l}$  during this time frame**

**Molybdenum, dissolved [ $\mu\text{g/l}$ ]**

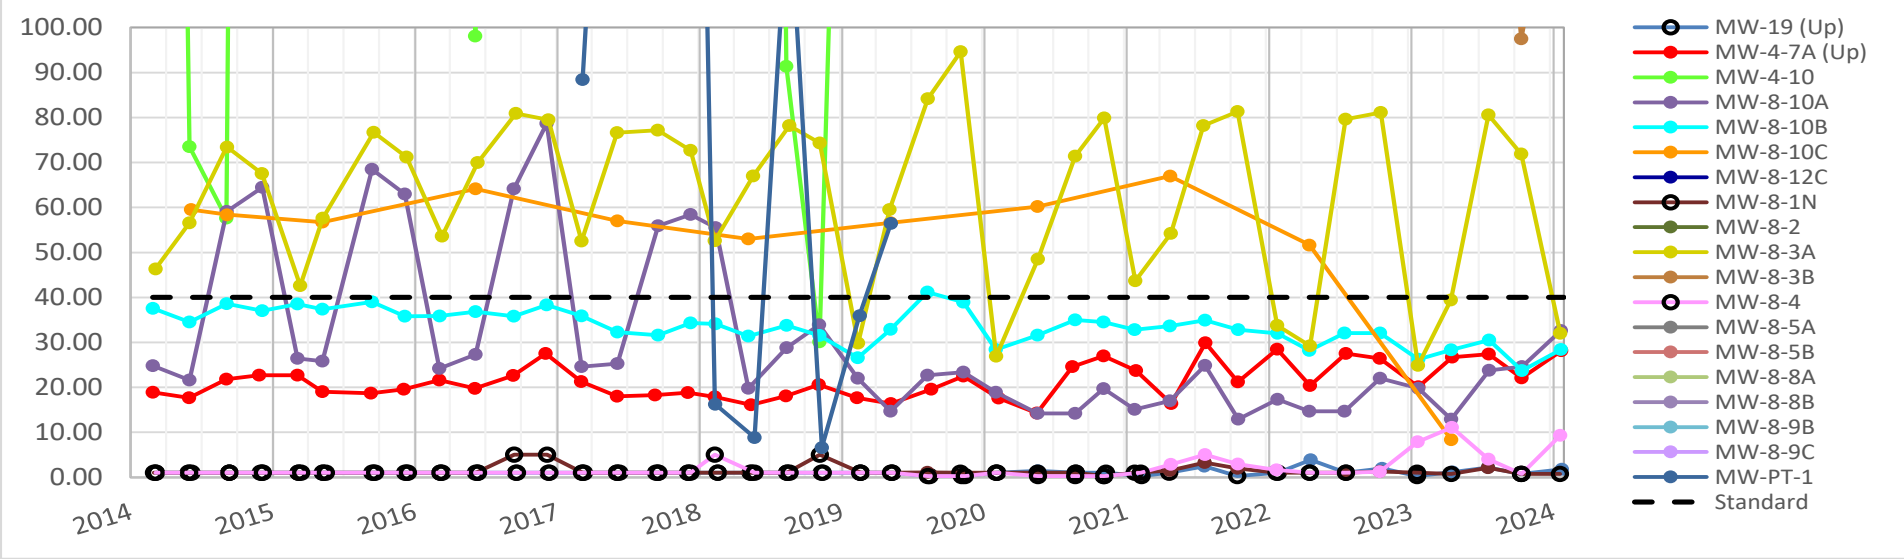
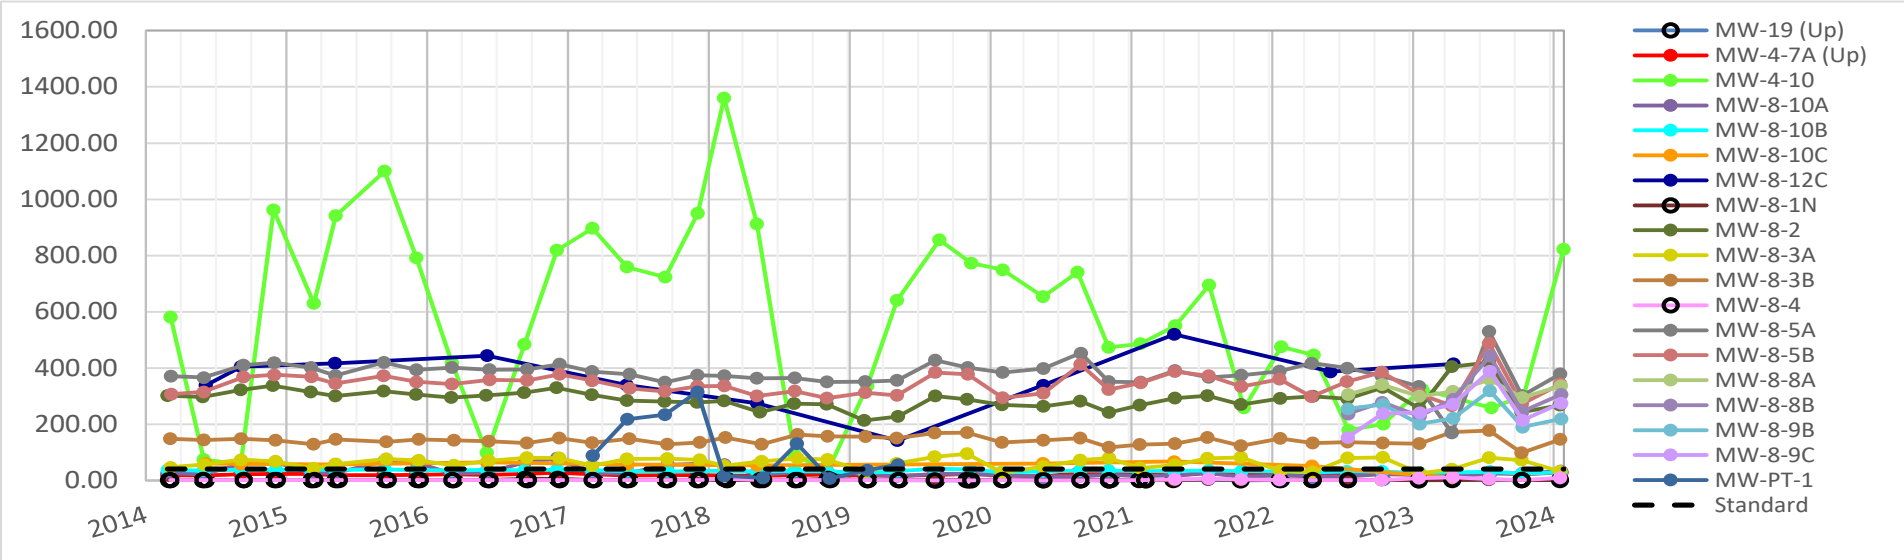


# Talen Energy

Brunner Island - Basin 5

1st Quarter 2024

## Molybdenum, total [ $\mu\text{g/l}$ ]

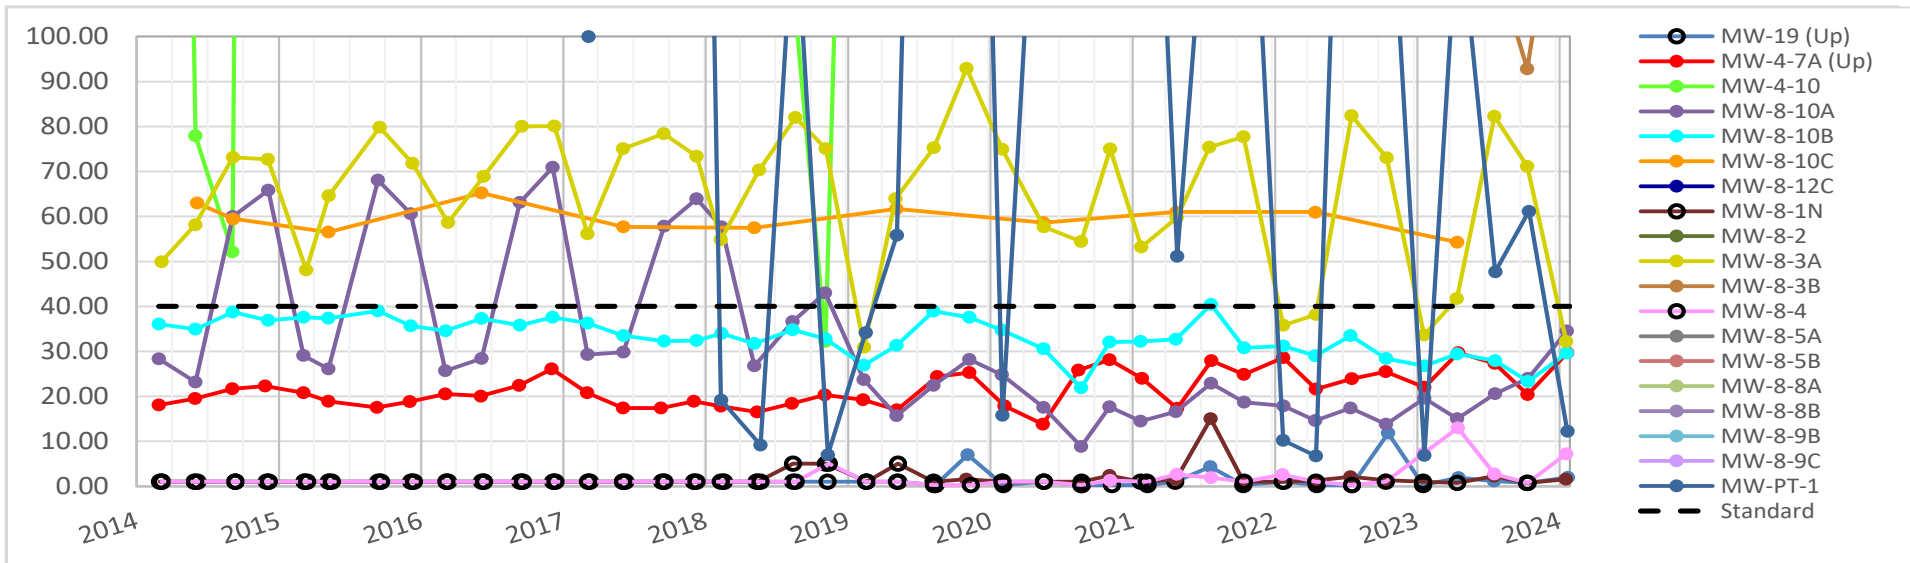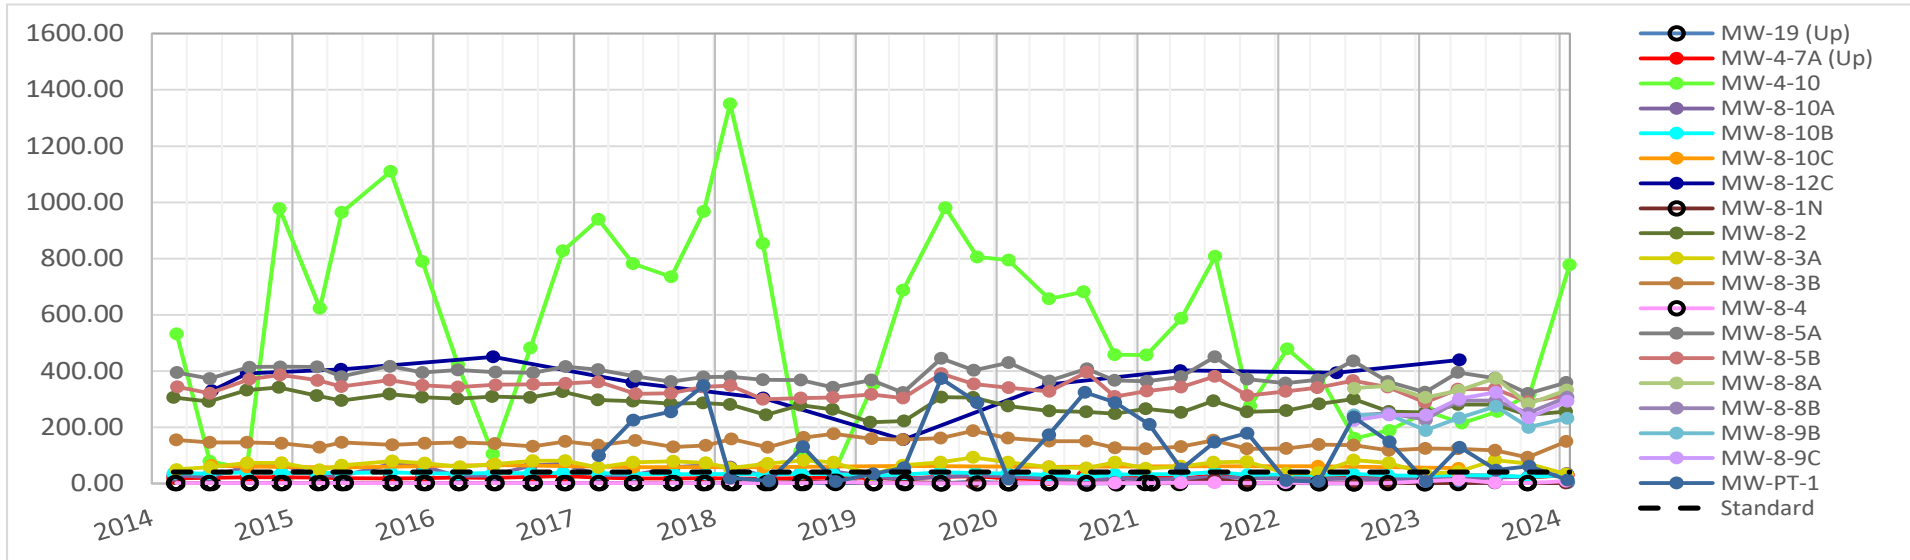











*pH, field [s.u.]*

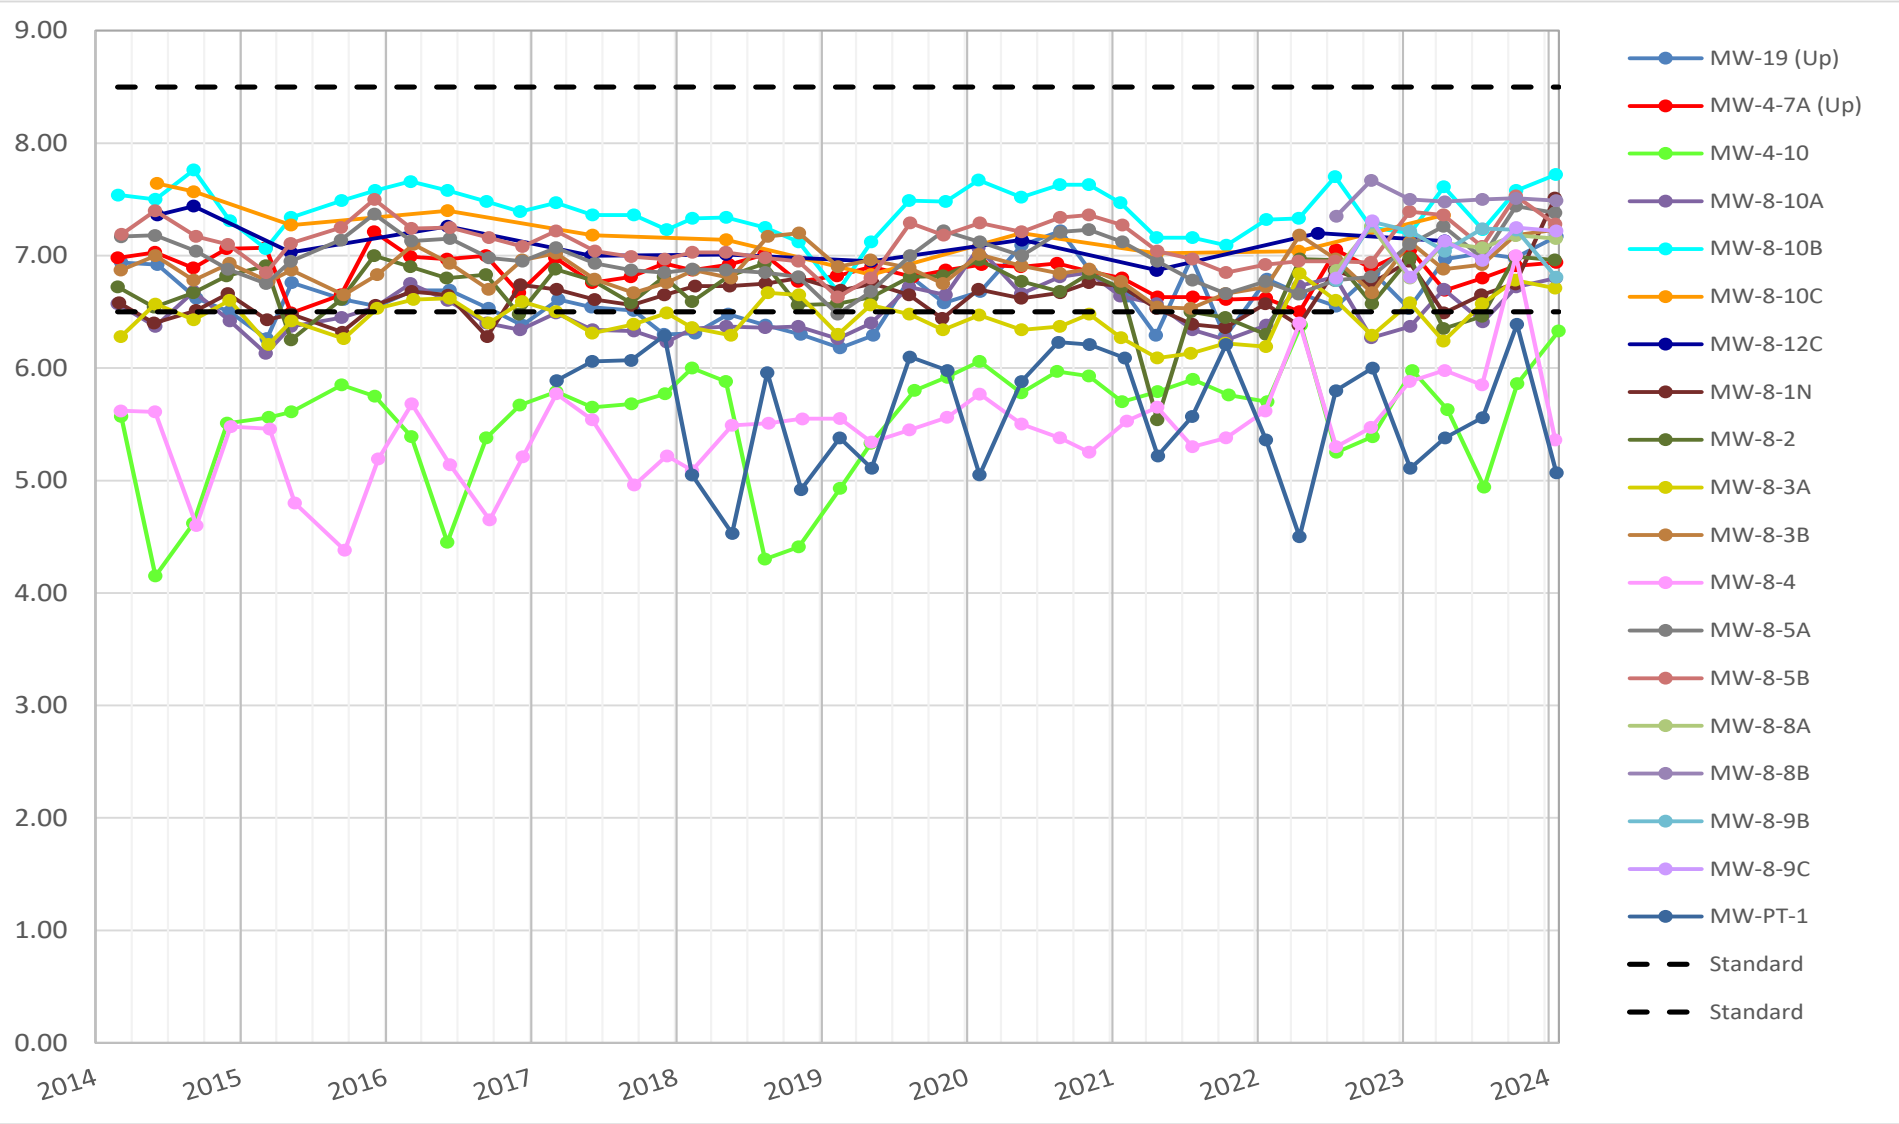

**pH, lab [s.u.]**


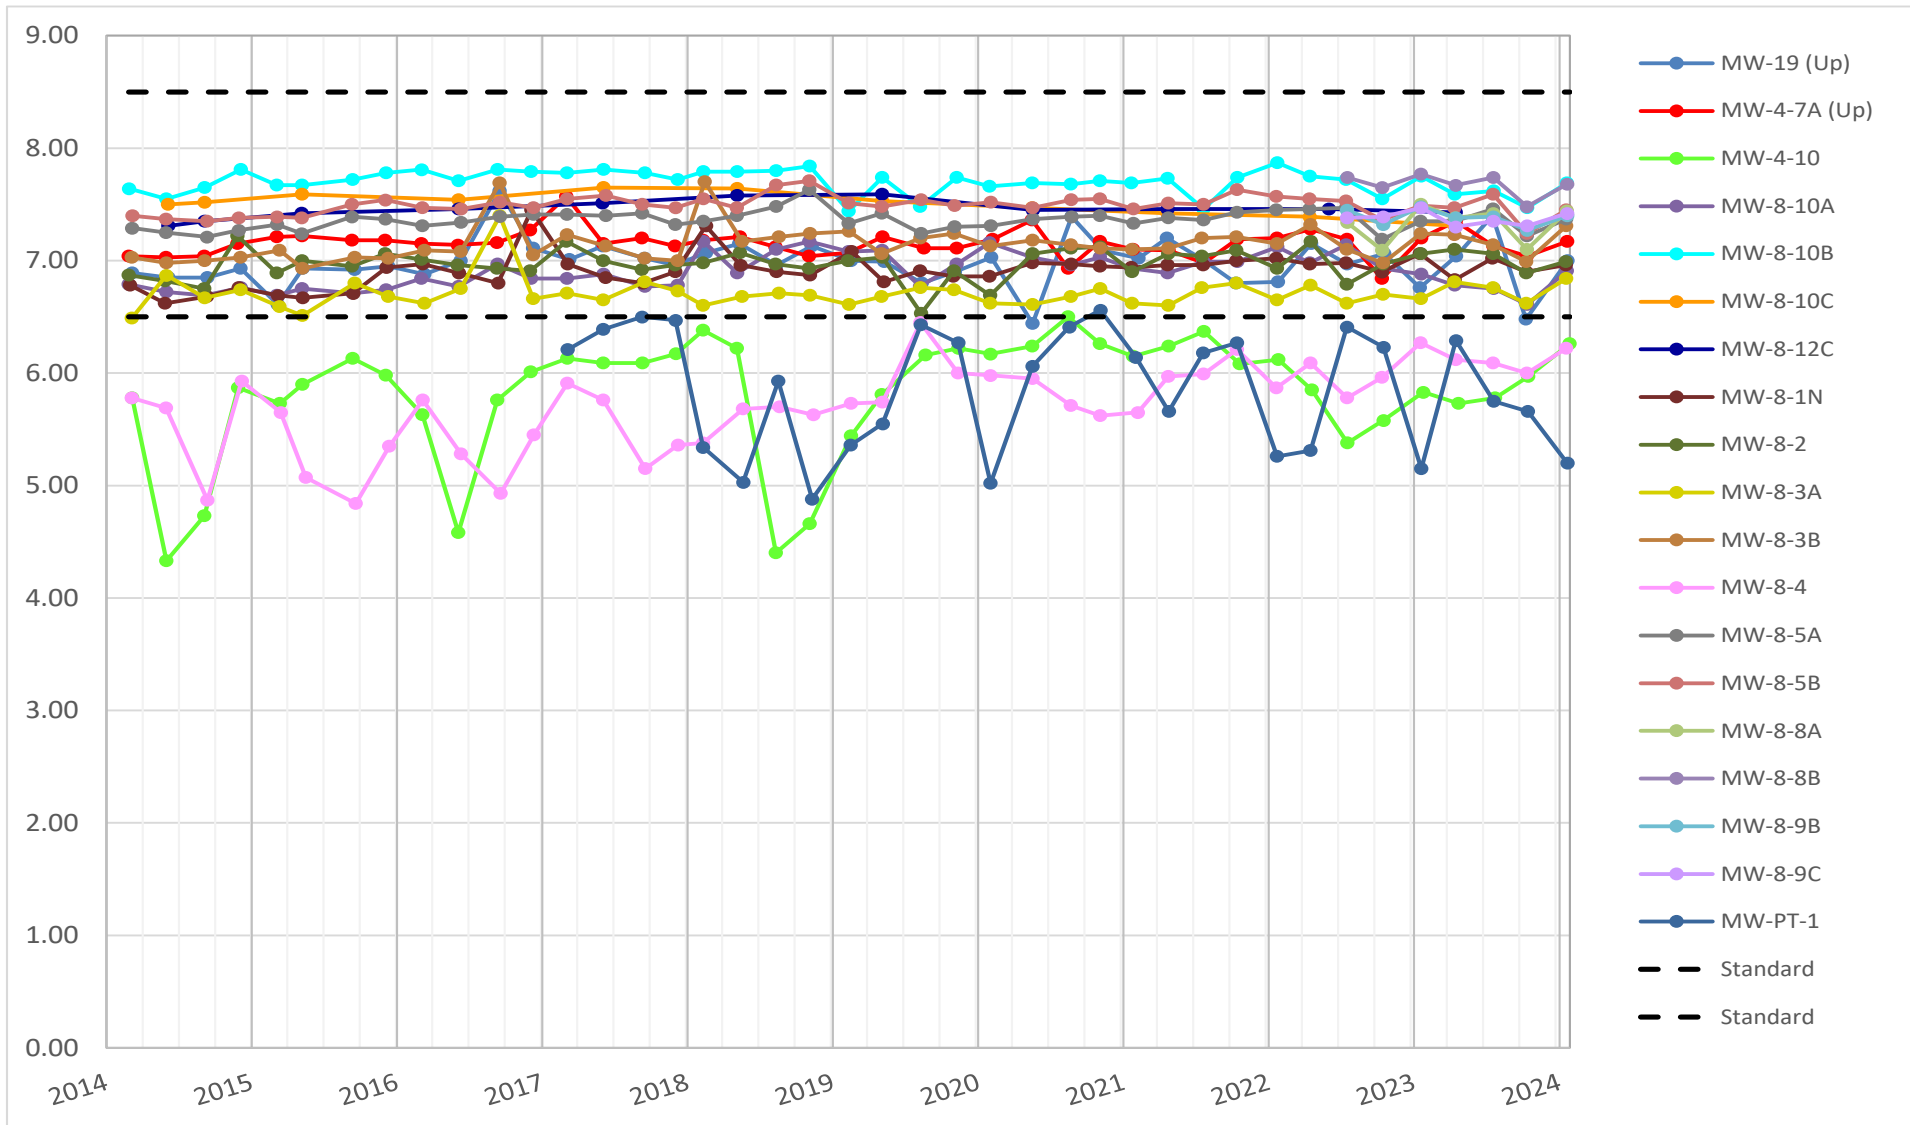


**Potassium, dissolved [mg/l]**

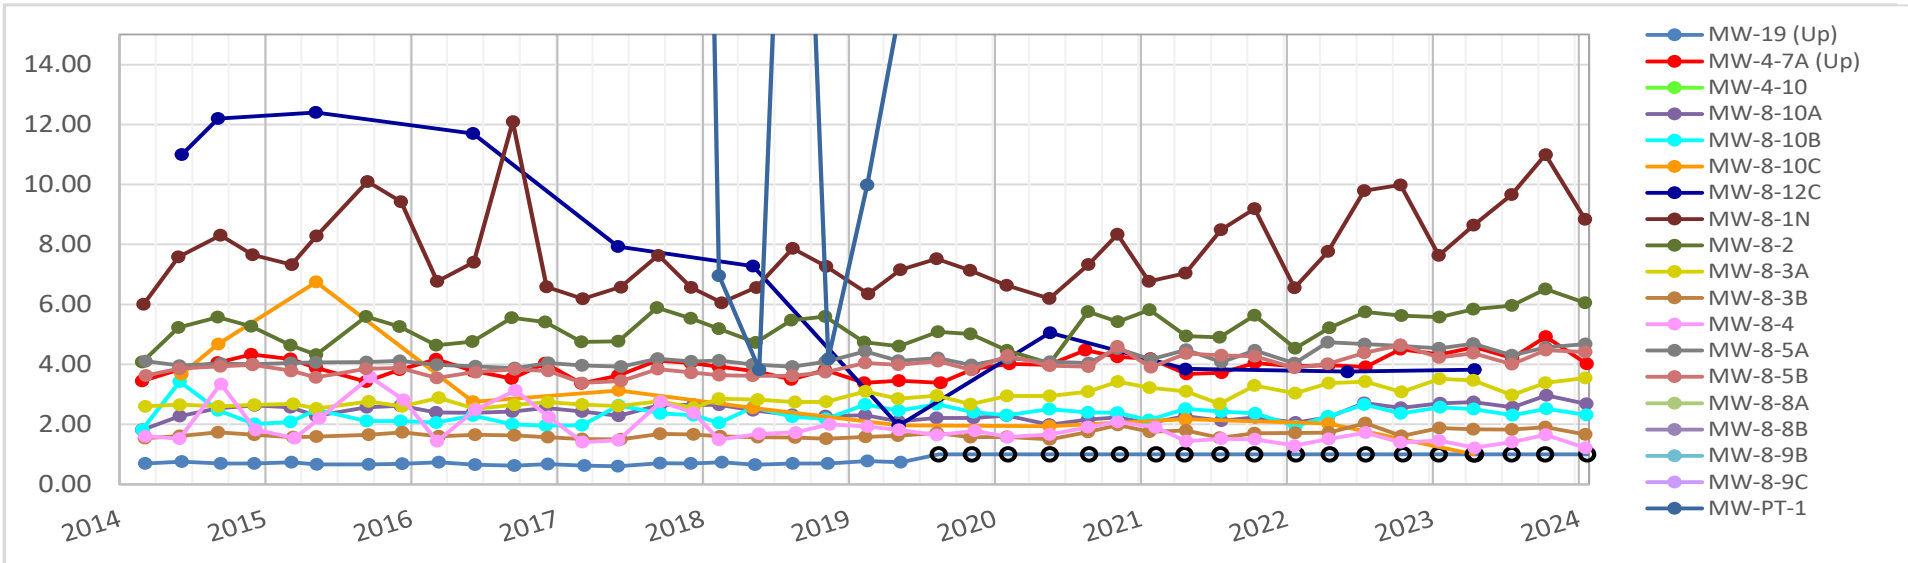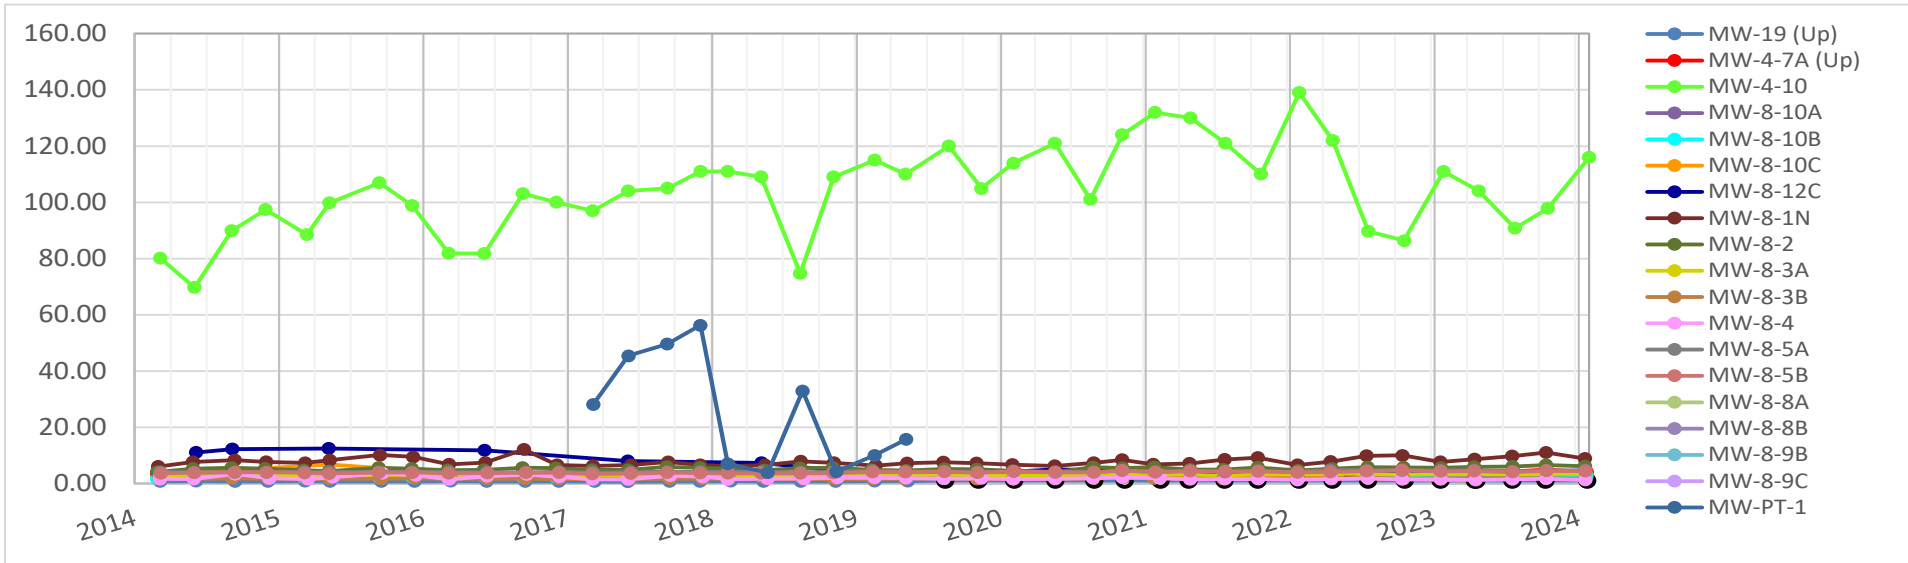


**NOTE: There are no applicable standards for this parameter**

**Potassium, total [mg/l]**

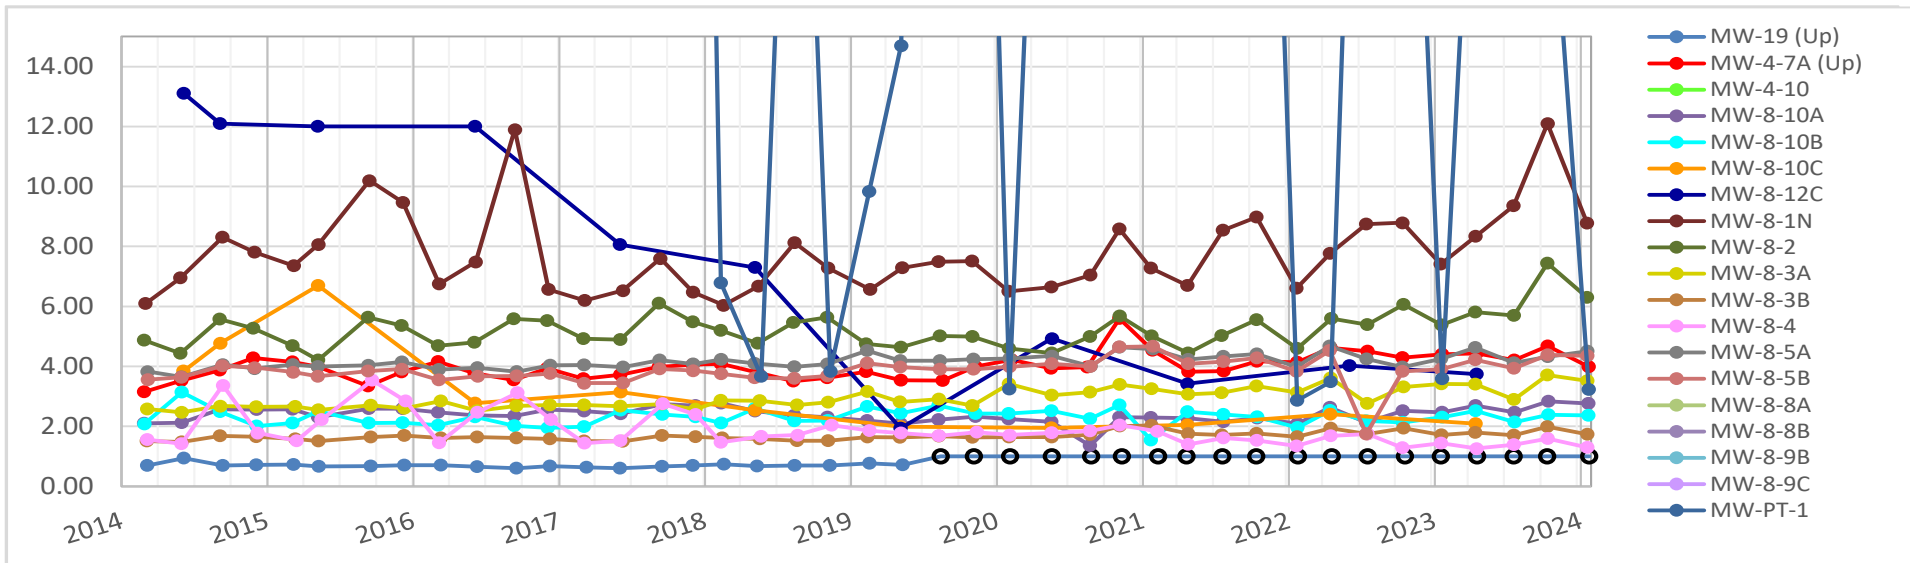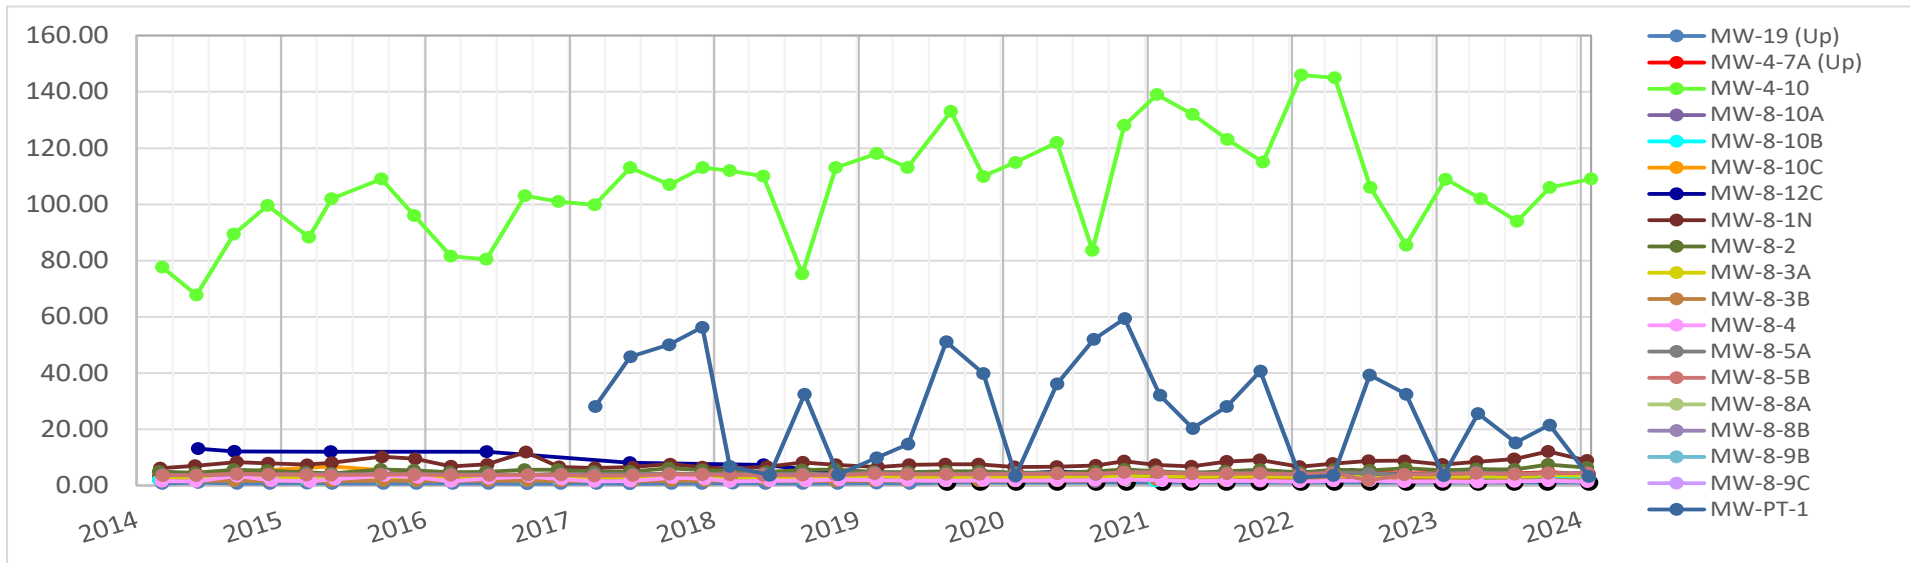

**NOTE: There are no applicable standards for this parameter**

**Redox, field [mv]**

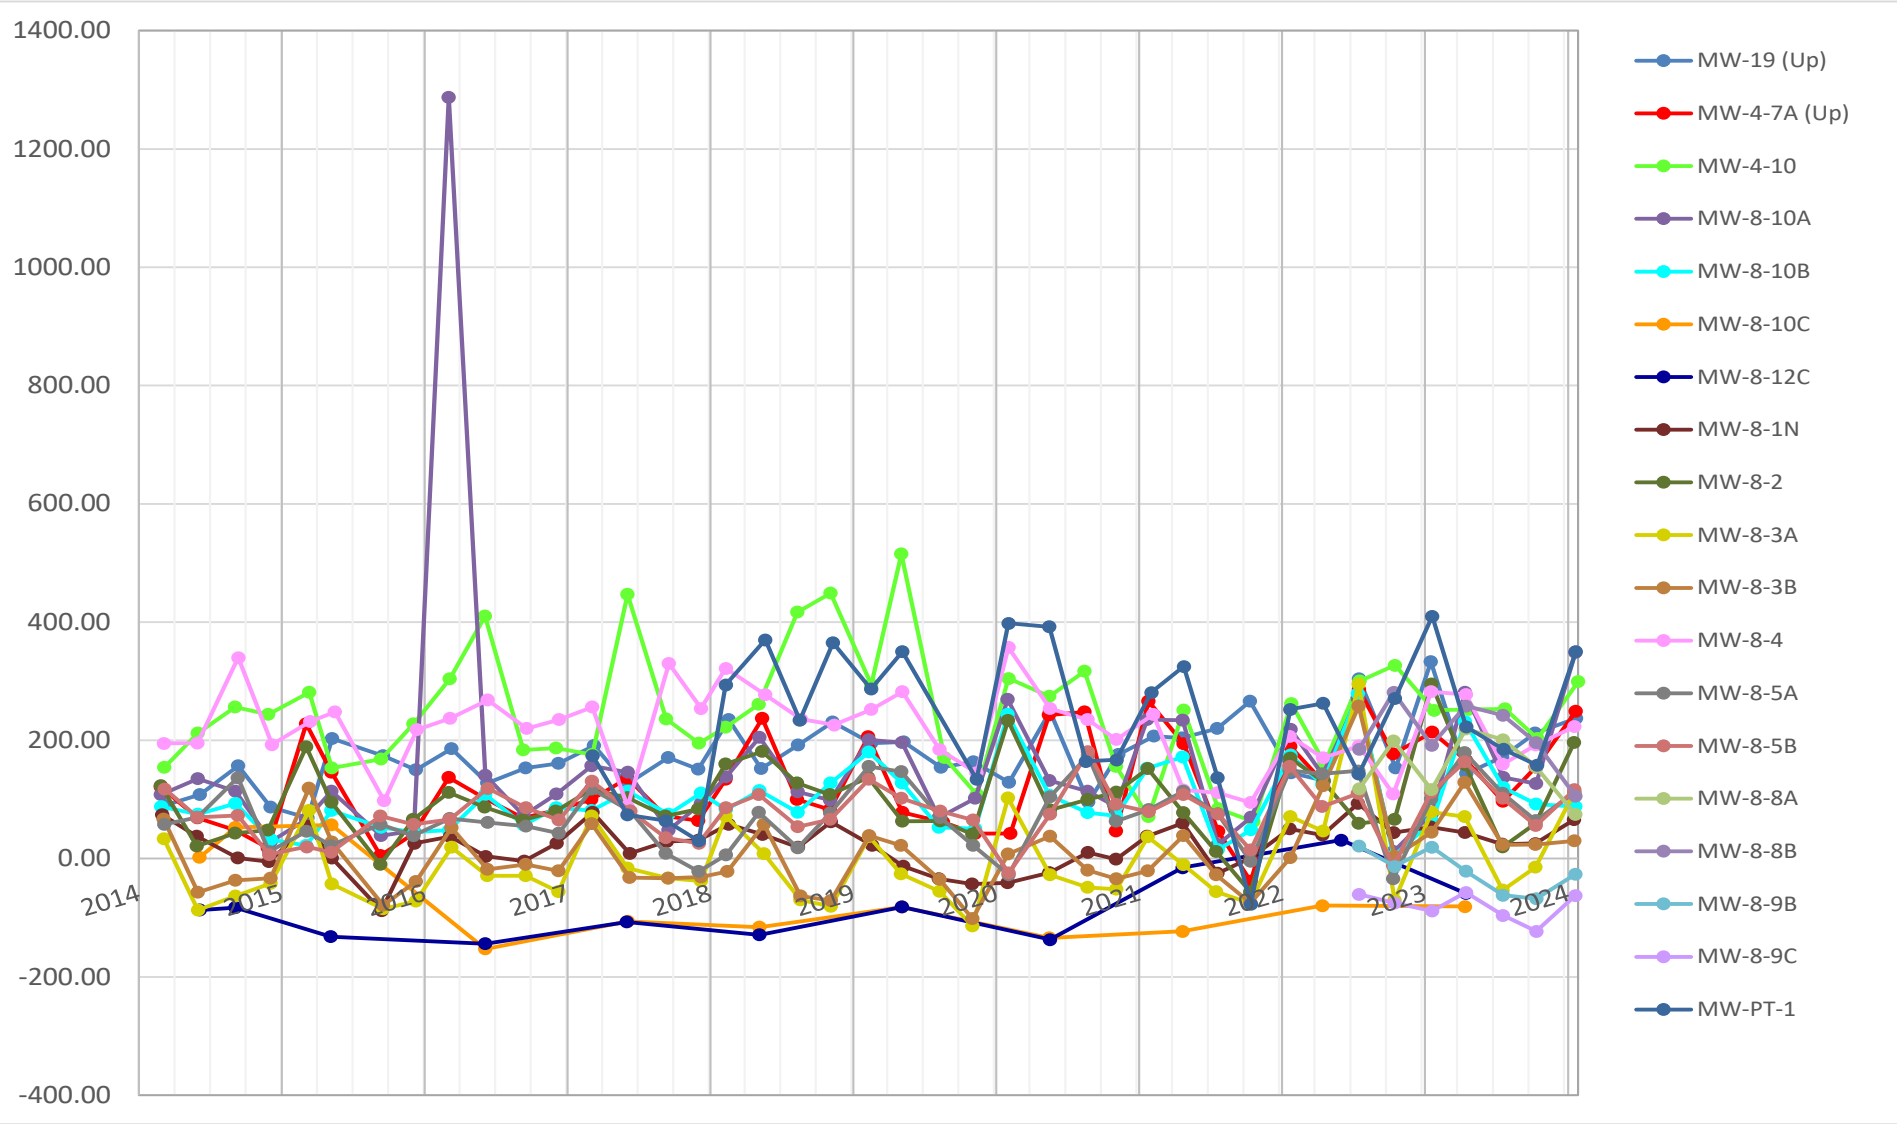


**NOTE: There are no applicable standards for this parameter**






**Silver, dissolved [ $\mu\text{g/l}$ ]**

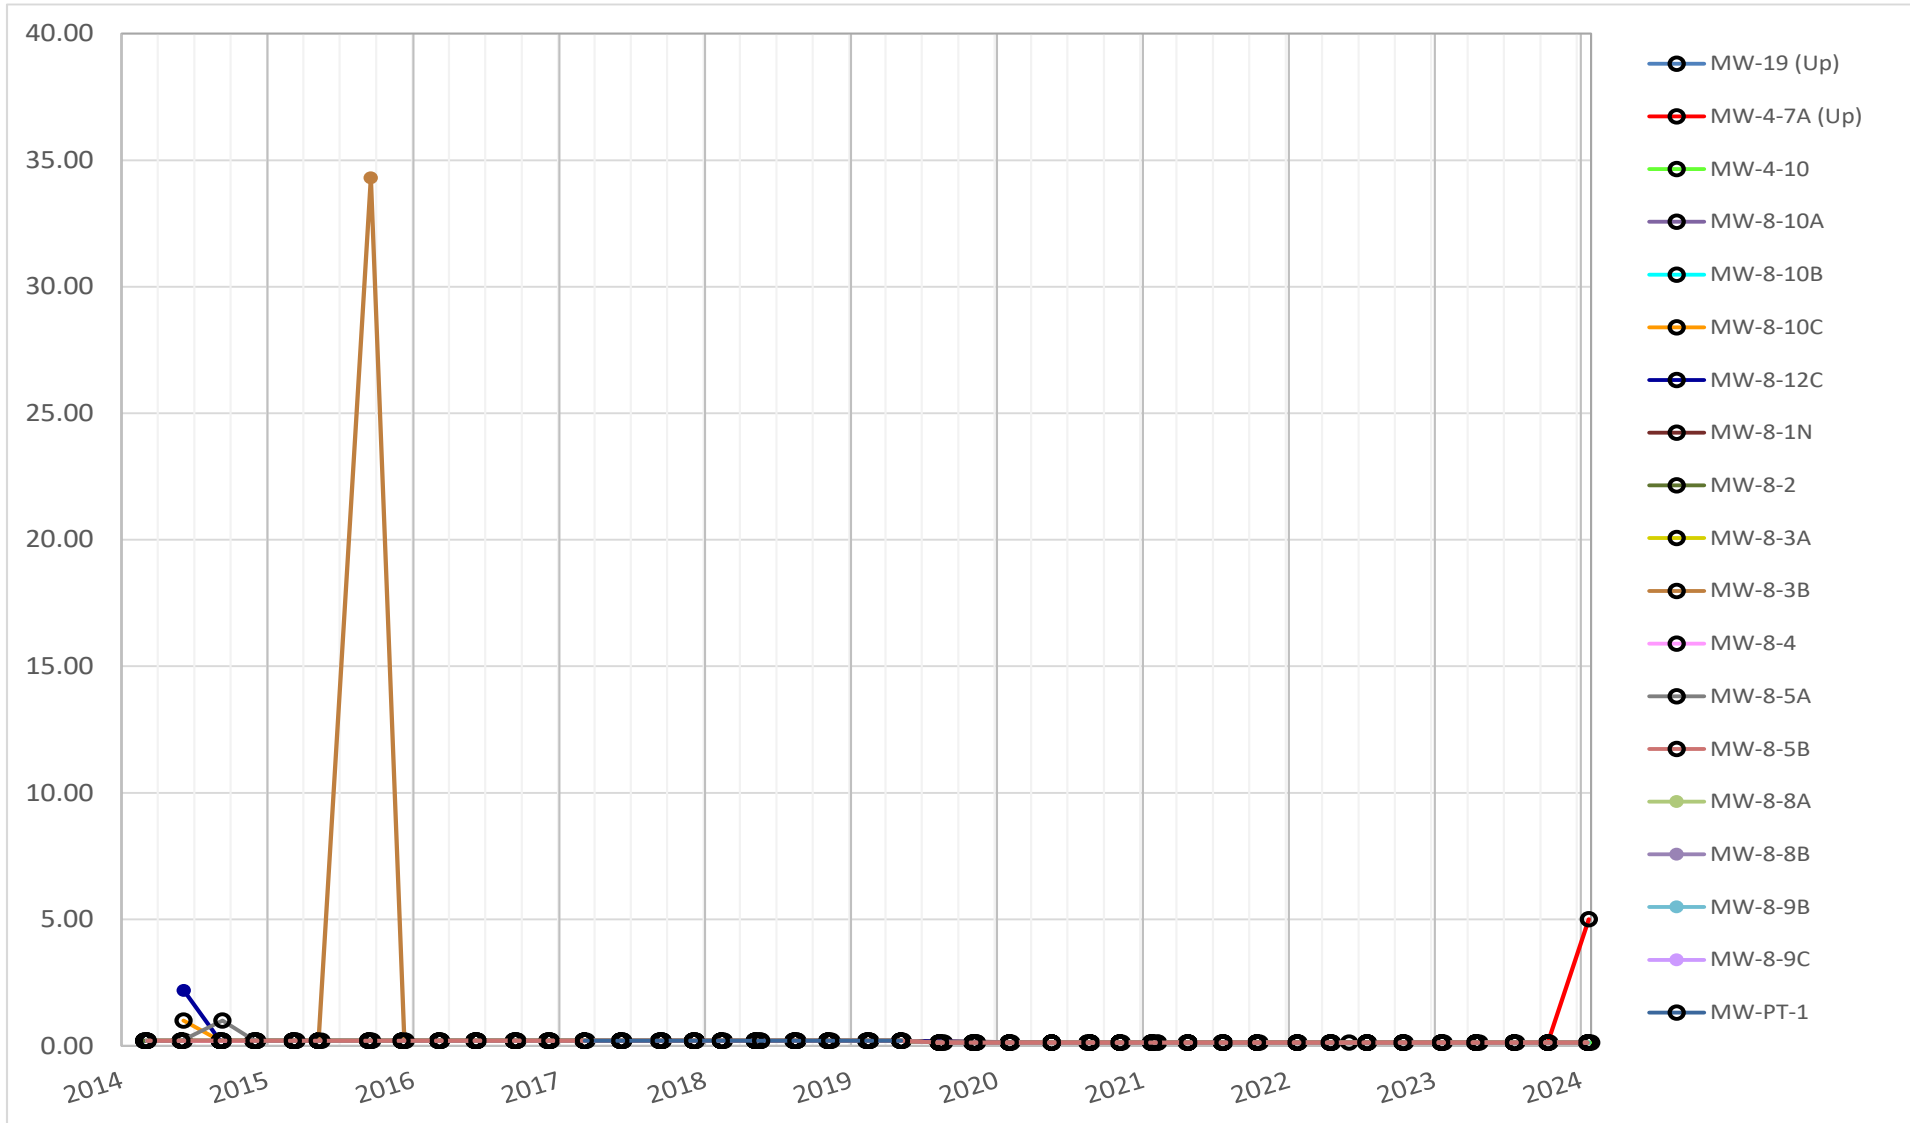


**NOTE: Data does not exceed standard of 100  $\mu\text{g/l}$  during this time frame**

**Silver, total [ $\mu\text{g/l}$ ]**

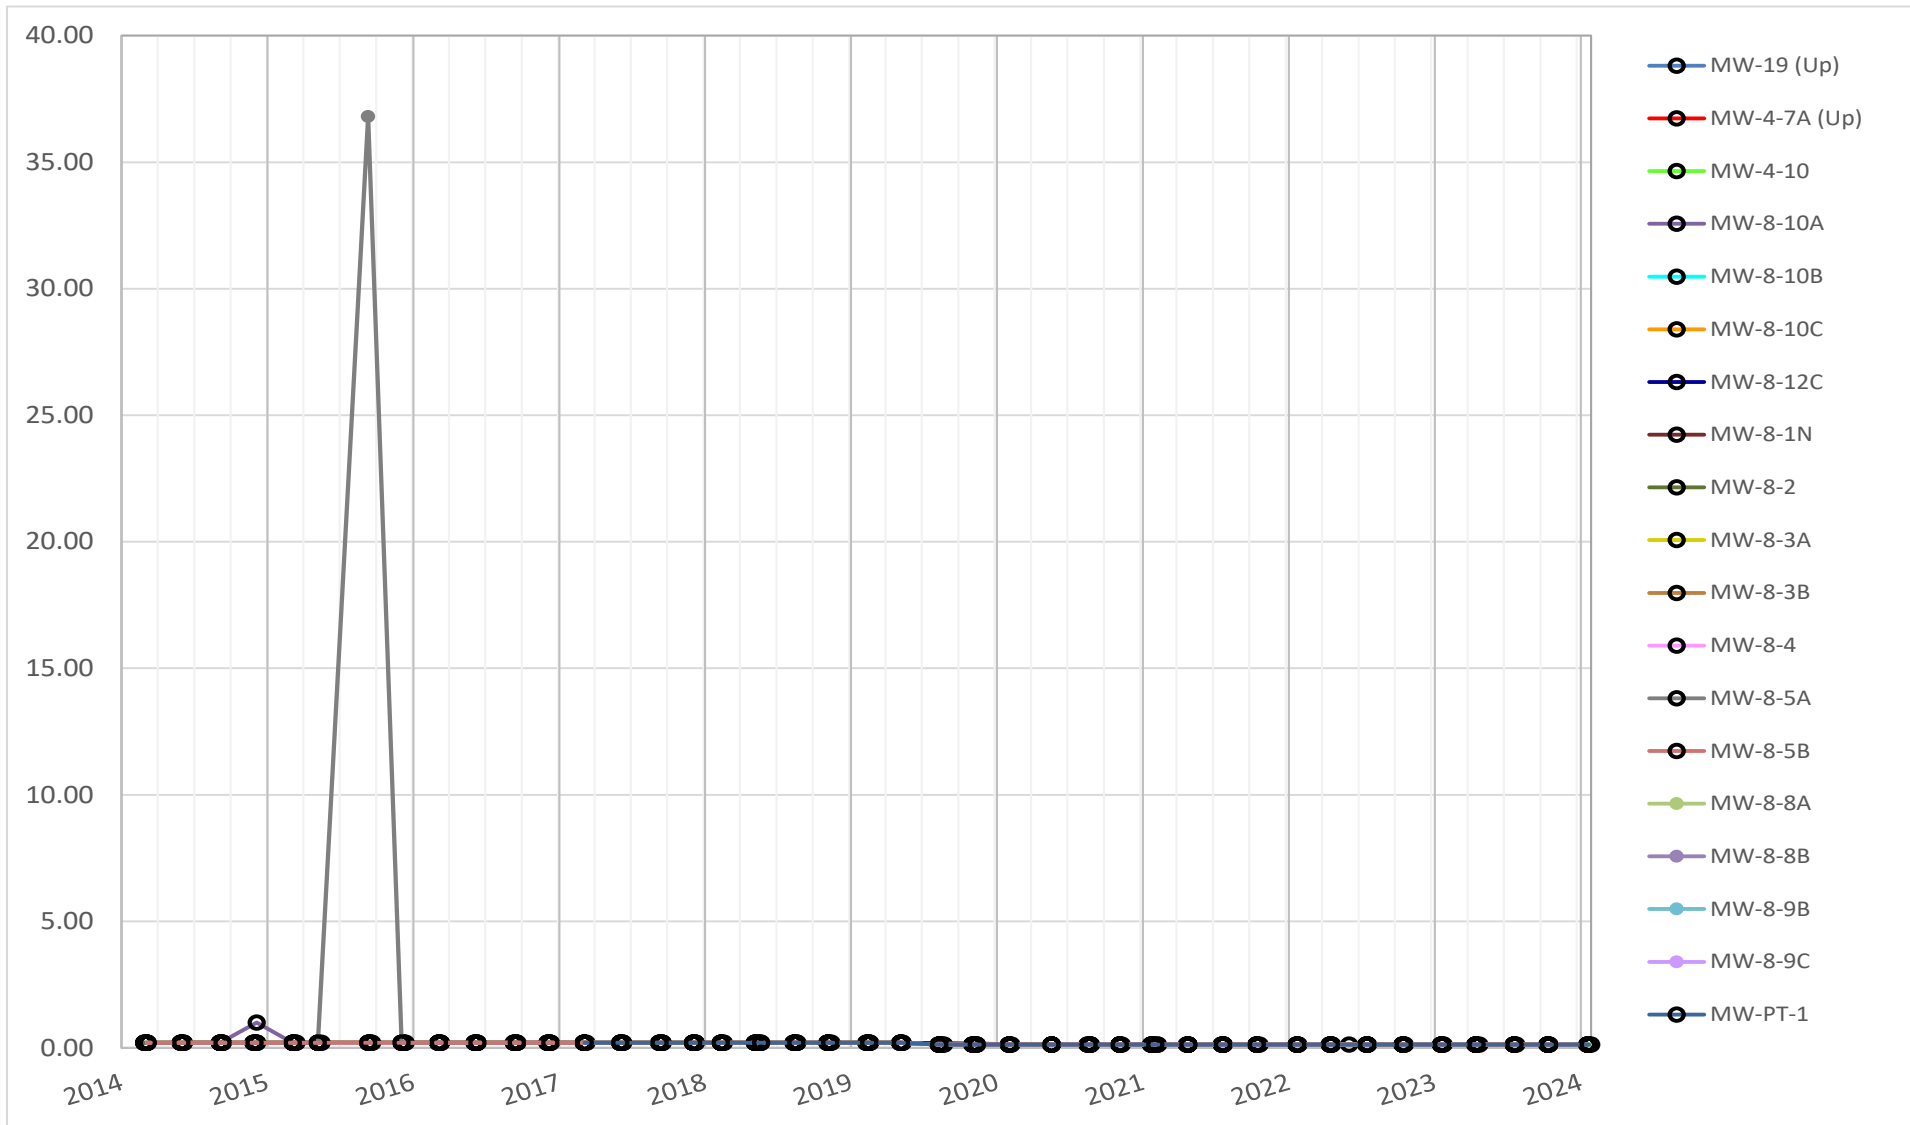


**NOTE: Data does not exceed standard of 100  $\mu\text{g/l}$  during this time frame**

**Sodium, dissolved [mg/l]**

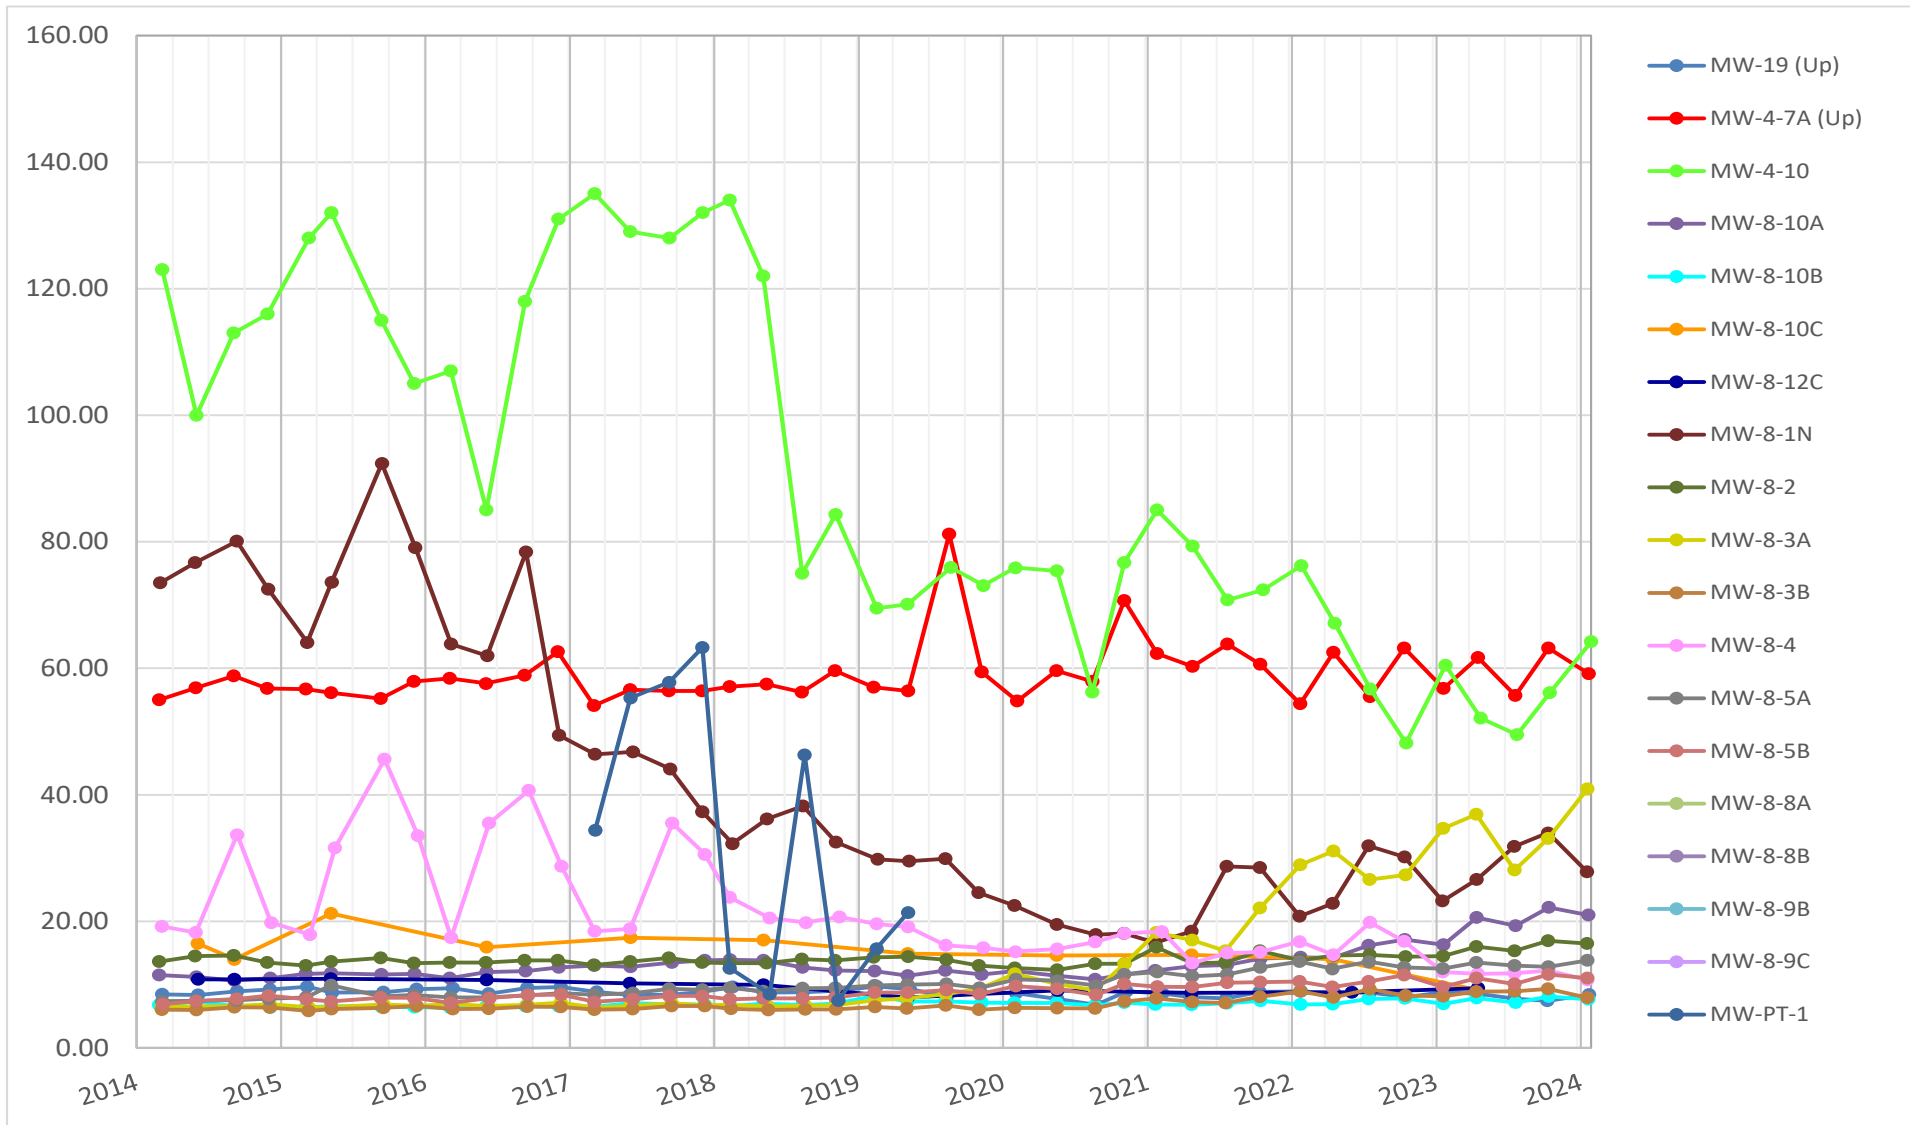


**NOTE: There are no applicable standards for this parameter**

**Sodium, total [mg/l]**

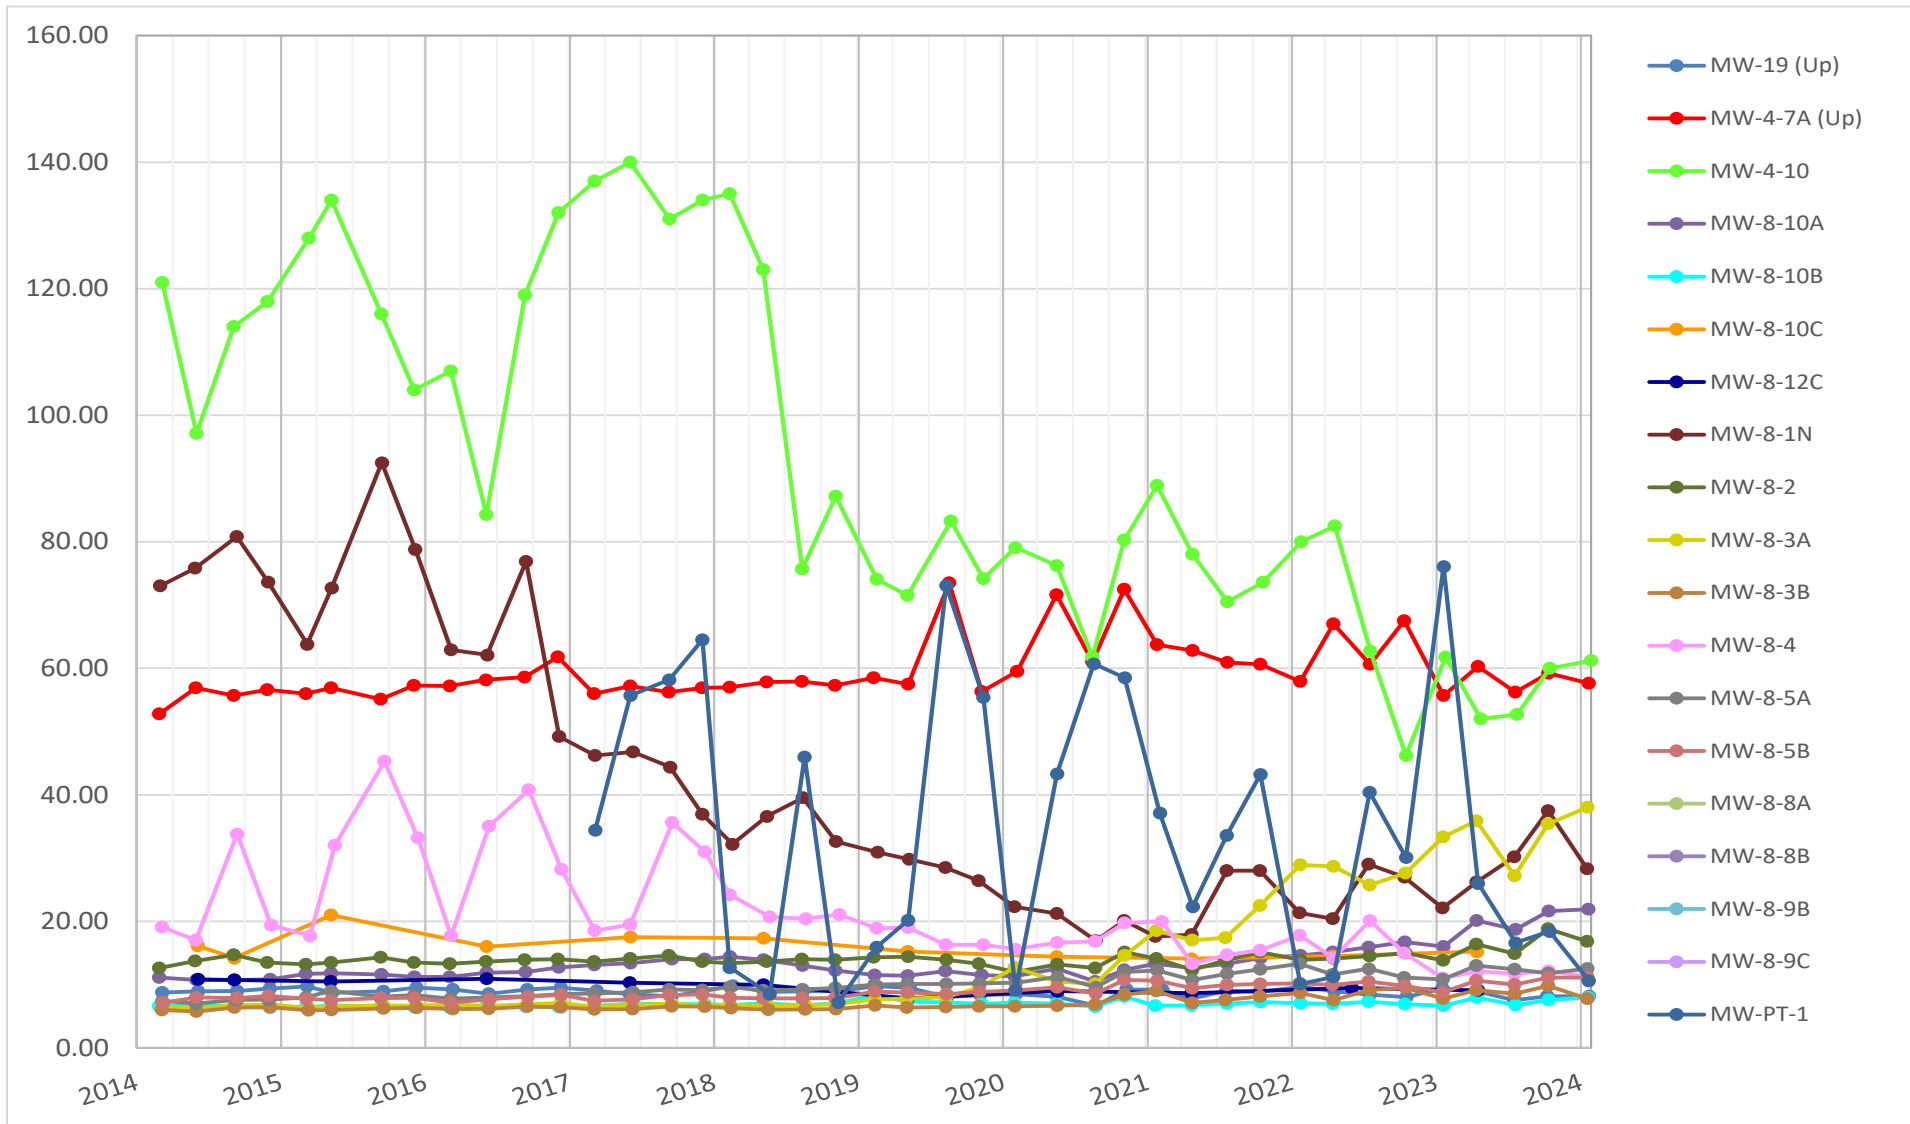


**NOTE: There are no applicable standards for this parameter**

**Specific Conductance, field [umhos/cm]**

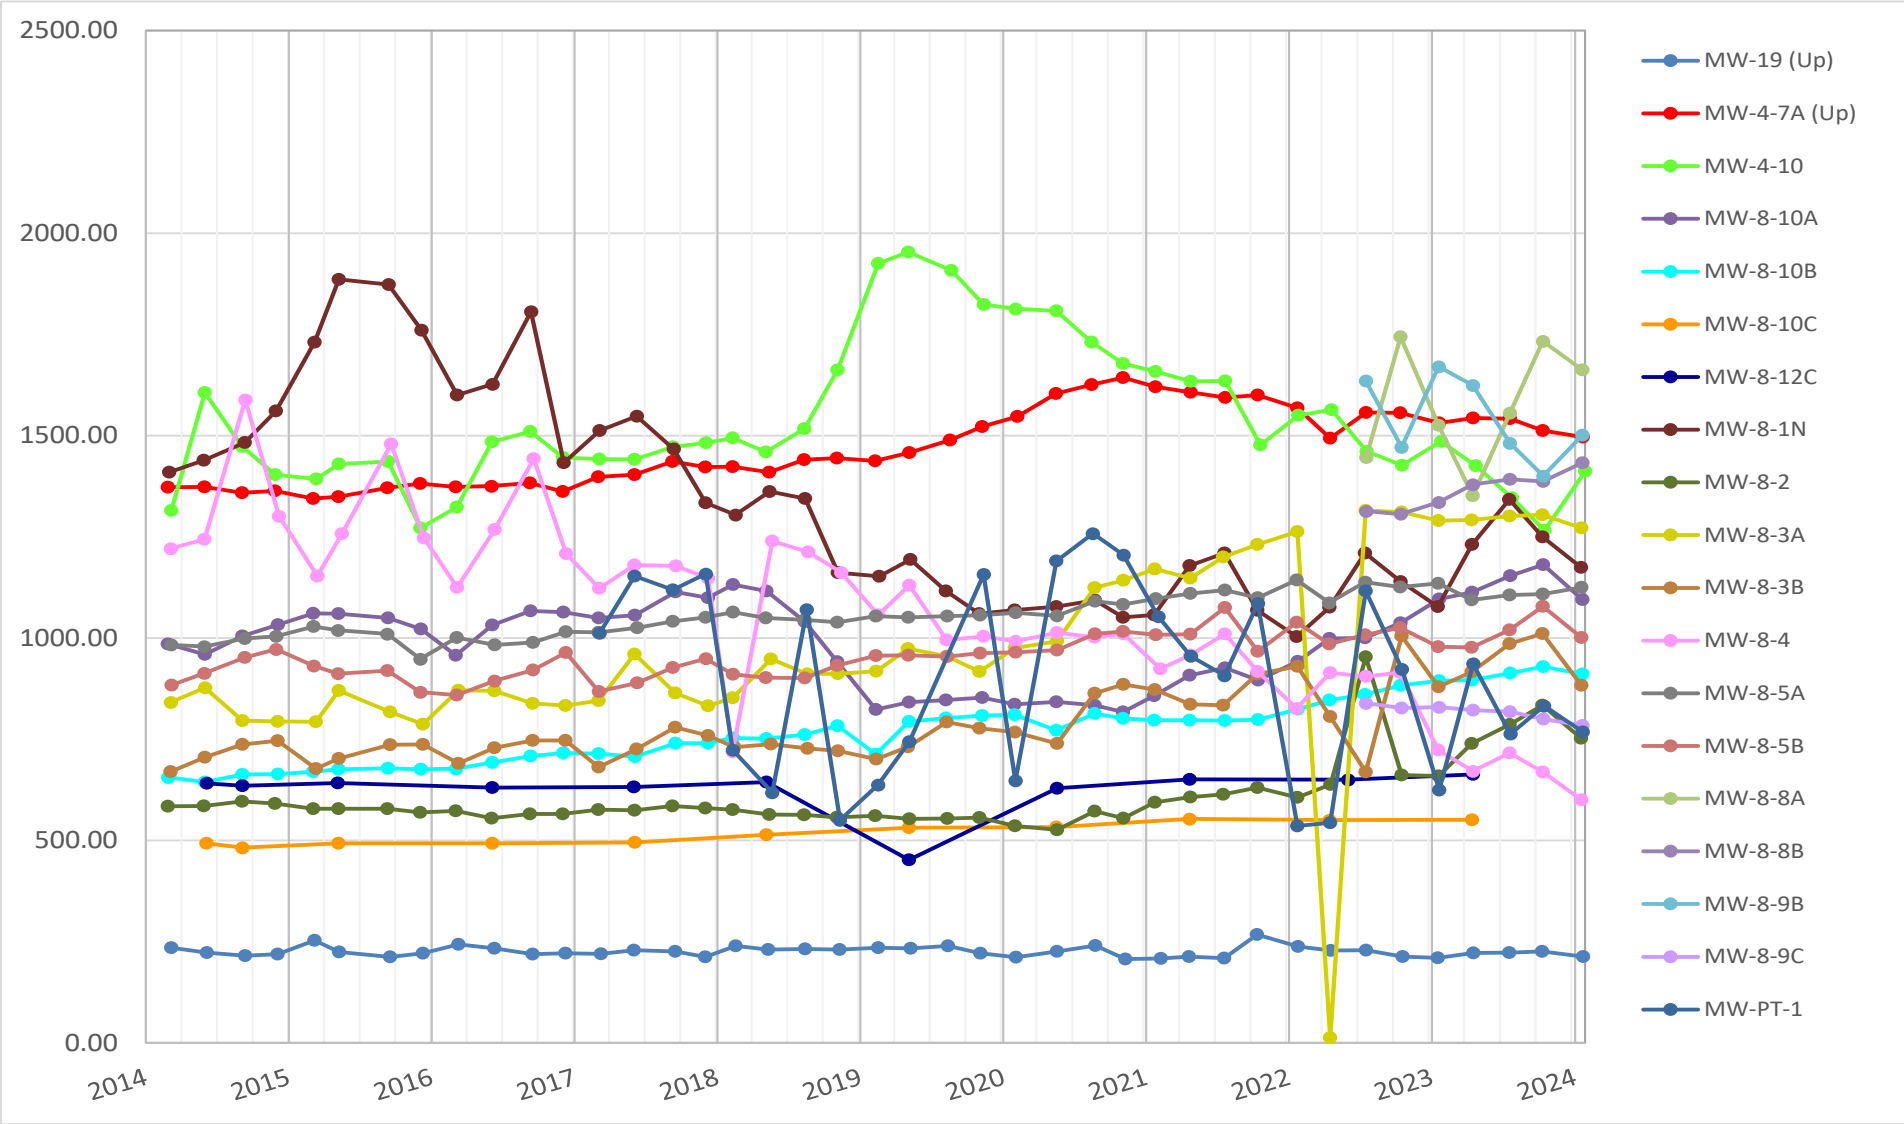


**NOTE: There are no applicable standards for this parameter**

**Specific Conductance, lab [umhos/cm]**

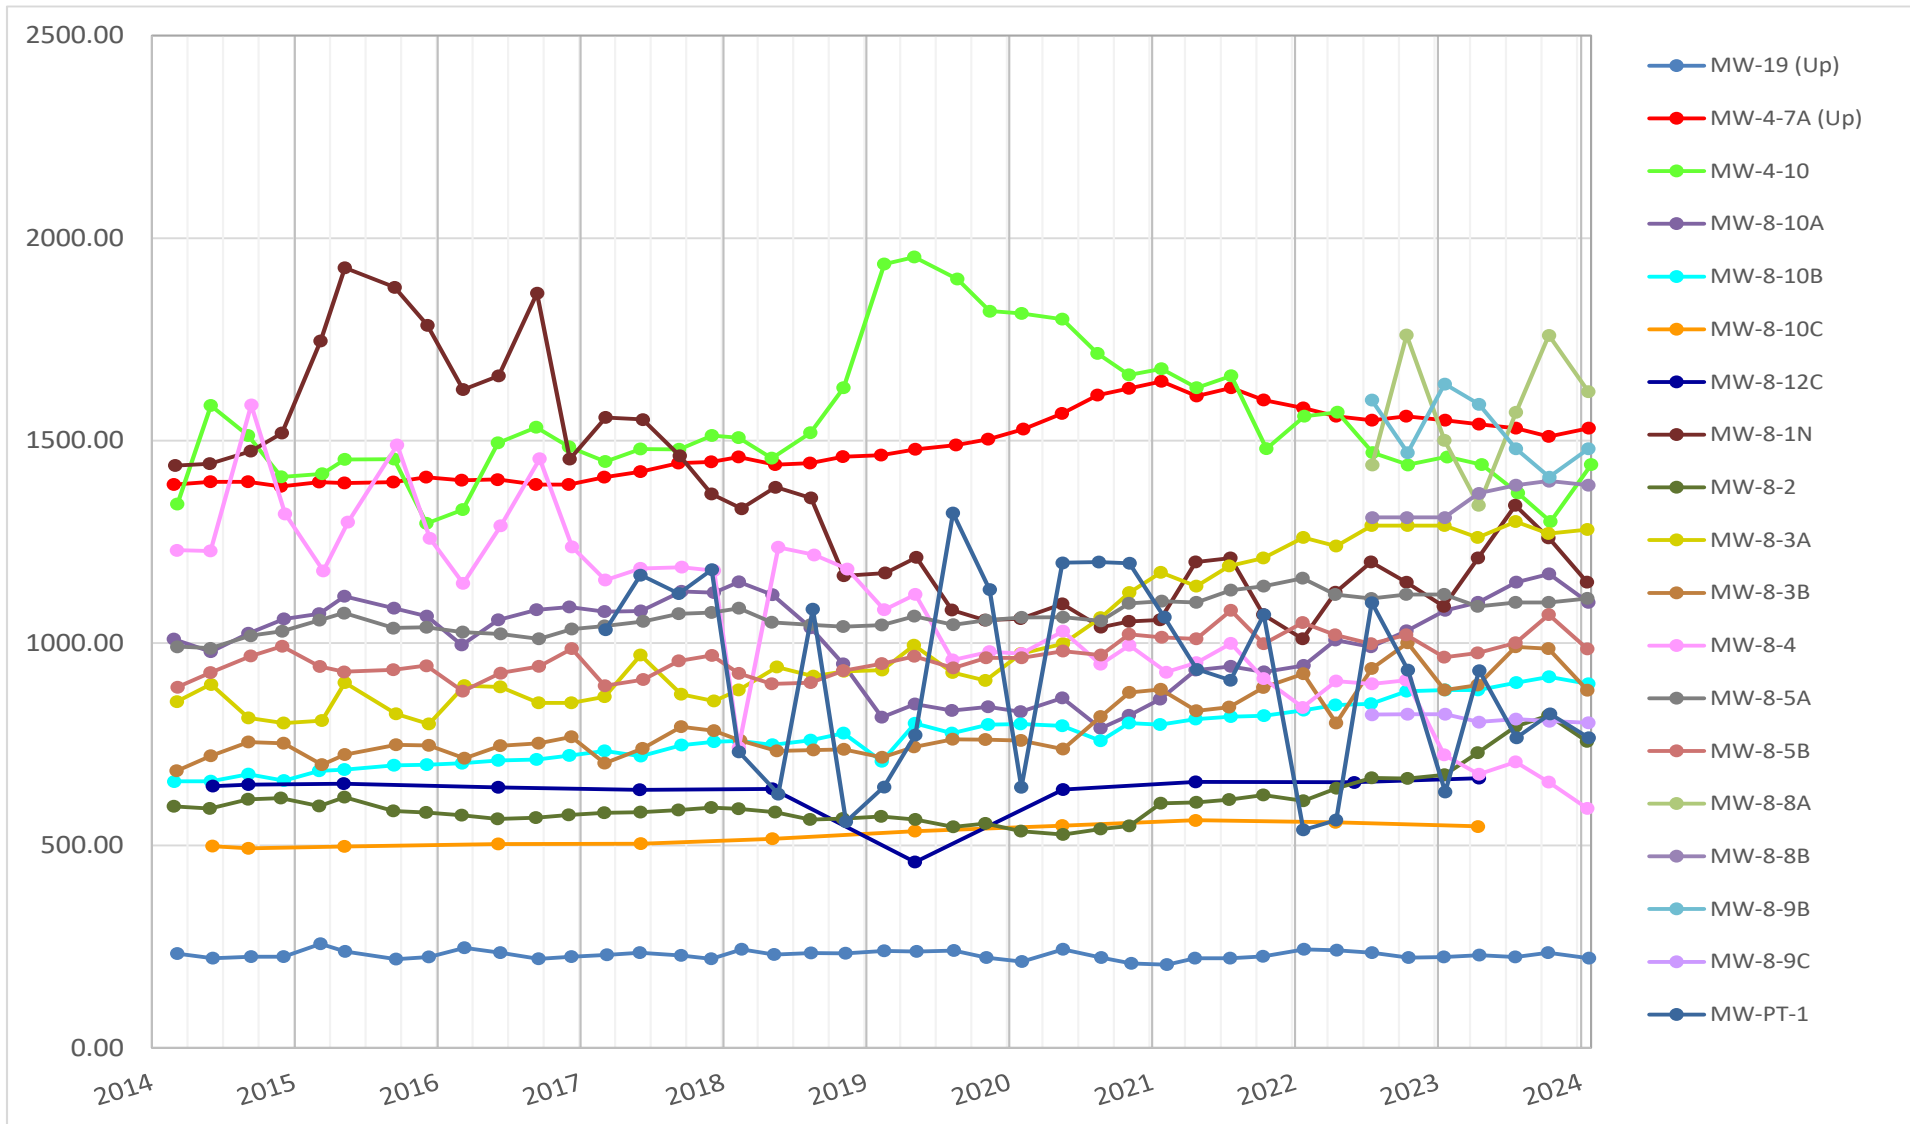


**NOTE: There are no applicable standards for this parameter**

**Strontium, dissolved [ $\mu\text{g/l}$ ]**

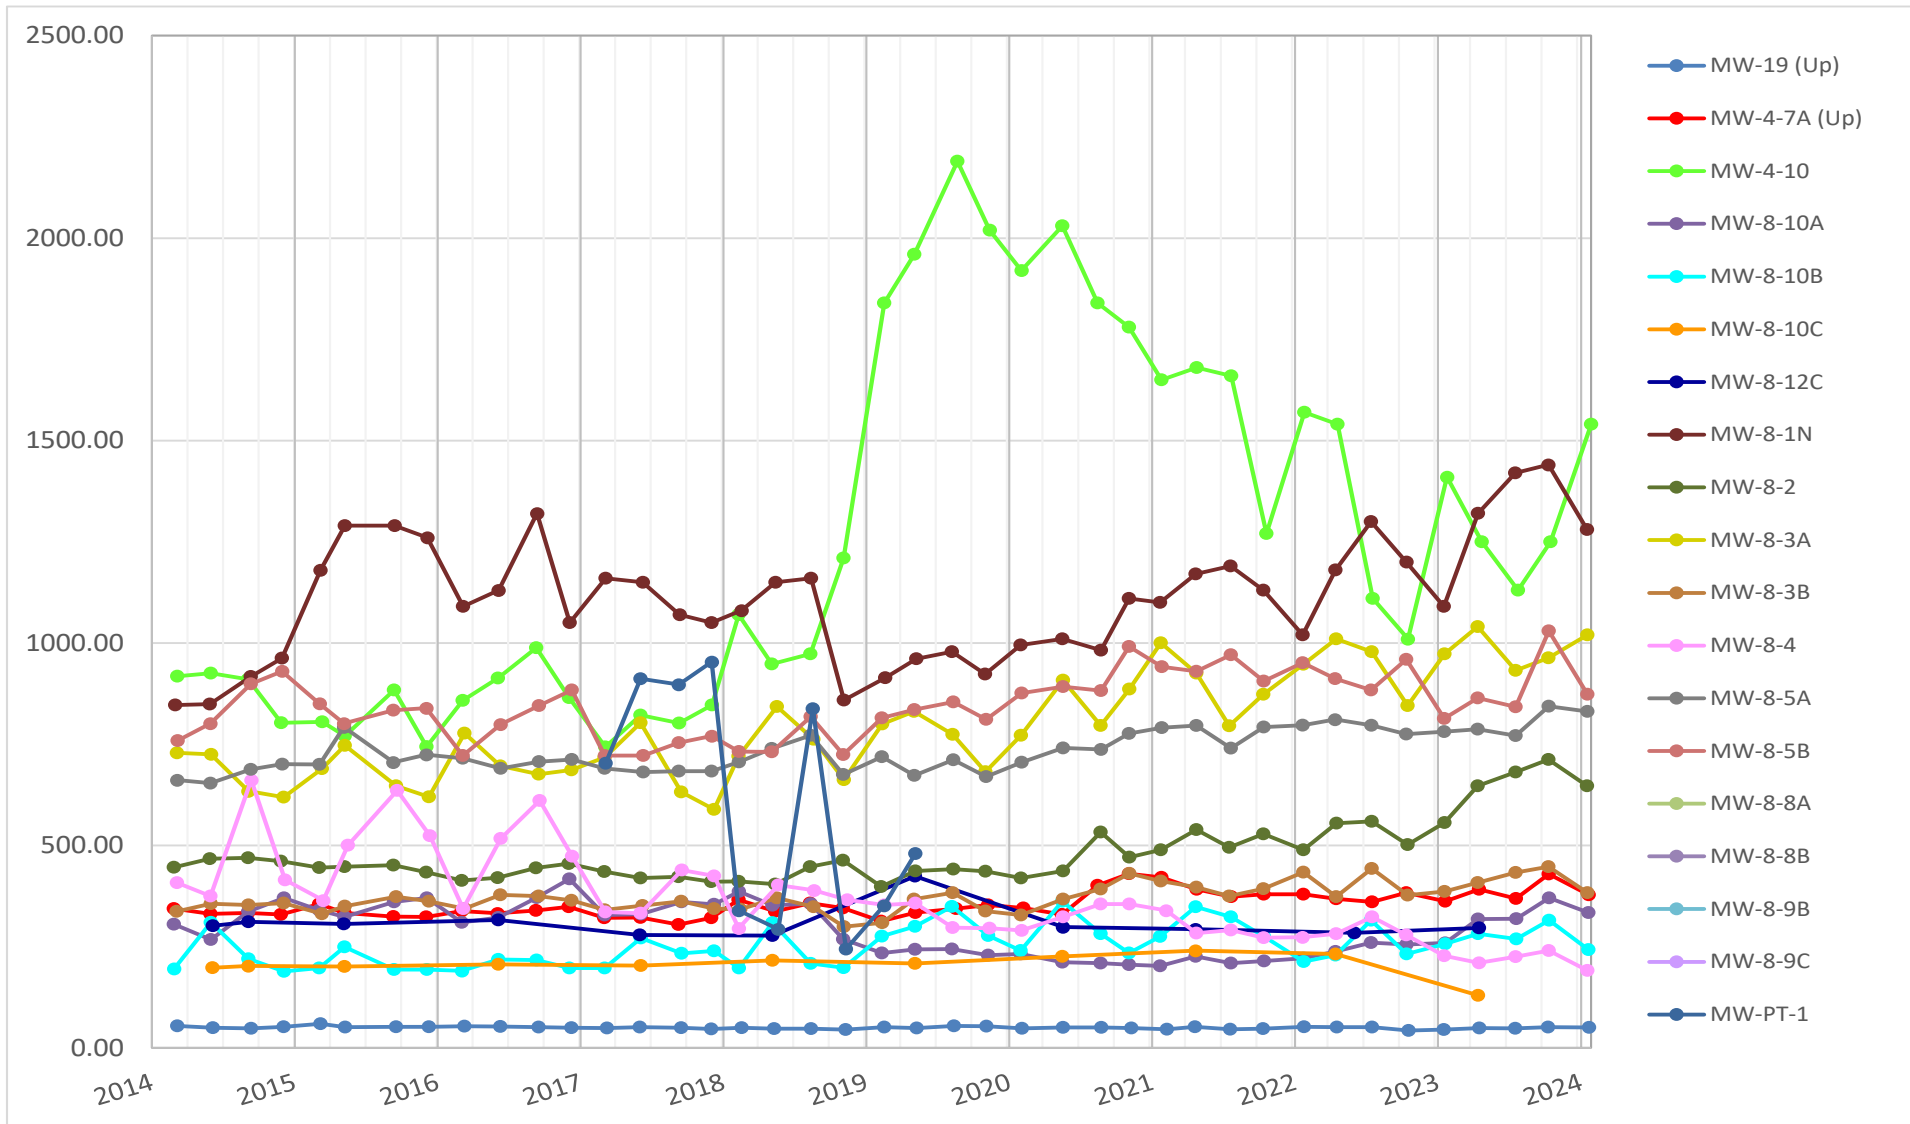

**NOTE: Data does not exceed standard of 4000  $\mu\text{g/l}$  during this time frame**


**Strontium, total [ $\mu\text{g/l}$ ]**

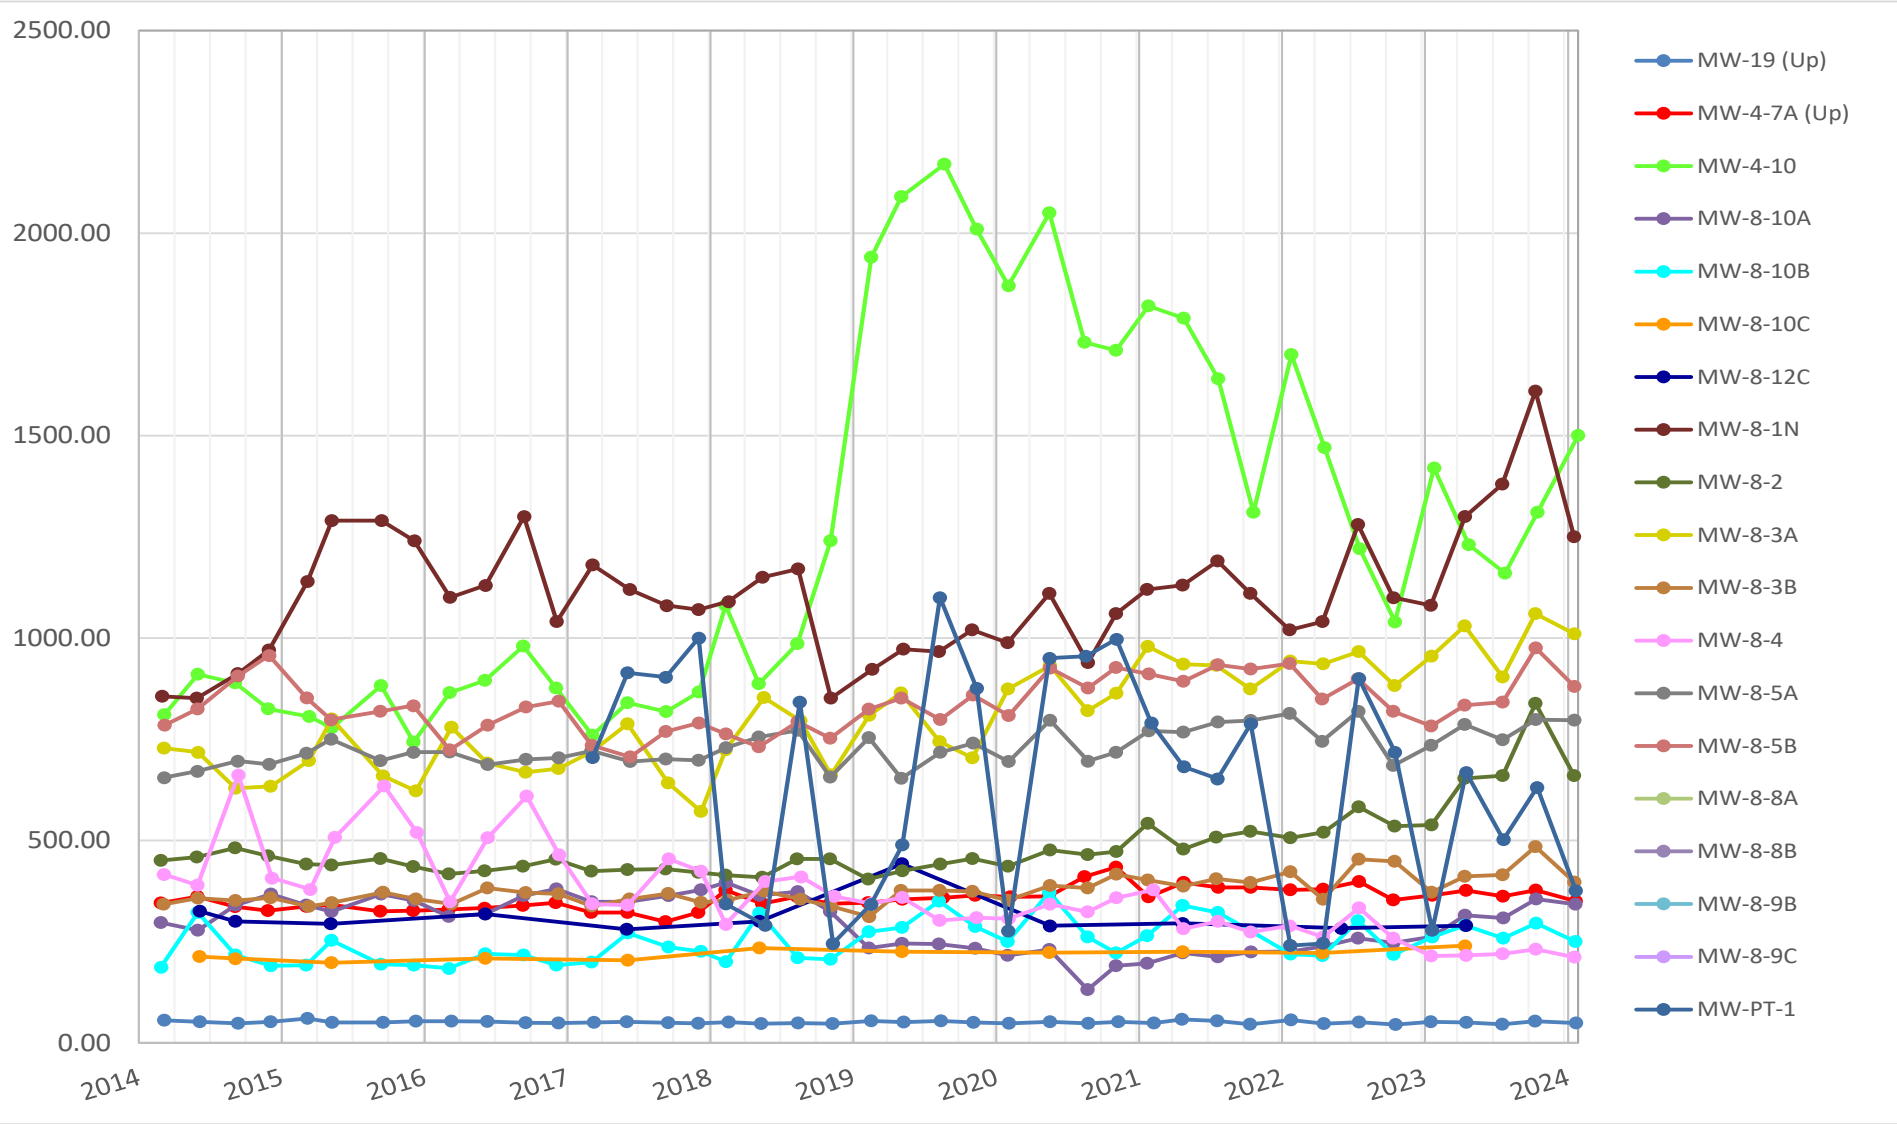

**NOTE: Data does not exceed standard of 4000  $\mu\text{g/l}$  during this time frame**




**Titanium, dissolved [ $\mu\text{g/l}$ ]**

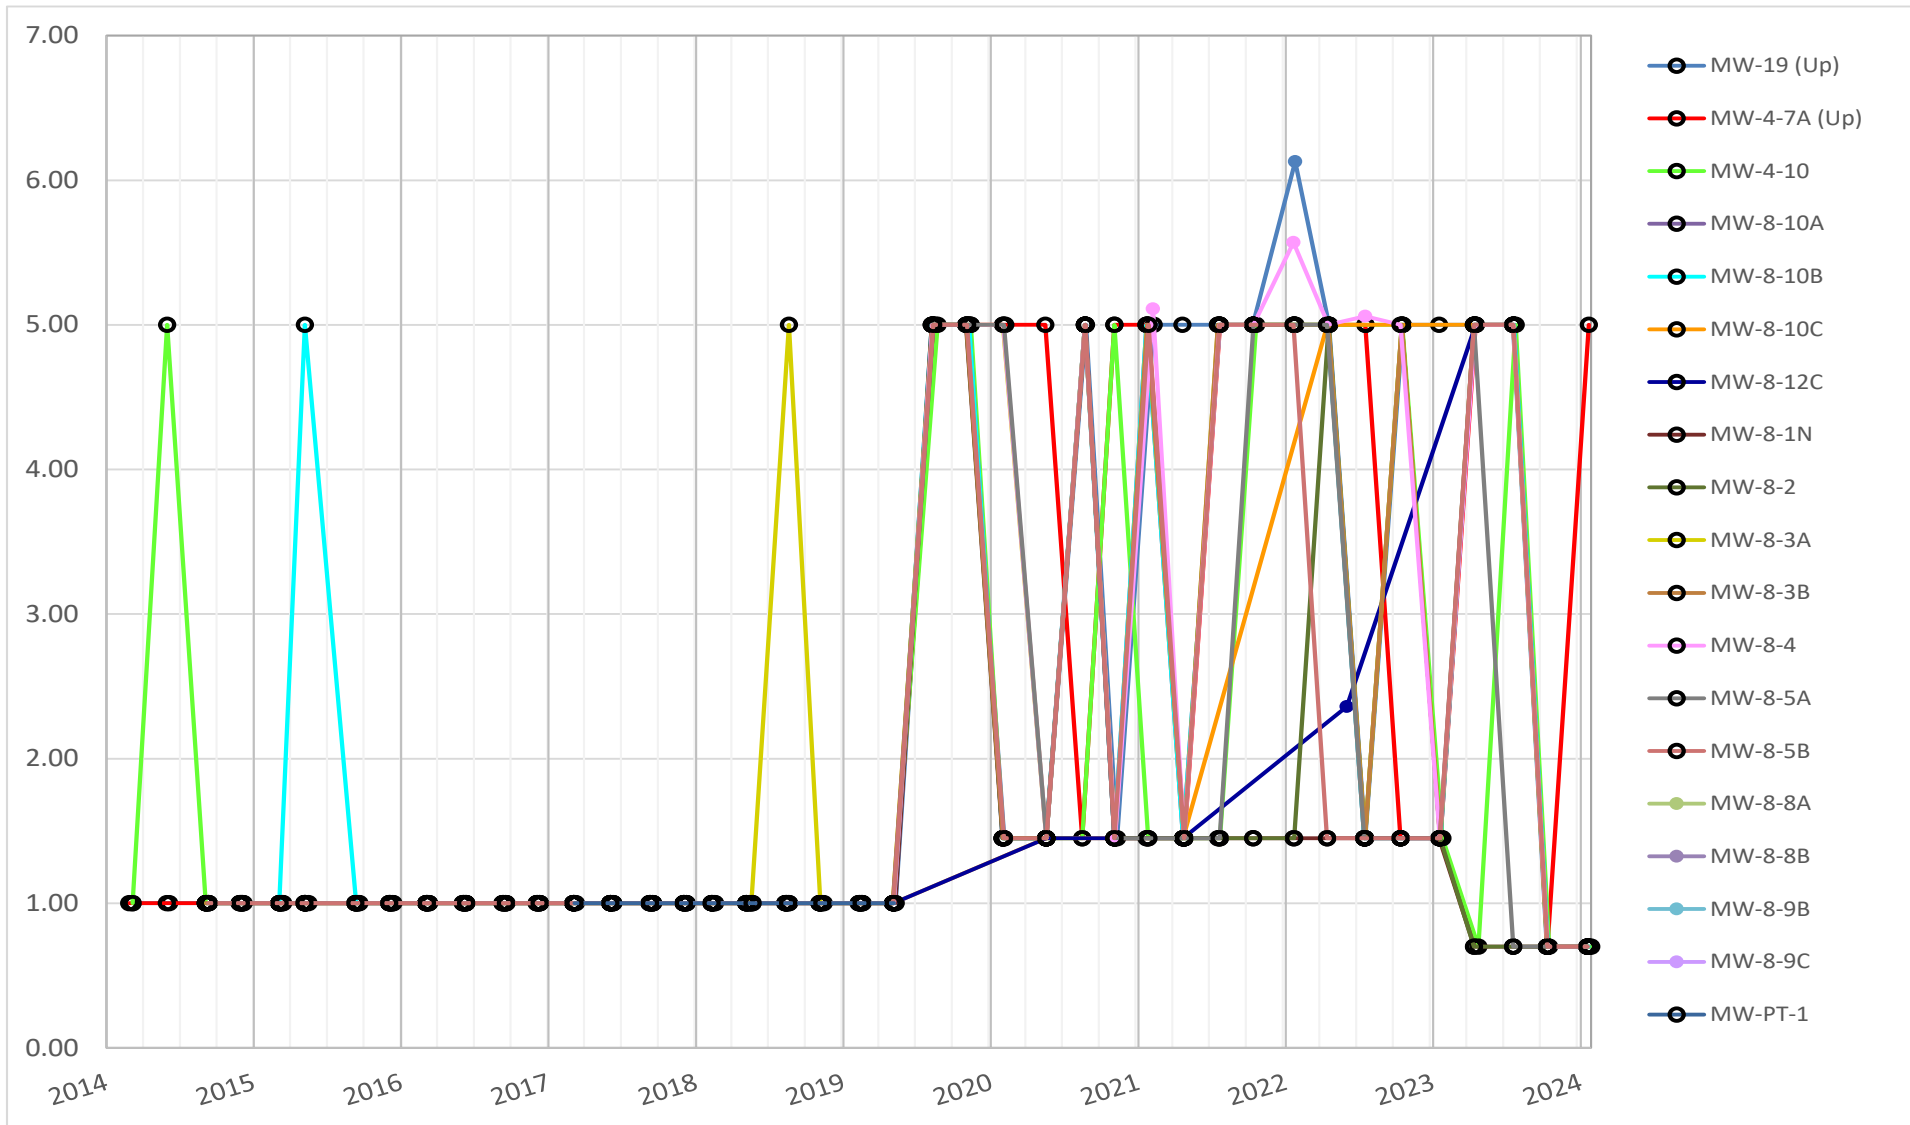


**NOTE: There are no applicable standards for this parameter**

**Titanium, total [ $\mu\text{g/l}$ ]**

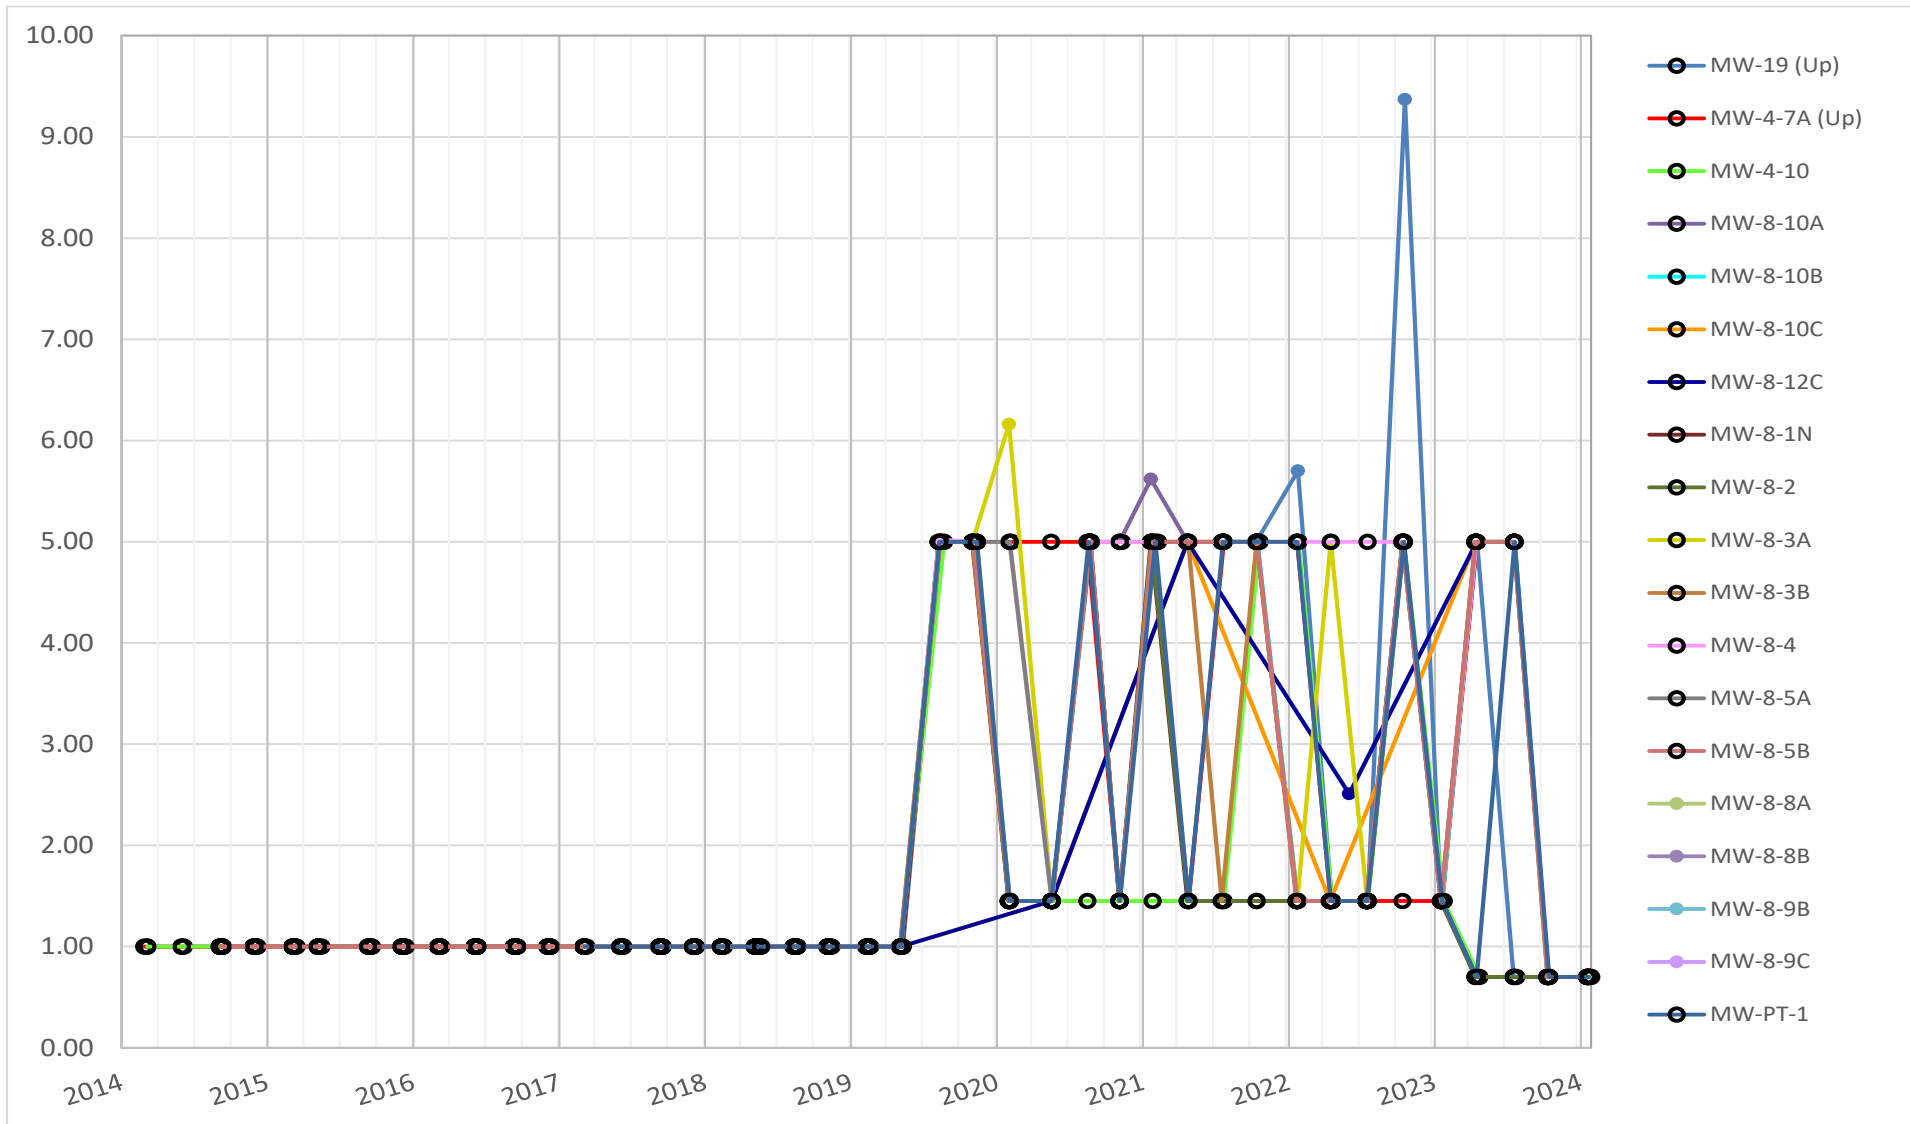


**NOTE: There are no applicable standards for this parameter**

**Total Dissolved Solids [mg/l]**

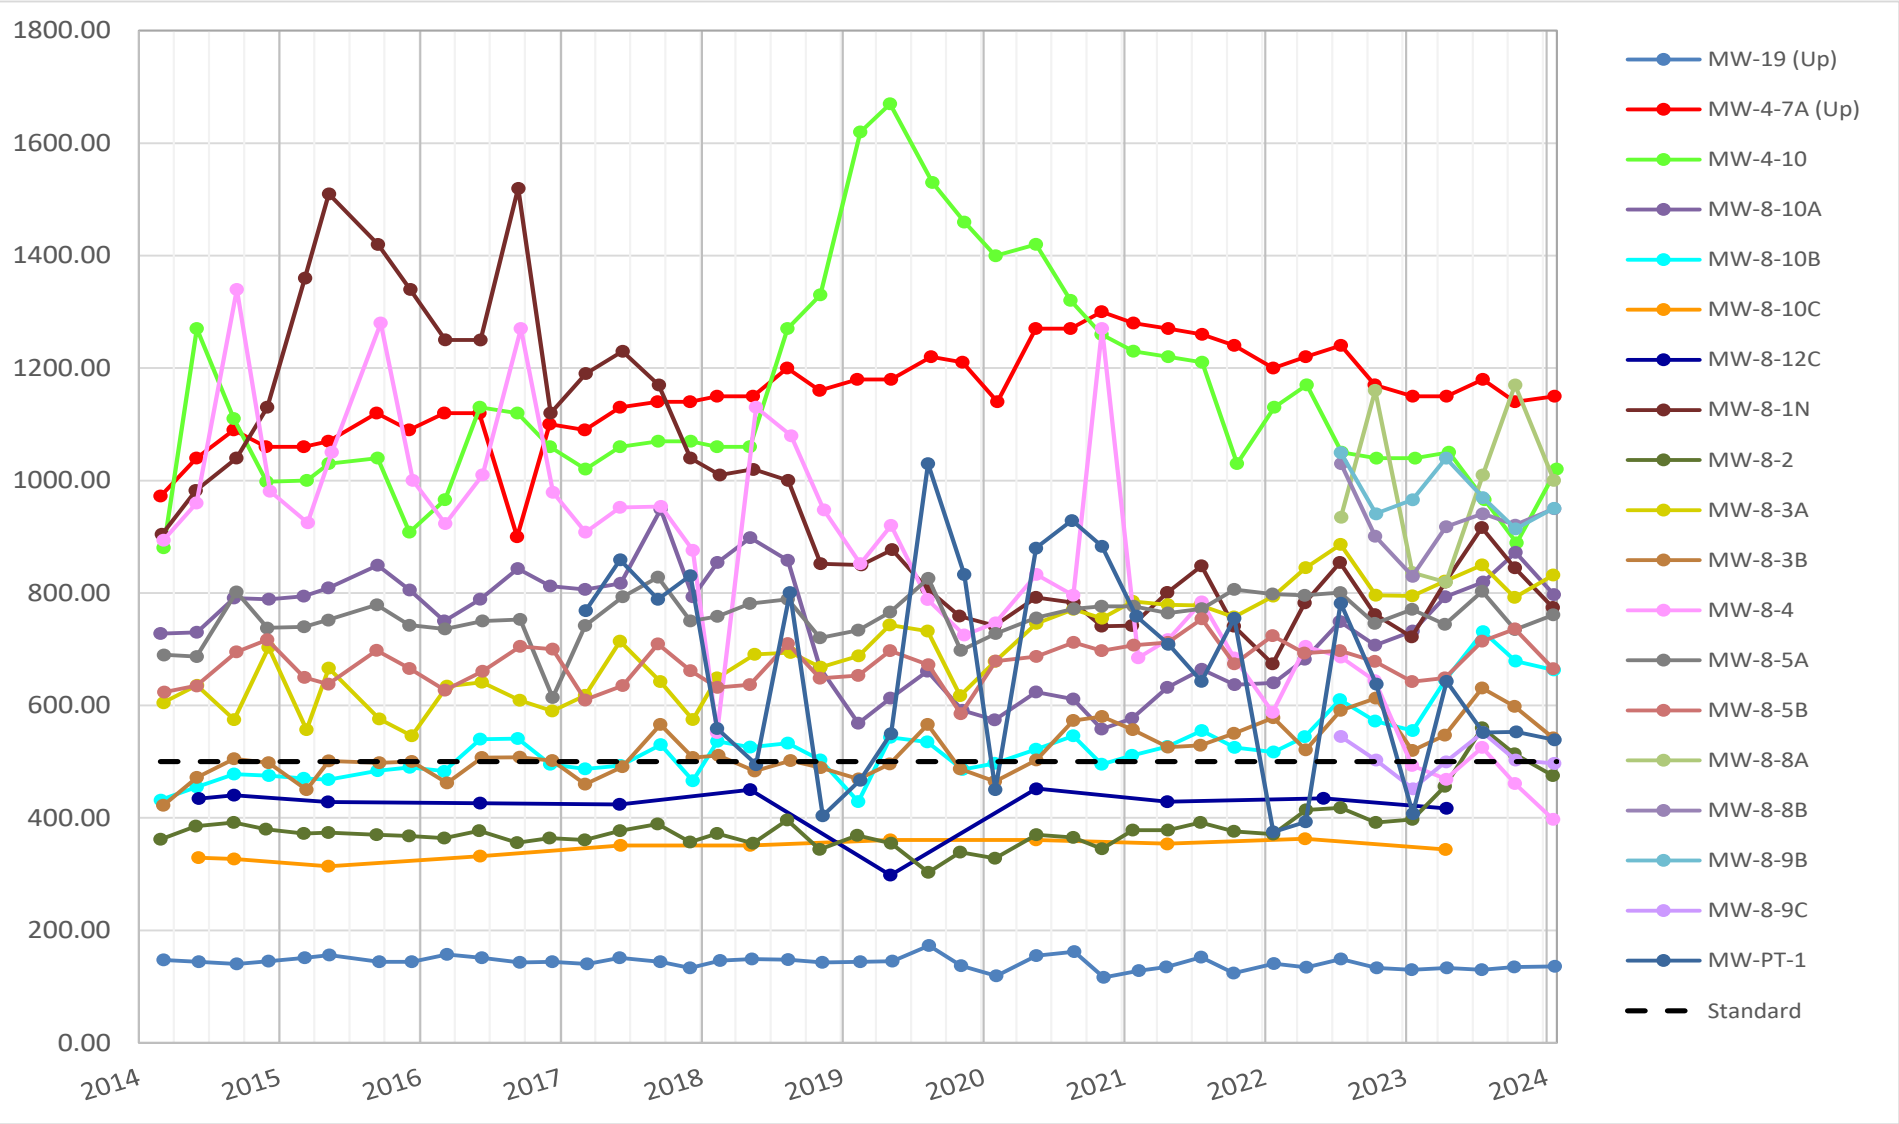


**Total Organic Carbon [mg/l]**

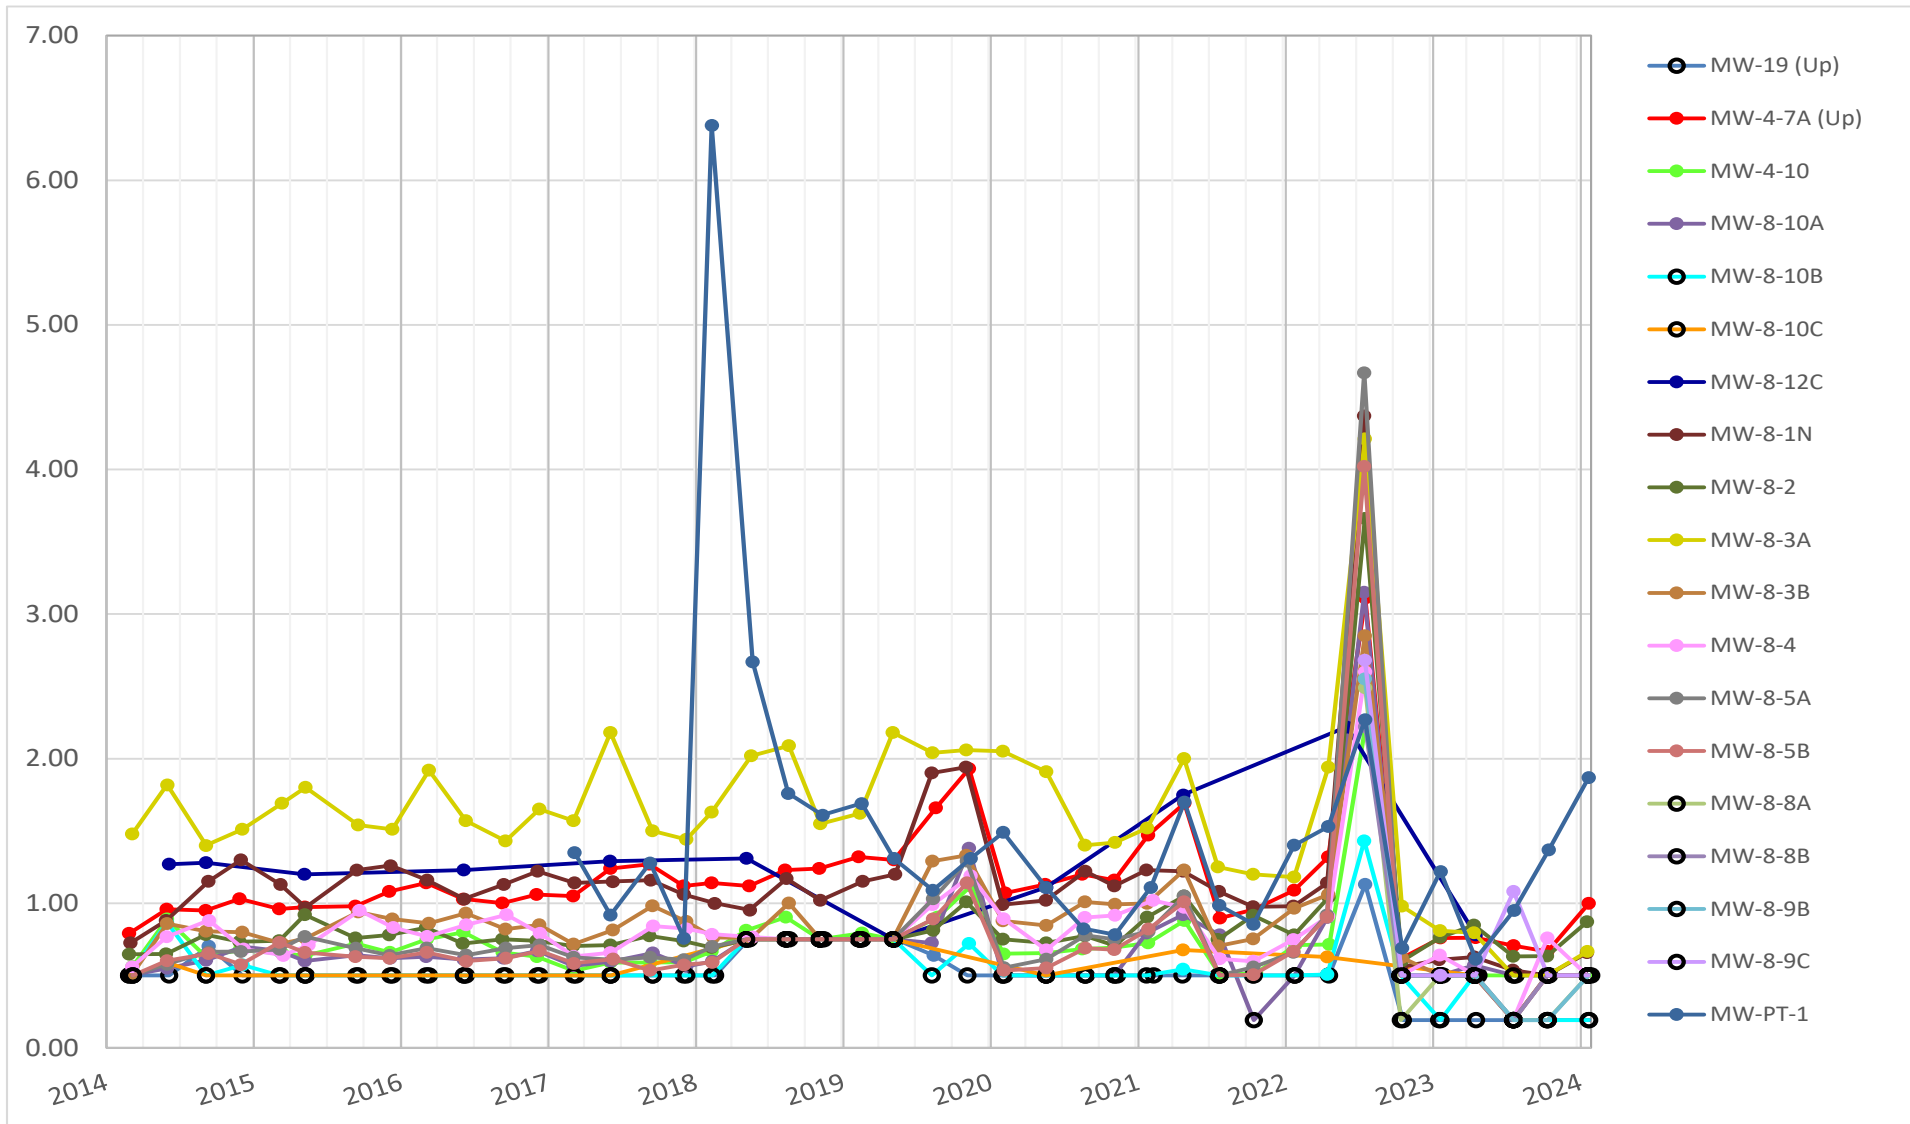


**NOTE: There are no applicable standards for this parameter**

**Turbidity, field [ntu]**

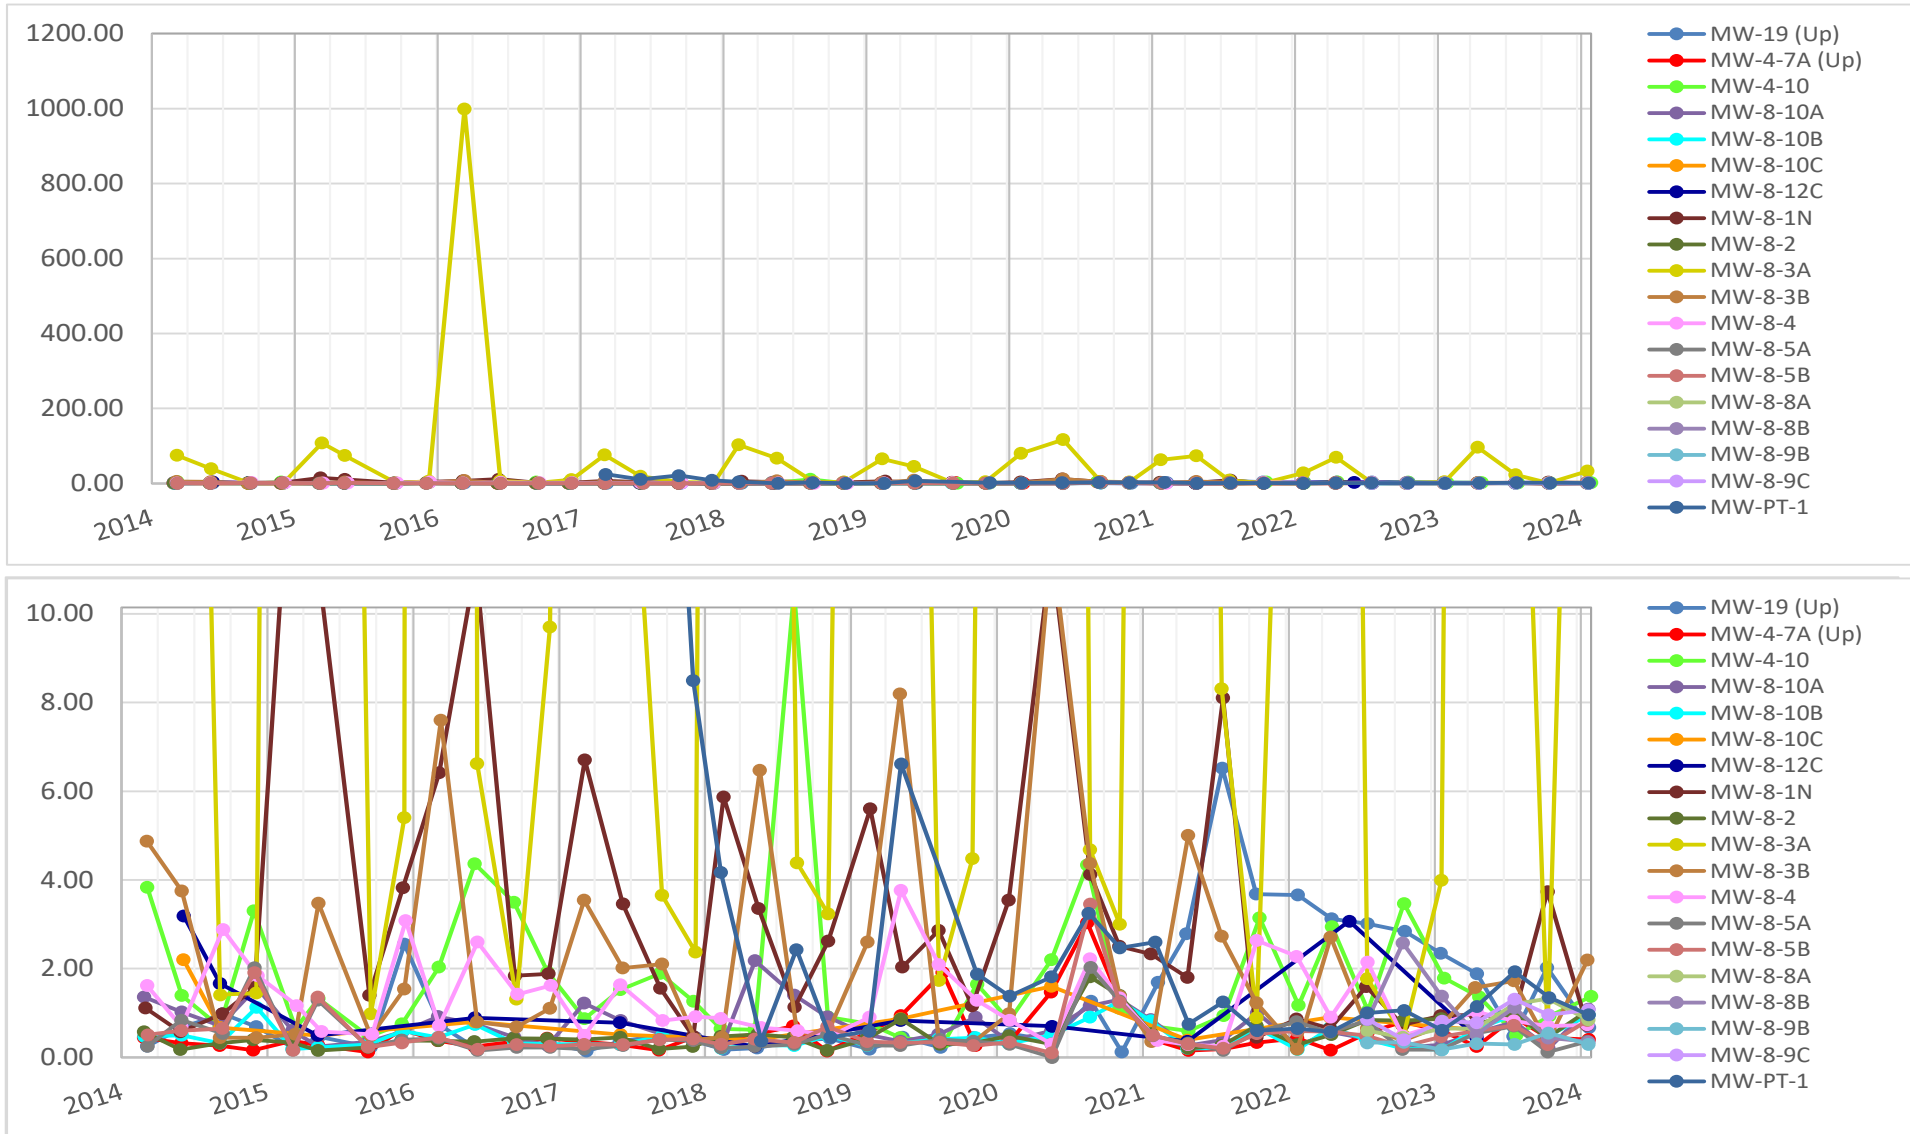


**NOTE: There are no applicable standards for this parameter**

**Vanadium, dissolved [ $\mu\text{g/l}$ ]**

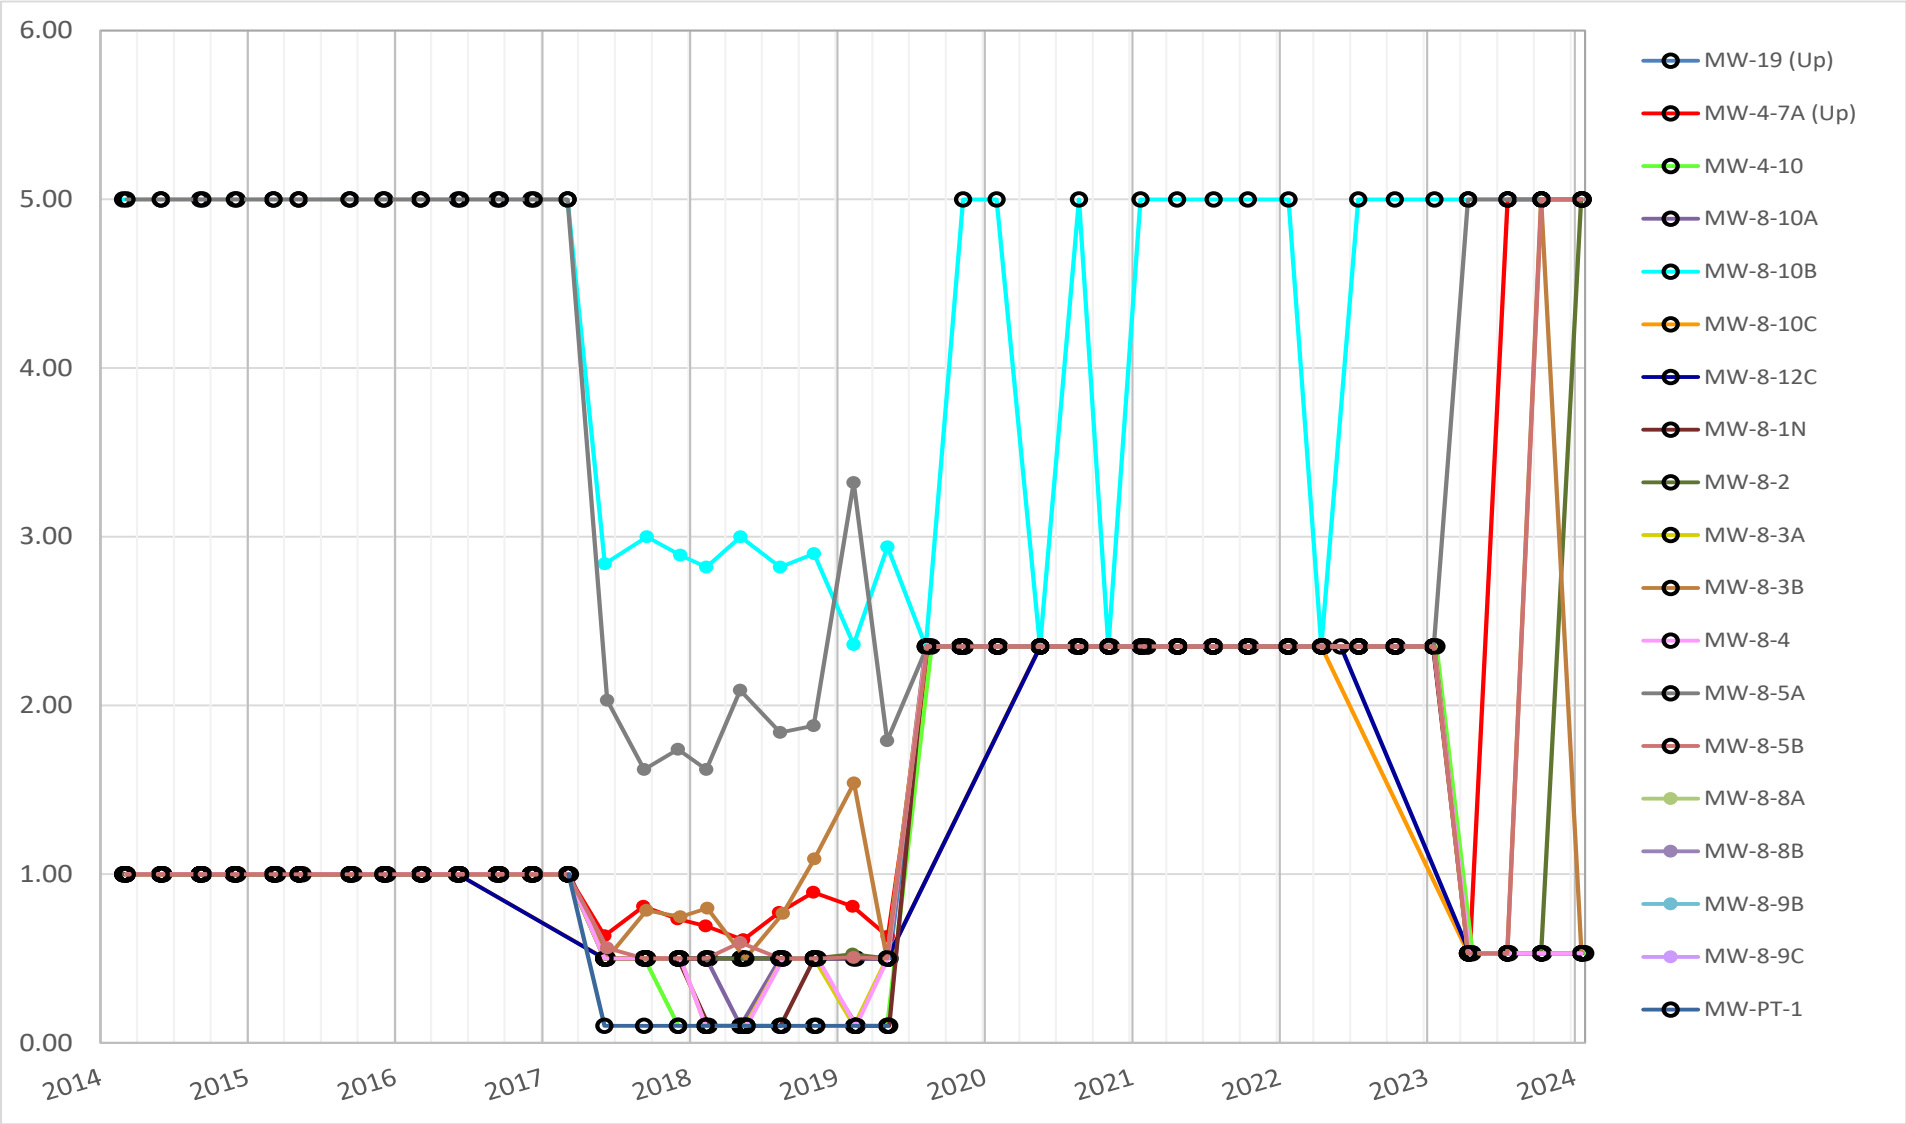


**NOTE: Data does not exceed standard of 170  $\mu\text{g/l}$  during this time frame**

**Vanadium, total [ $\mu\text{g/l}$ ]**

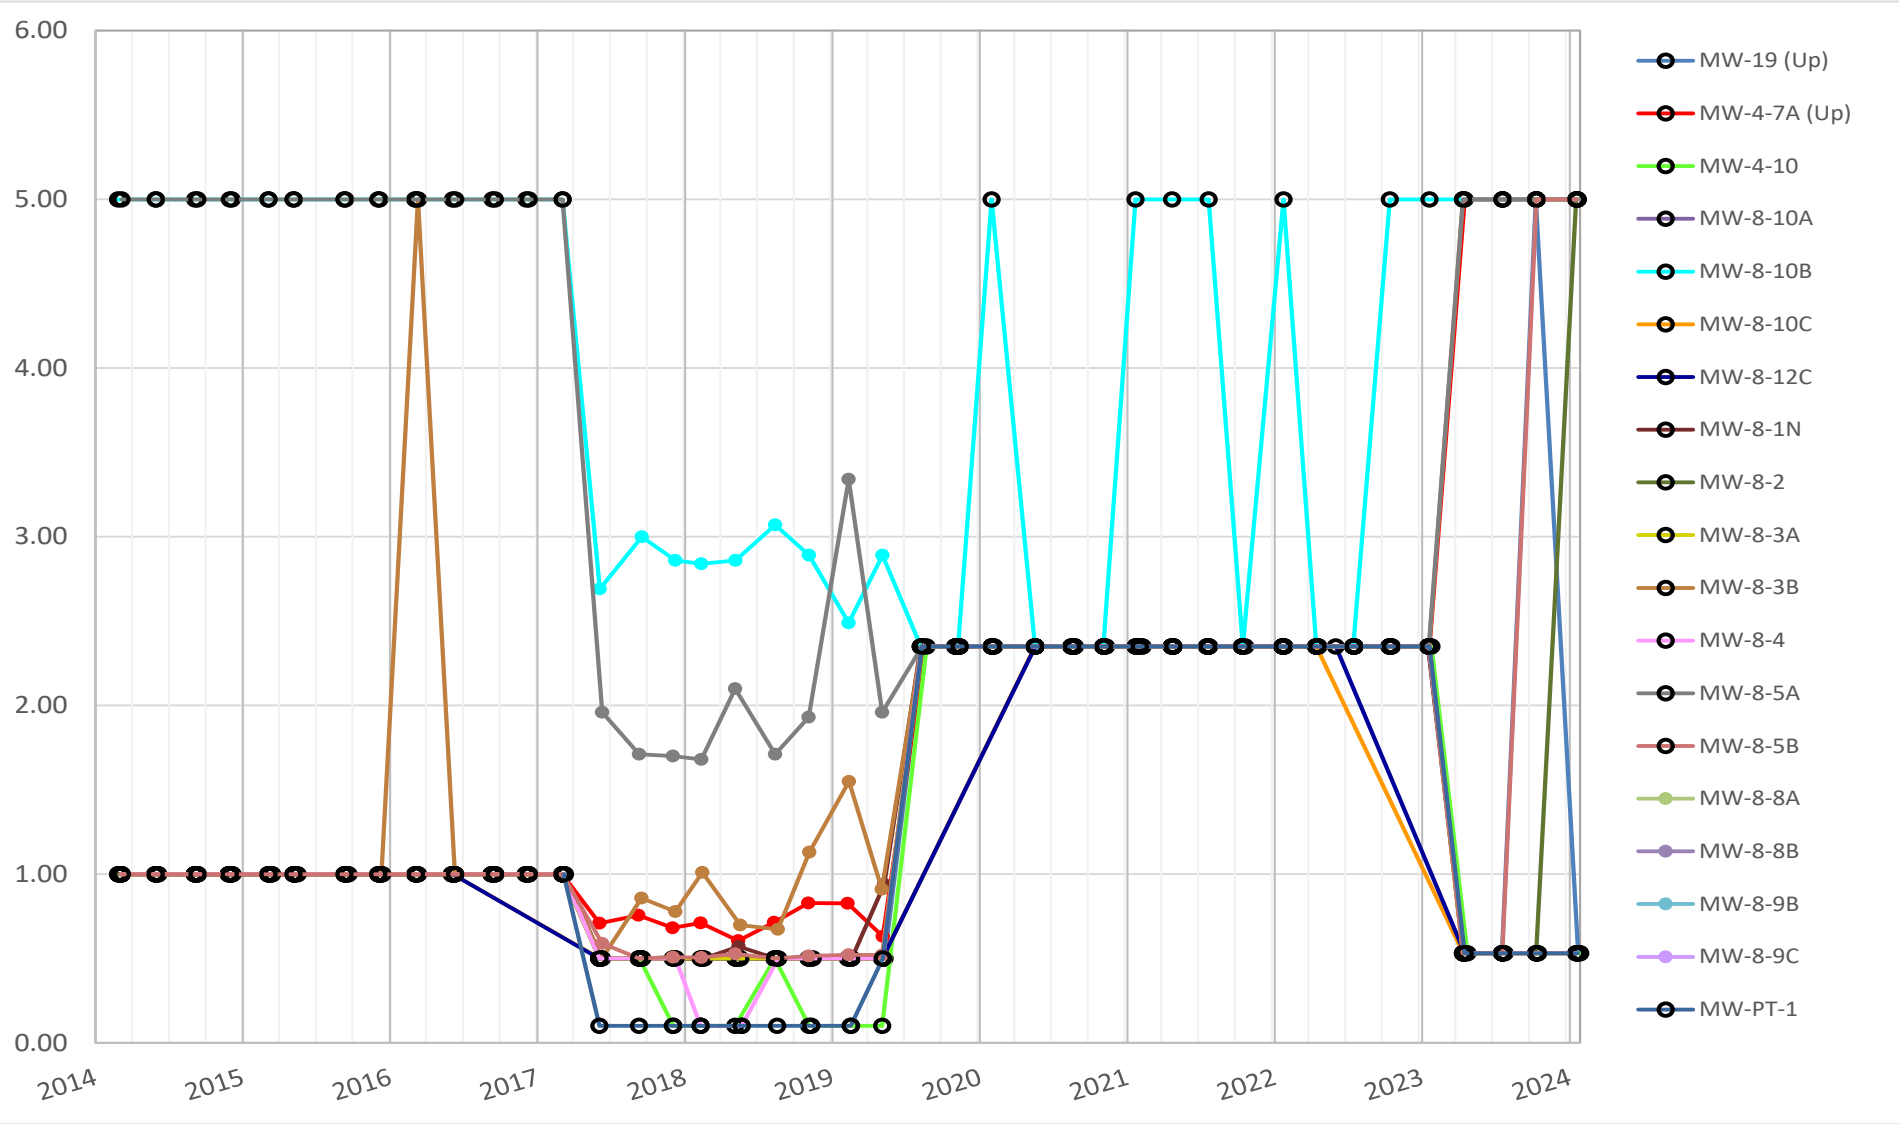


**NOTE: Data does not exceed standard of 170  $\mu\text{g/l}$  during this time frame**

**Water Surface Elevation [ft]**

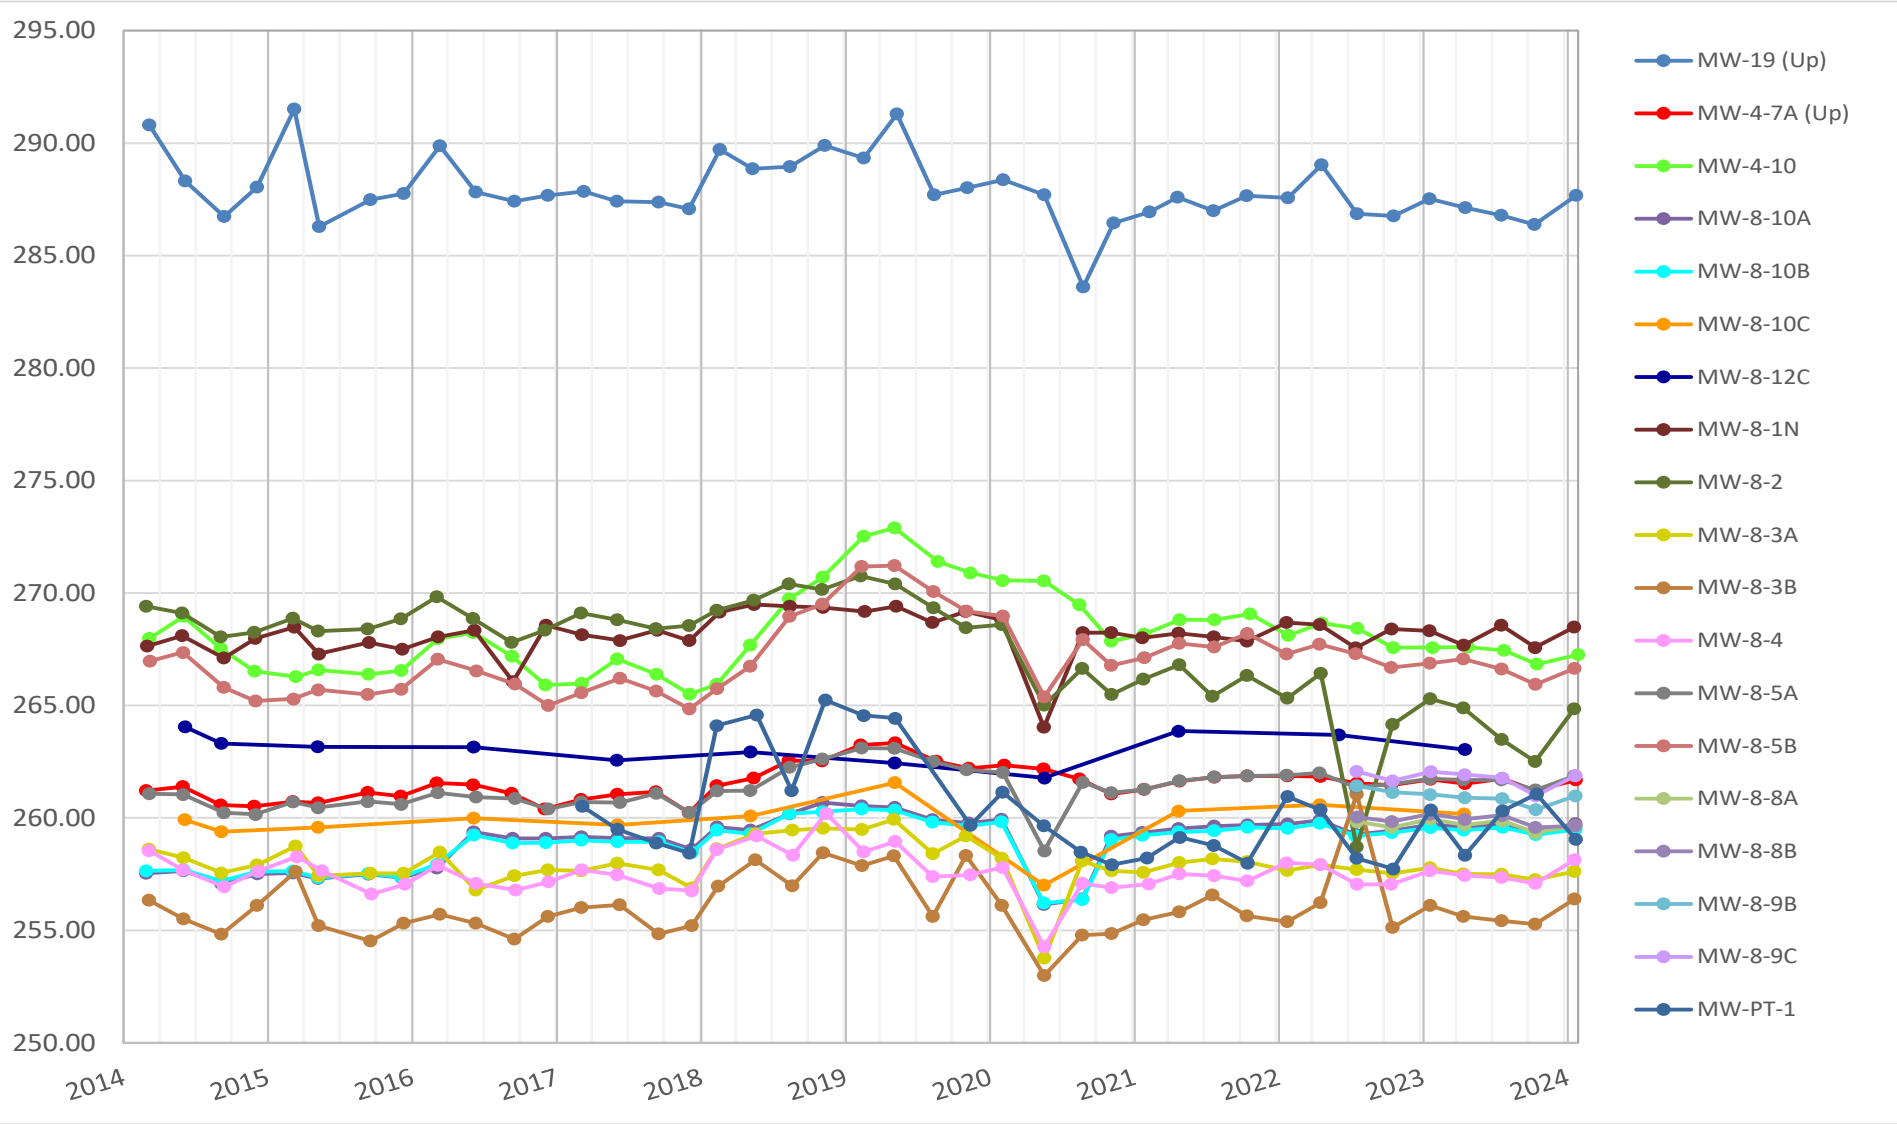


**NOTE: There are no applicable standards for this parameter**

**Zinc, dissolved [ $\mu\text{g/l}$ ]**

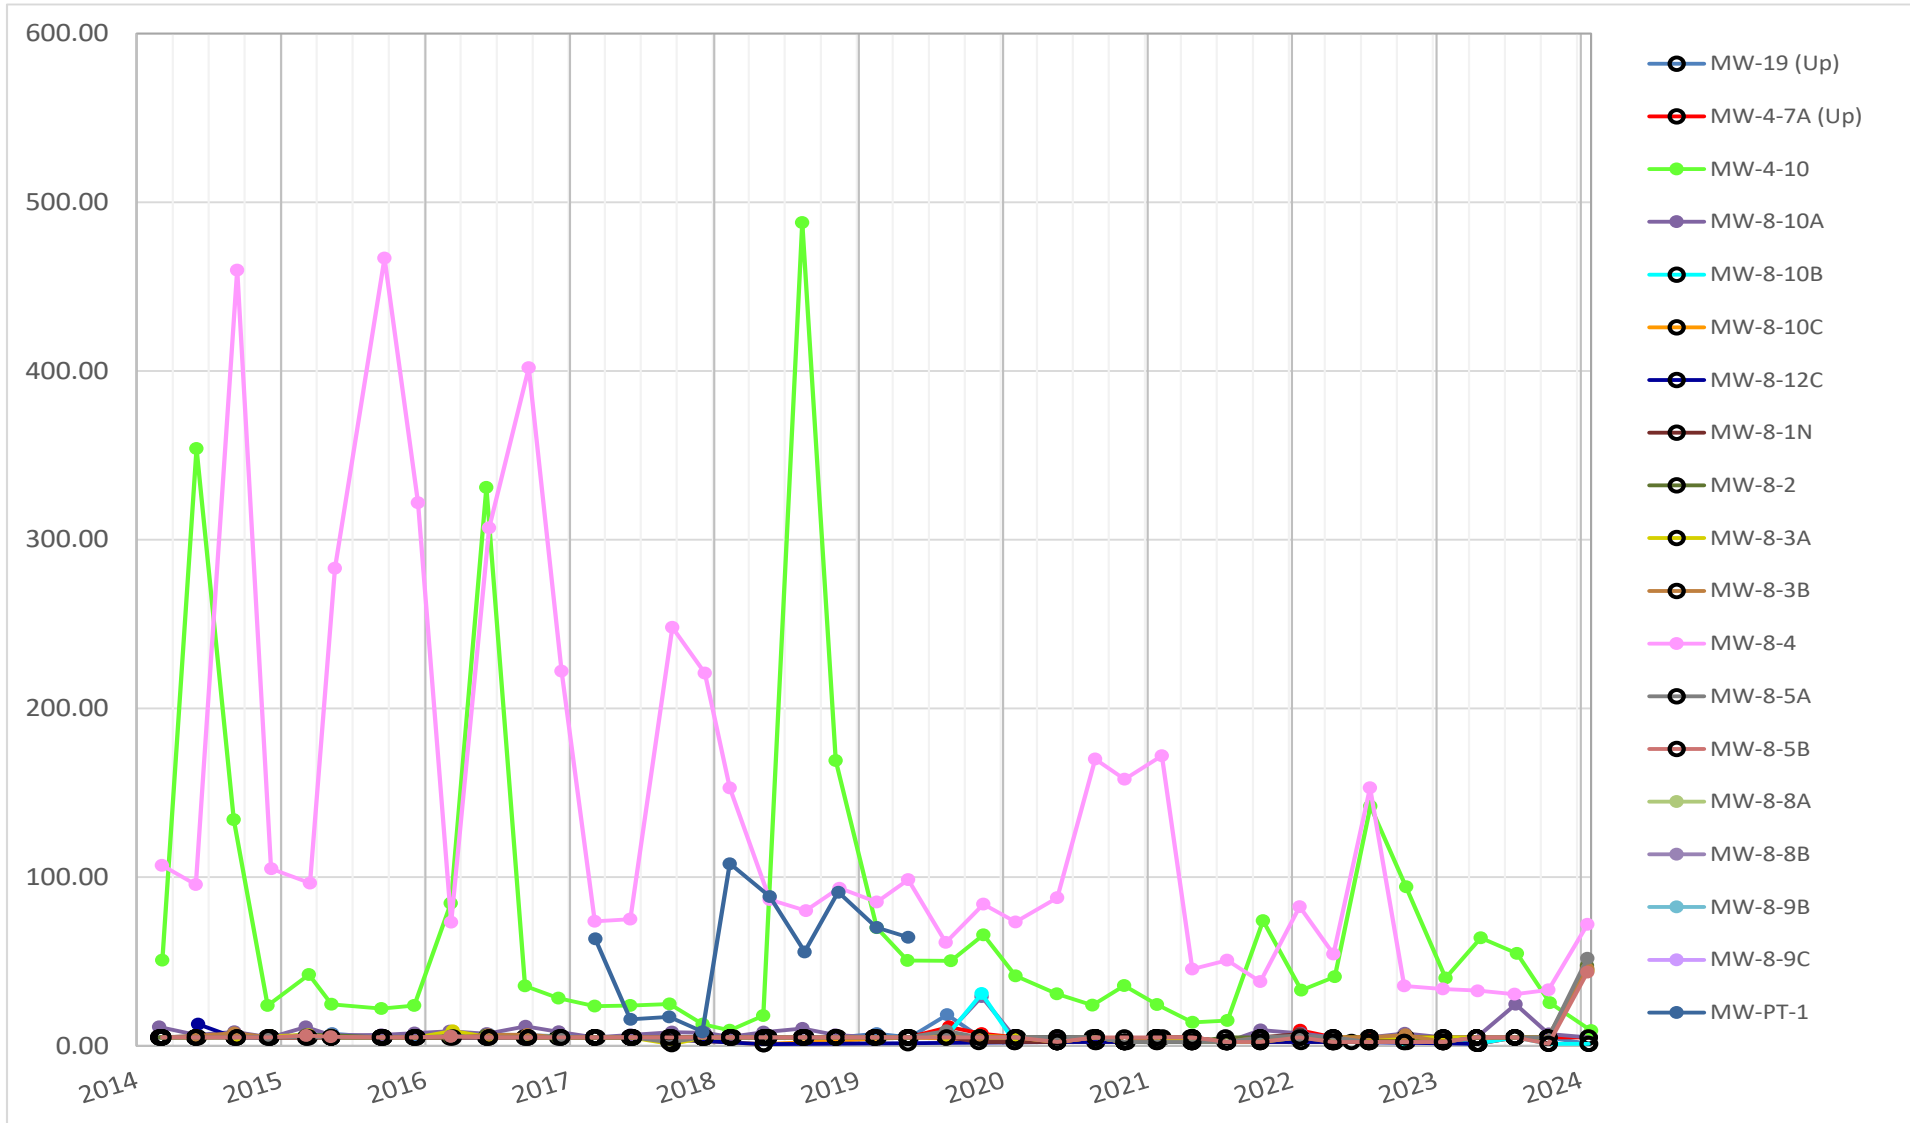


**NOTE: Data does not exceed standard of 2000  $\mu\text{g/l}$  during this time frame**


**Zinc, total [ $\mu\text{g}/\text{l}$ ]**

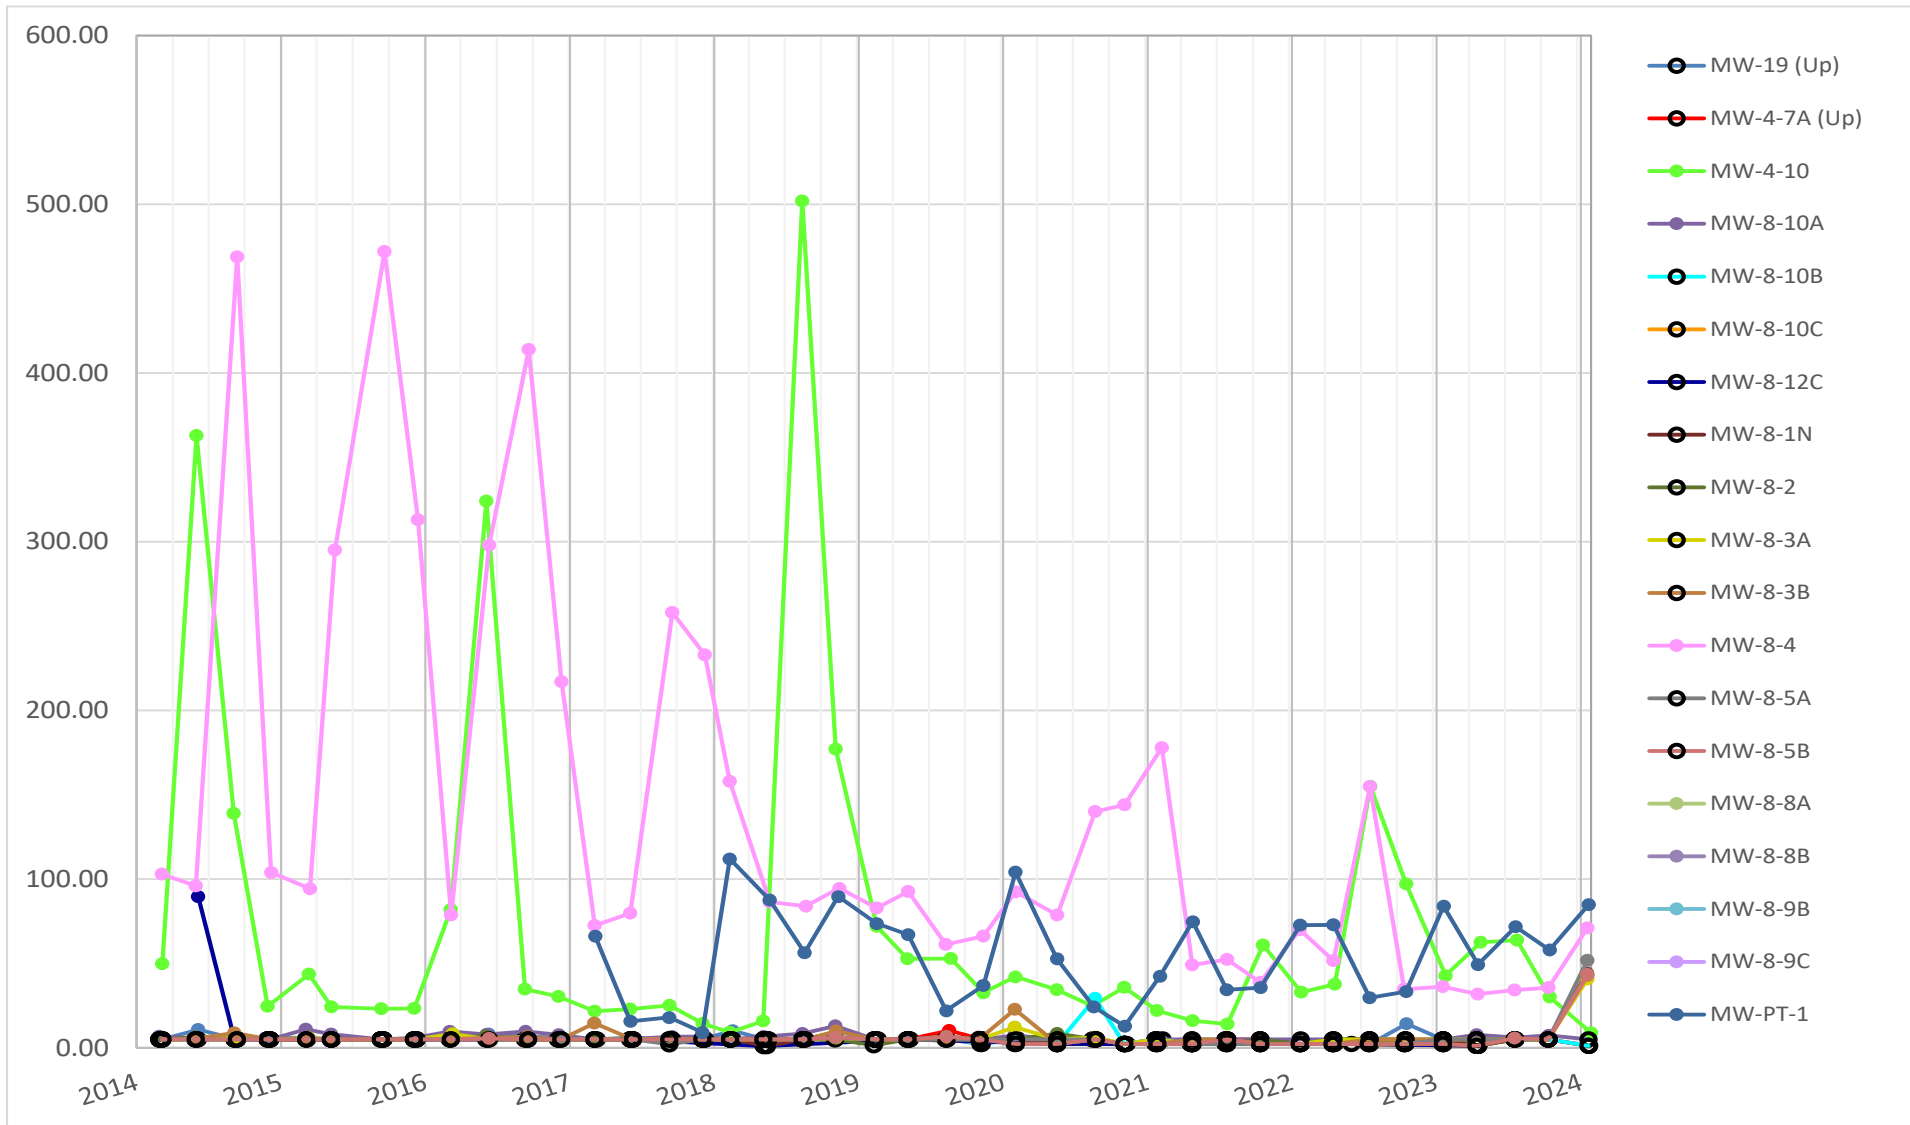


**NOTE: Data does not exceed standard of 2000  $\mu\text{g}/\text{l}$  during this time frame**

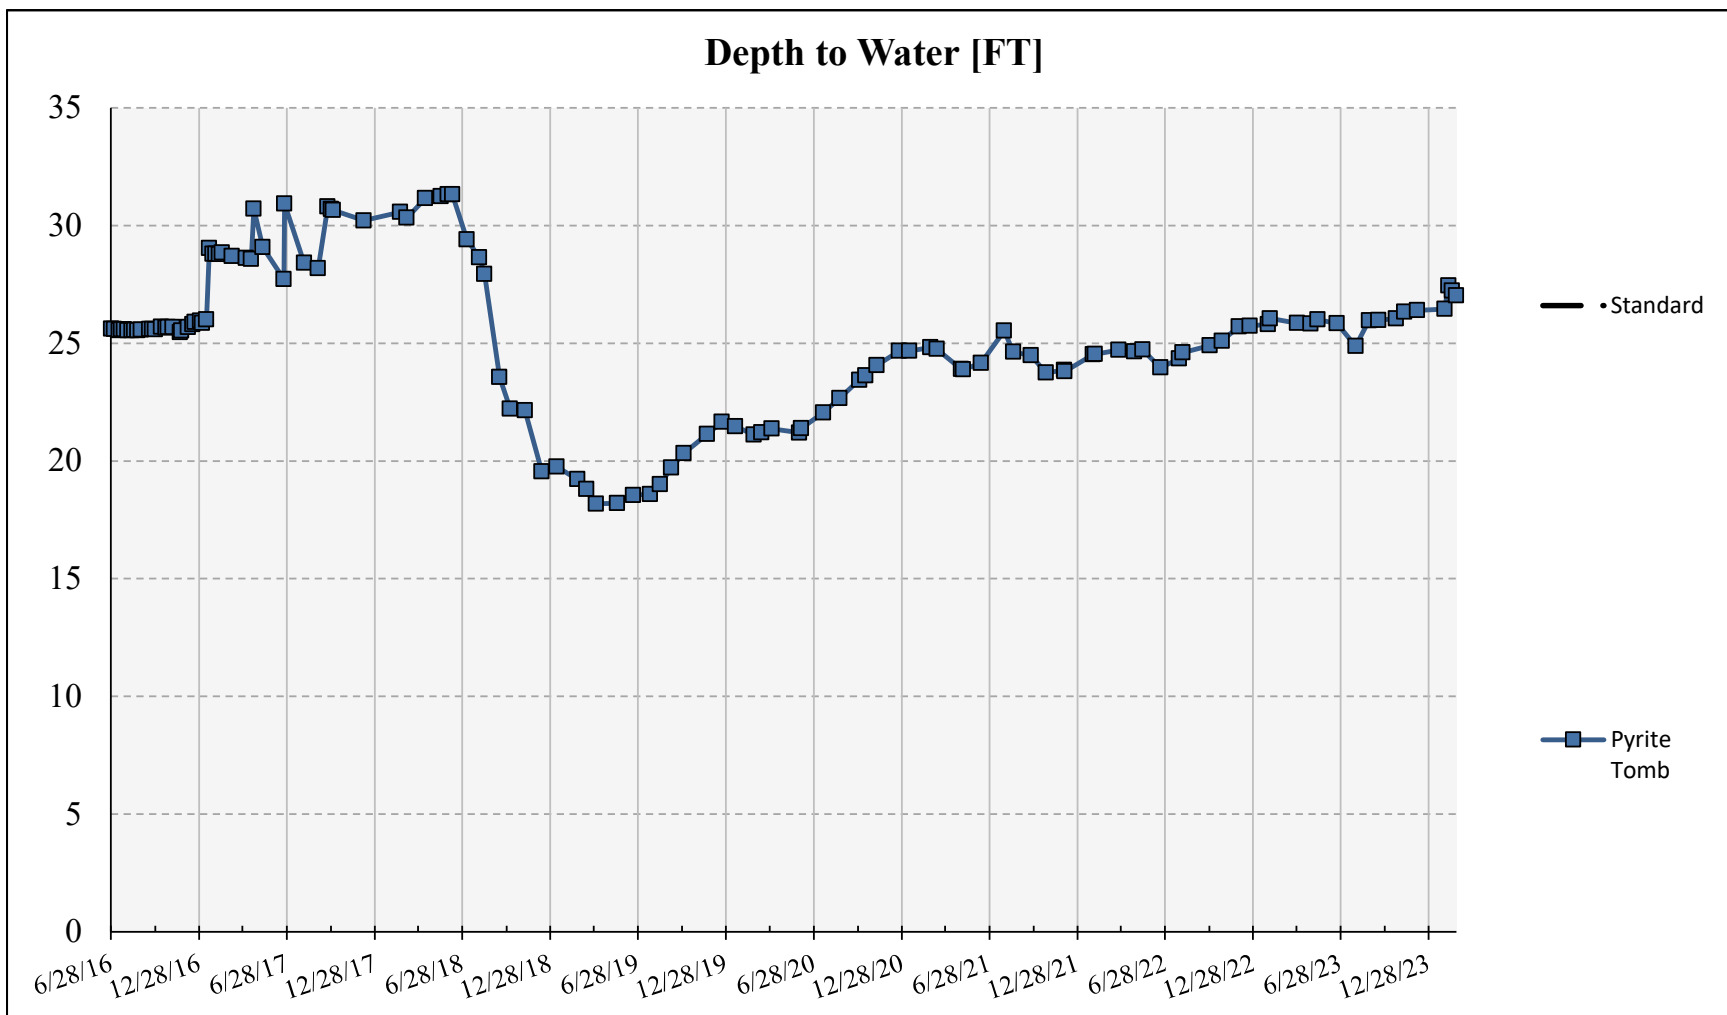

**NOTE: There are no applicable standards for this parameter.**

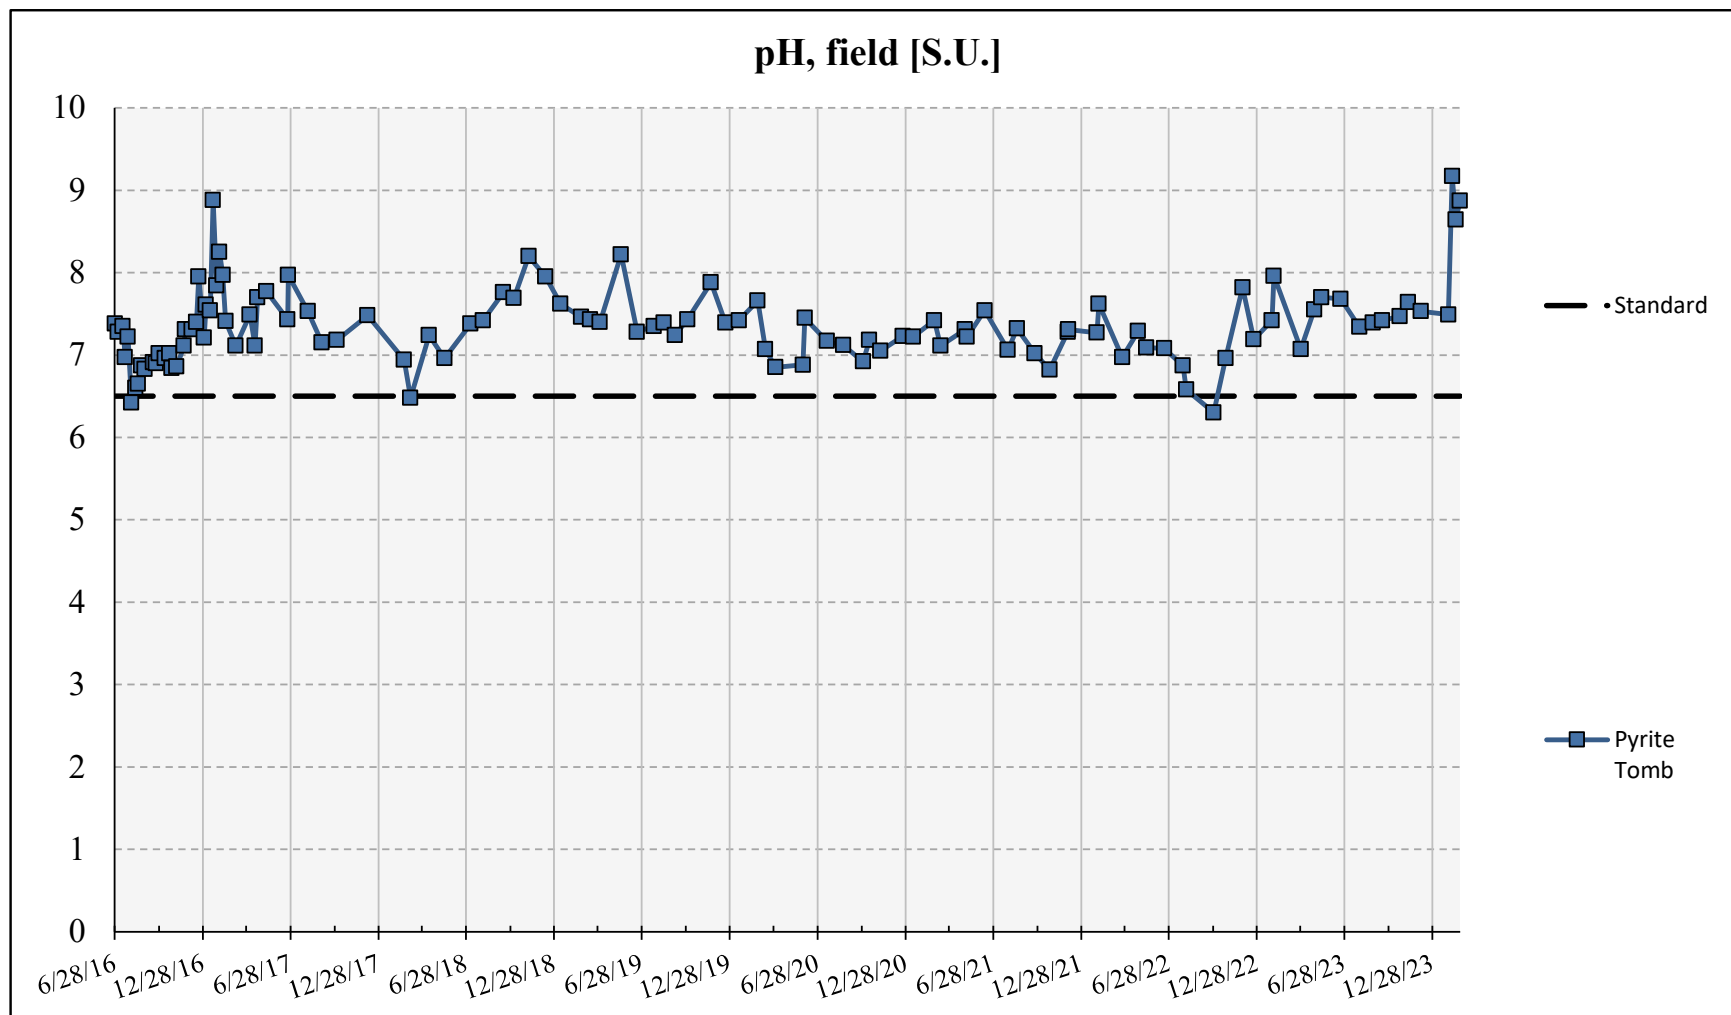

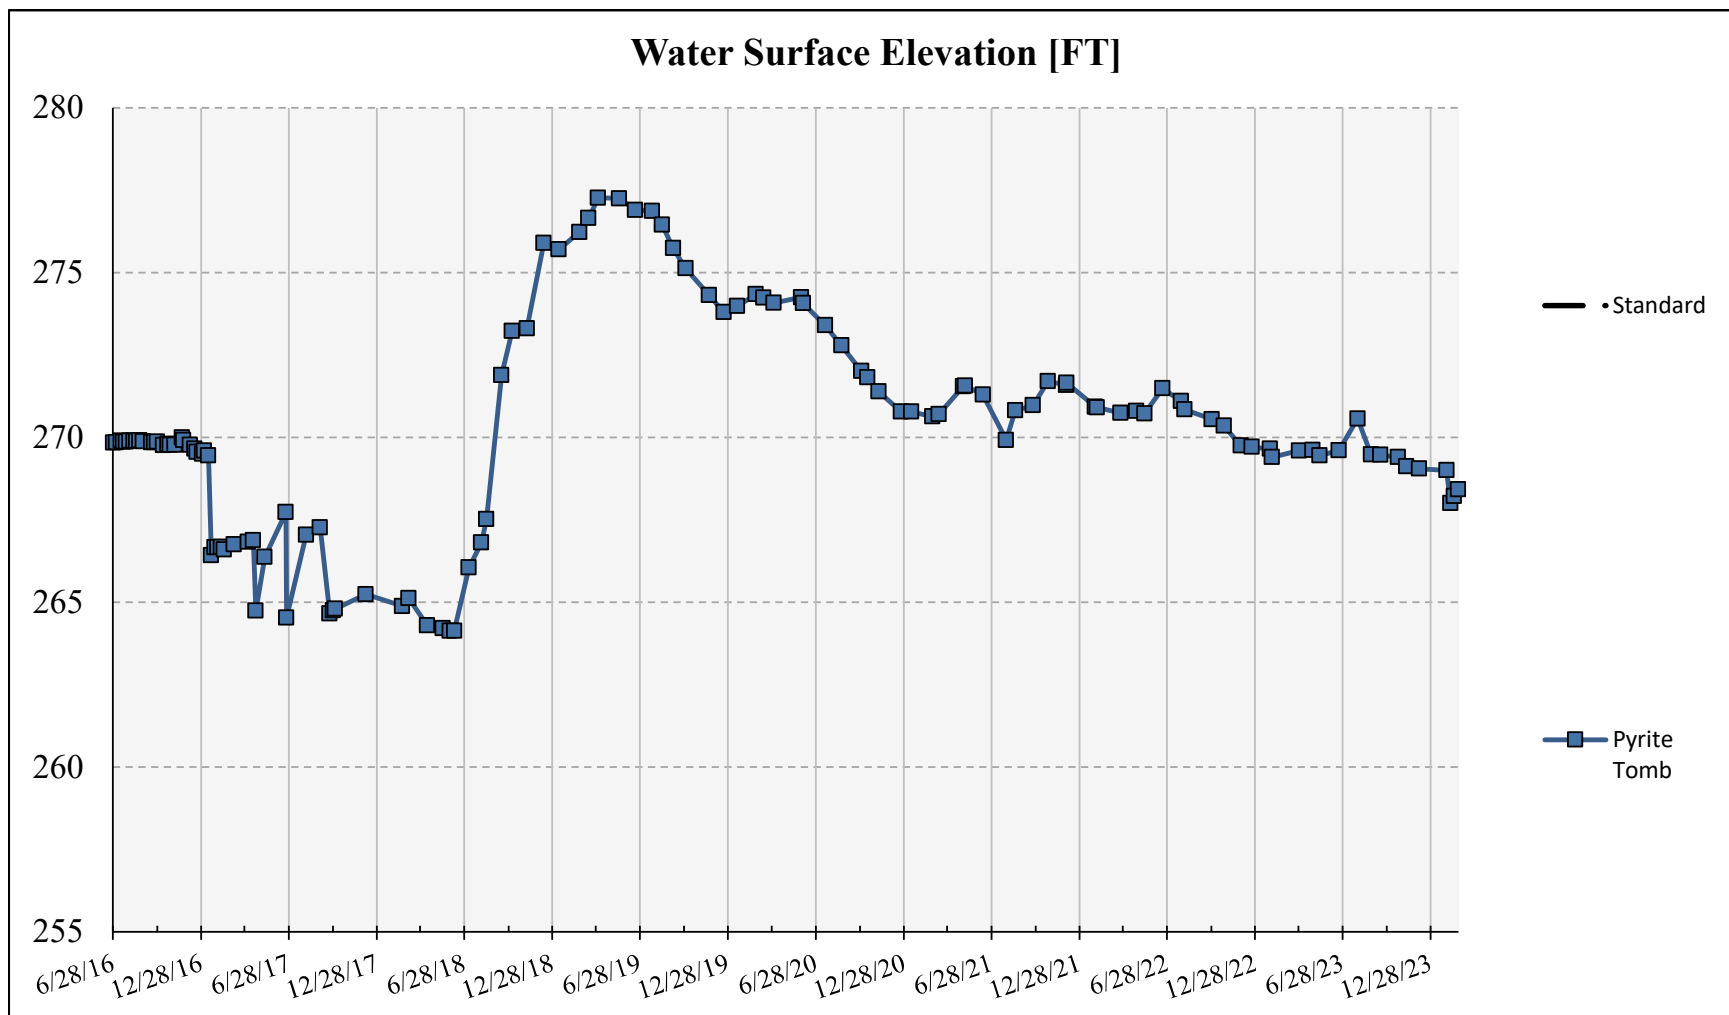

**NOTE: There are no applicable standards for this parameter.**